

SIEMENS



Industrial Controls

Safety Engineering
SIRIUS 3SK1 Safety Relays

Manual

Edition

02/2014

Answers for industry.

Industrial Controls

Safety engineering 3SK1 safety relays




Manual

Introduction	1
Product-specific safety information	2
Product overview for 3SK1	3
Safety systems - General information	4
3SK1 devices	5
System configuration	6
Circuit diagrams	7
Mounting	8
Connection	9
Configuration / operation	10
Commissioning	11
Display and diagnostics	12
Technical data	13
Dimension drawings	14
Accessories	15
Appendix	A

Legal information

Warning notice system

This manual contains notices you have to observe in order to ensure your personal safety, as well as to prevent damage to property. The notices referring to your personal safety are highlighted in the manual by a safety alert symbol, notices referring only to property damage have no safety alert symbol. These notices shown below are graded according to the degree of danger.

 DANGER
indicates that death or severe personal injury will result if proper precautions are not taken.
 WARNING
indicates that death or severe personal injury may result if proper precautions are not taken.
 CAUTION
indicates that minor personal injury can result if proper precautions are not taken.
NOTICE
indicates that property damage can result if proper precautions are not taken.


If more than one degree of danger is present, the warning notice representing the highest degree of danger will be used. A notice warning of injury to persons with a safety alert symbol may also include a warning relating to property damage.

Qualified Personnel

The product/system described in this documentation may be operated only by **personnel qualified** for the specific task in accordance with the relevant documentation, in particular its warning notices and safety instructions. Qualified personnel are those who, based on their training and experience, are capable of identifying risks and avoiding potential hazards when working with these products/systems.

Proper use of Siemens products

Note the following:

 WARNING
Siemens products may only be used for the applications described in the catalog and in the relevant technical documentation. If products and components from other manufacturers are used, these must be recommended or approved by Siemens. Proper transport, storage, installation, assembly, commissioning, operation and maintenance are required to ensure that the products operate safely and without any problems. The permissible ambient conditions must be complied with. The information in the relevant documentation must be observed.

Trademarks

All names identified by ® are registered trademarks of Siemens AG. The remaining trademarks in this publication may be trademarks whose use by third parties for their own purposes could violate the rights of the owner.

Disclaimer of Liability

We have reviewed the contents of this publication to ensure consistency with the hardware and software described. Since variance cannot be precluded entirely, we cannot guarantee full consistency. However, the information in this publication is reviewed regularly and any necessary corrections are included in subsequent editions.

Table of contents

1	Introduction.....	11
1.1	User responsibility for system design and function.....	11
1.2	Required basic knowledge.....	11
1.3	Validity range	11
1.4	Definitions	12
1.5	Service&Support	12
1.6	Configurator for 3SK1 safety relays	14
1.7	DataMatrix code	15
1.8	Correction sheet.....	16
1.9	History	16
2	Product-specific safety information	17
2.1	General safety notes	17
2.2	Intended use	20
2.3	Current information about operational safety.....	20
2.4	Declaration of conformity.....	21
3	Product overview for 3SK1	23
3.1	Overview.....	23
3.2	Overview of components and accessory parts.....	26
3.3	Functional scope of the 3SK1 basic units.....	27
3.4	Introduction	28
3.5	3SK1 system.....	29
3.5.1	Standard	29
3.5.1.1	Typical system configuration	29
3.5.2	Advanced.....	30
3.5.2.1	Typical system configuration	30
4	Safety systems - General information.....	33
4.1	What is safety?.....	33
4.2	Safety function	34
4.3	Basic terminology	35
4.3.1	Redundancy/single-channel and two-channel	35
4.3.2	Cross-circuit detection.....	36
4.3.3	Enabling circuit.....	36
4.3.4	Signaling circuit	37
4.3.5	Feedback circuit.....	37

4.3.6	Stop categories	37
4.3.7	Automatic start	38
4.3.8	Manual start	38
4.3.9	Monitored start	39
4.3.10	Two-hand operation/synchronism	40
4.3.11	Cascading	41
4.3.12	Startup testing	41
4.3.13	Connection of actuators	42
4.3.14	Series connection of sensors	45
5	3SK1 devices	47
5.1	3SK1 standard	47
5.1.1	General information	47
5.1.2	Applications	47
5.1.3	3SK1111 Standard basic unit instantaneous (with relay outputs)	48
5.1.3.1	General information	48
5.1.3.2	Function description	48
5.1.3.3	Design	49
5.1.3.4	Terminal assignment	50
5.1.3.5	Inputs	50
5.1.3.6	Outputs	51
5.1.3.7	Display of the operating state	52
5.1.3.8	Function setting	52
5.1.4	3SK1112 Standard basic unit instantaneous (with solid-state outputs)	55
5.1.4.1	General information	55
5.1.4.2	Function description	56
5.1.4.3	Design	57
5.1.4.4	Terminal assignment	58
5.1.4.5	Inputs	58
5.1.4.6	Outputs	59
5.1.4.7	Display of the operating state	59
5.1.4.8	Function setting	60
5.2	3SK1 Advanced	62
5.2.1	General information	62
5.2.2	Applications	62
5.2.3	General device features	63
5.2.4	Function description	63
5.2.5	Functions	64
5.2.6	3SK1121 Advanced basic unit instantaneous (with relay outputs)	66
5.2.6.1	Device features	66
5.2.6.2	Function description	66
5.2.6.3	Design	67
5.2.6.4	Terminal assignment	68
5.2.7	3SK1121 Advanced basic unit time-delayed (with relay outputs)	69
5.2.7.1	Device features	69
5.2.7.2	Design	70
5.2.7.3	Terminal assignment	71
5.2.8	3SK1122 Advanced basic unit instantaneous (with solid-state outputs)	73
5.2.8.1	Device features	73
5.2.8.2	Design	74
5.2.8.3	Terminal assignment	75
5.2.9	3SK1122 Advanced basic unit time-delayed (with solid-state outputs)	77

5.2.9.1	Device features	77
5.2.9.2	Design	78
5.2.9.3	Terminal assignment	79
5.2.10	3SK1120 Advanced basic unit instantaneous (with solid-state outputs).....	81
5.2.10.1	Device features	81
5.2.10.2	Design	82
5.2.10.3	Terminal assignment	83
5.3	3SK1 output expansions.....	84
5.3.1	Applications.....	84
5.3.2	Function description	85
5.3.3	Display of the operating state	85
5.3.4	Function setting.....	85
5.3.5	Output expansion 3SK1211.....	86
5.3.5.1	Device features	86
5.3.5.2	Design of 3SK1211-.B..0	87
5.3.5.3	Design of 3SK1211-.BB40.....	88
5.3.5.4	Terminal assignment	89
5.3.6	Output expansion 3SK1213.....	90
5.3.6.1	Device features	90
5.3.6.2	Design of 3SK1213-.AB40.....	91
5.3.6.3	Design of 3SK1213-.A.20	92
5.3.6.4	Terminal assignment	92
5.3.7	3RM1 Failsafe motor starters.....	93
5.4	3SK1 input expansions.....	94
5.4.1	Input expansion 3SK1220.....	94
5.4.1.1	Device features	94
5.4.1.2	Applications.....	94
5.4.1.3	Design	95
5.4.1.4	Terminal assignment	95
5.4.1.5	Display of the operating state	96
5.4.1.6	Function setting.....	96
5.4.2	Power supply 3SK1230	98
5.4.2.1	Device features	98
5.4.2.2	Applications.....	98
5.4.2.3	Design	99
5.4.2.4	Terminal assignment	100
5.4.2.5	Display of the operating state	100
6	System configuration	101
6.1	General information.....	101
6.1.1	General notes on the Standard system.....	101
6.1.2	General information on the Advanced system.....	101
6.1.3	Maximum system configuration	102
6.2	3ZY12 device connector.....	106
6.2.1	Device features	106
6.2.2	Applications.....	108
6.3	System configuration rules	109

7	Circuit diagrams.....	113
7.1	Internal circuit diagrams	113
7.1.1	Internal circuit diagrams for 3SK1 Standard basic units	113
7.1.2	Internal circuit diagrams for 3SK1 Advanced basic units	115
7.1.3	Internal circuit diagrams for expansion units	118
7.2	Typical circuits	122
7.2.1	Typical circuits	122
7.3	Typical circuits of 3SK1 safety relays with 3RM1 Failsafe motor starters.....	134
7.3.1	3SK1 safety relay with 3RM1 Failsafe motor starter via device connector	134
7.3.2	3SK1 safety relay wired with 3RM1 Failsafe motor starter.....	136
8	Mounting.....	139
8.1	Warning notices	139
8.2	Terminal coding.....	140
8.3	Mounting the devices on a level surface	141
8.4	Disassembling devices from a level surface.....	143
8.5	Mounting 22.5 mm/17.5 mm devices on a standard mounting rail	145
8.6	Mounting the 90 mm devices on a standard mounting rail.....	146
8.7	Removing devices from a standard mounting rail.....	147
8.8	Mounting 22.5 mm/17.5 mm devices with device connectors on a standard mounting rail	148
8.9	Removing 22.5 mm/17.5 mm devices with device connectors from a standard mounting rail.....	151
8.10	Mounting 90 mm devices with device connectors on a standard mounting rail.....	154
8.11	Removing 90 mm devices with device connectors from a standard mounting rail	158
8.12	Mounting 22.5 mm/17.5 mm devices with device connectors on the wall.....	161
8.13	Removing 22.5 mm/17.5 mm devices with device connectors from the wall	164
8.14	Mounting 90 mm devices with device connectors on the wall	167
8.15	Removing 90 mm devices with device connectors from wall	170
8.16	Mounting the sealable cover.....	172
9	Connection.....	173
9.1	22.5 mm/17.5 mm devices	173
9.1.1	Terminal assignment.....	173
9.1.2	Connection data for terminals.....	175
9.1.3	Connecting the screw-type terminals	176
9.1.4	Disconnecting the screw-type terminals.....	177
9.1.5	Wiring rules for spring-loaded terminals (with push-in technology)	178
9.1.6	Connecting the push-in terminals	179
9.1.7	Disconnecting the push-in terminals	181
9.1.8	Attaching the terminals.....	182
9.1.9	Disconnecting	183
9.2	Devices 90 mm	185
9.2.1	Opening the terminal cover.....	185

9.2.2	Connection data for terminals	186
9.2.3	Connecting terminals	186
9.2.4	Mounting terminals	188
9.2.5	Disconnecting	189
9.3	Device replacement.....	191
10	Configuration / operation	193
10.1	Procedure for configuration	193
10.2	Explanation of the device's functions	194
10.3	Modes	197
10.4	Response times	198
11	Commissioning	201
12	Display and diagnostics.....	203
12.1	LED display.....	203
12.2	Power-up	205
12.3	Error statuses.....	205
12.4	Diagnostics	206
13	Technical data	209
13.1	General technical data.....	209
13.2	Basic units.....	213
13.2.1	Standard	213
13.2.1.1	Technical data for 3SK1111 Standard relay basic unit	213
13.2.1.2	Technical data for 3SK1112 Standard solid-state basic unit	218
13.2.2	Advanced.....	222
13.2.2.1	Technical data for 3SK1120 Advanced solid-state basic unit.....	222
13.2.2.2	Technical data for 3SK1121 Advanced relay instantaneous basic unit	227
13.2.2.3	Technical data for 3SK1121 Advanced relay time-delayed basic unit.....	231
13.2.2.4	Technical data for 3SK1122 Advanced solid-state instantaneous basic unit	237
13.2.2.5	Technical data for 3SK1122 Advanced solid-state time-delayed basic unit.....	241
13.3	Expansion modules	247
13.3.1	Output expansions	247
13.3.1.1	Technical data for output expansion 3SK1211	247
13.3.1.2	Technical data for output expansion 3SK1213	252
13.3.2	Input expansions	257
13.3.2.1	Technical data for input expansion 3SK1220	257
13.3.2.2	Technical data for power supply unit 3SK1230	261
14	Dimension drawings	263
14.1	Dimension drawings for 3SK1 devices.....	263
14.2	Dimension drawings for 3SK1 device connector	272
15	Accessories	279
A	Appendix.....	281
A.1	Correction sheet.....	281

Introduction

1.1 User responsibility for system design and function

The products described here were developed to perform safety-related functions as part of an overall installation or machine.

A complete, safety-related system is generally equipped with sensors, evaluation units, and signaling units, and uses reliable shutdown concepts.

It is the responsibility of the manufacturer of a system or machine to ensure that the product functions properly.

Siemens AG, its regional offices, and associated companies (hereinafter referred to as "Siemens") cannot guarantee all the properties of an entire plant, system or machine that has not been designed by Siemens.

Nor can Siemens assume liability for recommendations that appear or are implied in the following description. No new guarantee, warranty, or liability claims beyond the scope of the Siemens general terms of supply are to be derived or inferred from the following description.

1.2 Required basic knowledge

A general knowledge of the following areas is needed in order to understand this manual:

- Low-voltage switchgear
- Digital circuit logic
- Automation systems
- Safety systems

1.3 Validity range

The manual is valid for these safety relays SIRIUS 3SK1. It describes the components that are valid at the time of publication.

SIEMENS reserves the right of including a Product Information for each new component, and for each component of a later version.

1.4 Definitions

"3SK1" always applies to all variants of the SIRIUS 3SK1 safety relays.

1.5 Service&Support

Online Support

The Online Support in the Service&Support portal is an extensive information system for all questions relating to Siemens products and solutions. This service enables direct and central access to in-depth information concerning the products, systems and applications for industry and to a large number of programming, configuration and application examples. Its content is available via a mobile app.

The Technical Forum of the Online Support provides the opportunity for users to swap information. Support Request allows contact to be established with Siemens experts in Technical Support.

Siemens Industry Online Support ensures that users in industry are always kept up-to-date with news, software updates and announcements by means of newsletters and Twitter.

Links: Service&Support Portal (<http://support.automation.siemens.com>), Online Support (<http://support.automation.siemens.com/WW/view/en/16605022>)

Product Support

Are you looking for product information such as technical data, updates or FAQs? Here, the "Product Support" section of the Service & Support Portal offers an extensive collection of all information about the Siemens Industry Automation and Drive Technologies products and solutions:

- Answers to frequently asked questions (FAQs)
- Updates/upgrades, service packs and support tools for downloading
- Manuals and operating instructions
- Technical data/CAx data
- Approvals and certificates
- Test certificates and characteristic curves

All Product Support information is at your disposal free of charge and around the clock, and you always get the current version.

Link: Product Support (<http://support.automation.siemens.com/WW/view/en/4000024>)

CAx data

The CAx Download Manager provides you with a simple means of gaining access to up-to-date product data for your CAx or CAe system.

You configure your own download package with just a few clicks. You can choose from the following information for products

- Product images
- 2D dimensional drawings
- 3D models
- Internal circuit diagrams
- EPLAN macro files
- Manuals
- Characteristics
- Operating instructions
- Certificates
- Product master data

Link: CAx Download Manager

(<http://support.automation.siemens.com/WW/view/en/42455541>)

Applications & Tools

Applications & Tools supports you with various tools and examples when it comes to solving your automation tasks. Solutions are presented in interaction with several components in the system, without focusing on individual products.

- Application examples
- Function blocks & tools
- Background and system descriptions
- Performance statements
- Demonstration systems/videos

Link: Applications & Tools (<http://support.automation.siemens.com/WW/view/en/20208582>)

My Documentation Manager

My Documentation Manager enables you to compile your own documentation from our standard documents (manuals), which are located in the Product Support section. Under mySupport, you have the opportunity to create and manage your own compilations in a structure of their own.

Link:

MyDocumentationManager (<http://support.automation.siemens.com/WW/view/en/38715968>)

Reference

You can find further information on structure and navigation in Online Support here (<http://support.automation.siemens.com/WW/view/en/11774658>).

1.6 Configurator for 3SK1 safety relays

Configurator

Various configurators are available on the Internet to assist you with configuration.

The configurator for 3SK1 safety relays and matching accessories is an easy-to-use selection and configuration tool. You can select the individual components and plan your system in accordance with your specific requirements. You can save your selection, export it as a text file or you can order it directly.

The configurator automatically compiles a document list of the information available in Service&Support for every component. You can use it as the basis for putting together your system documentation.

Link:

- Configurator (<http://www.siemens.com/industrial-controls/configurators>)

1.7 DataMatrix code

A DataMatrix code is lasered onto the lower terminal cover of all 3SK1-series safety relays.

DataMatrix codes are standardized in ISO/IEC 16022. The DataMatrix codes on Siemens devices use ECC200 coding for powerful error correction.

The following device information is encoded in the DataMatrix codes as a bit stream:

- Article number (MLFB)
- Serial number
- MAC address, if applicable

This information is stored in the following format in the DataMatrix code:

1P	Article number + (MLFB)	S serial number (+ 23S MAC address)
Data identifier	Net content	Separator

Note

The information content is displayed without spaces.

This machine-readable information simplifies and accelerates handling of the respective devices.

As well as fast access to the serial numbers of the respective devices for unique identification, the DataMatrix codes simplify communication with Siemens Technical Support.

SIEMENS Industry Support App

The Data Matrix codes enable in particular extremely fast and convenient access to all the device-specific information available on an article number (MLFB) in the SIEMENS Service&Support Portal, such as operating instructions, manuals, data sheets, FAQs, etc. We offer the SIEMENS Industry Support App free for this purpose. This can be used on commercially available smartphones and tablet PCs.

The SIEMENS Industry Support App is available for iOS and Android-based terminal devices and can be accessed via the following links:



Link for Android



Link for iOS

1.8 Correction sheet

The appendix to this manual contains a correction sheet for evaluation and feedback. Please use it to record your suggestions for improvements, additions and corrections, and return the sheet to us. This will help us to improve the next edition of the manual.

Thank you.

1.9 History

Product version	New features
02/2013	Initial release
02/2014	Integration of 3RM1 Failsafe motor starters

Product-specific safety information

2.1 General safety notes

Note**Recycling and disposal**

Dispose of existing packing material in accordance with applicable regulations or recycle it.

3SK1 safety relays are able to be recycled thanks to a low-pollutant manufacturing process. For environmentally-friendly recycling and disposal of your electronic waste, please contact a company certified for the disposal of electronic waste.

Note**SILCL 3 to IEC 62061:2005/PL e/Cat. 4 to EN ISO 138491:2008**

3SK1 safety relays are designed in such a way as to allow implementation of applications up to SILCL 3 in accordance with IEC 62061 and PL e/Kat. 4 in accordance with EN ISO 13849-1.

Note**Safe state**

The basis of the safety function is the definition of the safe state. In the case of safety relays, this is the "OFF state", i.e. an open contact for sensors or shutdown of the actuators.

 WARNING**Protection against electrically conductive contamination!**

The devices must be protected against conductive contamination while taking account of the ambient conditions. One way you can do this is to install the devices in a control cabinet with the appropriate degree of protection.

You will find more detailed information in IEC 60529, for example.

 **WARNING**

Safe functional extra-low voltage

The 3SK1 safety relays with a supply voltage of 24 V DC must be operated with safe functional extra-low voltage (SELV, PELV). This means these modules must only be subjected to a voltage of U_m even in the event of a fault. The following applies for these 3SK1 safety relays: **$U_m < 60.0 \text{ V}$** .

You can find more detailed information about safe functional extra low voltage in the data sheets of the power supplies to be used.

 **CAUTION**

Protection against electrostatic charge

When handling and installing 3SK1 safety relays, ensure that the components are protected from being electrostatically charged. Changes to the system configuration and wiring are only permissible while the supply voltage is switched off.

Connection of 3SK1 safety relays is only permissible when the power supply units (PELV and SELV) are switched off.

 **CAUTION**

Noise immunity / grounding

The following must be grounded in accordance with the regulations to ensure noise immunity of the 3SK1 safety relays:

- PELV / SELV power supply units (please also note the documentation for the respective power supply unit in this regard).

Note

Cover the 3ZY12 device connector on the left-hand side using the cover supplied with the device termination connector.

⚠ WARNING

3SK1..1 and 3SK1..3 safety relays (devices with outputs using contacts):
In continuous operation, the key safety values apply where the function test interval (state change of the outputs) \leq 1 year.

3SK1..2 and 3SK1120 safety relays (devices with solid-state outputs up to product version E01/V1.0.0):

In continuous operation, the key safety values apply where the function test interval (state change of the outputs) \leq 1 year.

3SK1..2 and 3SK1120 safety relays (devices with solid-state outputs from product version E02/V1.1.0):

In continuous operation, the key safety values apply where the function test interval (state change of the outputs) \leq 20 years.

Function test procedure:

- Actuate the connected sensors.
- Check their effect on the safety relay and the downstream actuators.
- Activate the safety relay via the connected sensors.
- Check their effect on the safety relay and the downstream actuators.
- Defective devices must be replaced.

Note

3SK1..2 and 3SK1120 safety relays (devices with solid-state outputs) as from E02/V1.1.0 run power-on tests, so-called light tests, at regular intervals in the "OFF state".


⚠ WARNING

As a result of light tests at the solid-state outputs, the level switches to the ON state for up to 2.5 ms. Users are responsible for ensuring that this does not result in any actuator changing to the active state.

Note**3ZY12 device connectors**


Only safety relays with a supply voltage of **24 V DC** may be used on the 3ZY12 device connector.

2.2 Intended use

 WARNING
Hazardous Voltage. Can Cause Death, Serious Injury, or Property Damage. Proper use of hardware products
This equipment is only allowed to be used for the applications described in the catalog and in the technical description, and only in conjunction with non-Siemens equipment and components recommended by Siemens.
Correct transport, storage, installation and assembly, as well as careful operation and maintenance, are required to ensure that the product operates safely and without faults.
EU note: Commissioning is absolutely prohibited until it has been ensured that the machine in which the component described here is to be installed complies with the stipulations of the Directive 2006/42/EC.

2.3 Current information about operational safety

Important note for maintaining operational safety of your system

 WARNING
Hazardous Voltage Can Cause Death, Serious Injury, or Property Damage. Please take note of our latest information
Systems with safety-related characteristics are subject to special operational safety requirements on the part of the operator. The supplier is also obliged to comply with special product monitoring measures. For this reason, we publish a special newsletter containing information on product developments and features that are (or could be) relevant to operation of safety-related systems. By subscribing to the appropriate newsletter, you will ensure that you are always up-to-date and able to make changes to your system, when necessary:
SIEMENS newsletter (http://www.industry.siemens.com/newsletter)
Sign on to the following newsletter under "Products & Solutions":
<ul style="list-style-type: none">• Control Components and System Engineering News• Safety Integrated Newsletter

2.4 Declaration of conformity

The manufacturer declares that the safety components of the SIRIUS 3SK1 series in the designs marketed by us comply with the applicable basic safety and health requirements of the EC Directives* stated (including amendments) and that the stated standards* were applied in their design and construction.

* You can download the complete EC Declaration of Conformity as a PDF.

Product overview for 3SK1

3.1 Overview

Overview of 3SK1 safety relays

The following tables provide an overview of the 3SK1 safety relays.

3SK1 basic units Standard

Designation	Voltages	Article number (MLFB)
3SK1 basic unit Standard instantaneous (with relay outputs)	24 V AC/DC	3SK1111-xAB30
	110 ... 240 V AC/DC	3SK1111-xAW20
3SK1 basic unit Standard instantaneous (with solid-state outputs)	24 V DC	3SK1112-xBB40

x = 1: screw terminals; x = 2: push-in terminals

3SK1 Advanced basic units

Designation	Voltages	Article number (MLFB)
3SK1 Advanced basic unit instantaneous (with relay outputs)	24 V DC	3SK1121-xAB40
3SK1 Advanced basic unit time-delayed (with relay outputs)	24 V DC	3SK1121-xCB4y
3SK1 Advanced basic unit instantaneous (with solid-state outputs)	24 V DC	3SK1122-xAB40
3SK1 Advanced basic unit time-delayed (with solid-state outputs)	24 V DC	3SK1122-xCB4y
3SK1 Advanced basic unit 17.5 mm instantaneous (with solid-state output)	24 V DC	3SK1120-xAB40

x = 1: screw terminals; x = 2: push-in terminals

y = 1: 0,05 ... 3 s; y = 2: 0,5 ... 30 s; y = 4: 5 ... 300 s

3.1 Overview

Expansion units

Designation	Voltages	Article number (MLFB)
3SK1211 output expansion	24 V AC	3SK1211-xBB00
	24 V DC	3SK1211-xBB40
	110 ... 240 V AC/DC	3SK1211-xBW20
3SK1213 output expansion	24 V DC	3SK1213-xAB40
	115 V AC	3SK1213-xAJ20
	240 V AC	3SK1213-xAL20
3SK1220 input expansion	24 V DC	3SK1220-xAB40
3SK1230 power supply	110 ... 240 V AC/DC	3SK1230-xAW20
3RM1 Failsafe direct-on-line starters	24 V DC	3RM11..-xAA4
3RM1 Failsafe reversing starters	24 V DC	3RM13..-xAA4

x = 1: screw terminals; x = 2: push-in terminals;

x = 3 (3RM1 only) hybrid connection method: Control circuit realized as push-in spring-loaded terminal and main circuit as screw terminal

Overview of the enabling circuits


Type and number of enabling circuits						
Advanced	Relay		Solid-state		Signaling circuits	Device connectors
	Instantaneous	Delayed	Instantaneous	Delayed		
3SK1121-xAB40	3	-	-	-	1	✓
3SK1121-xCB4x	2	2	-	-	-	✓
3SK1122-xAB40	-	-	3	-	1	✓
3SK1122-xCB4x	-	-	2	2	-	✓
3SK1120-xAB40	-	-	1	-	-	✓
Standard						
3SK1111-xAxx0	3	-	-	-	1	-
3SK1112-xBB40	-	-	2	-	1	-
Output expansions						
4RO						
3SK1211	4		-	-	1	✓ (for 24 V DC)
3RO						
3SK1213	3	-	-	-	1	✓ (for 24 V DC)

Online configurator

To assist you with configuration, the "SIRIUS 3SK1 safety relay configurator" is at your disposal on the Internet (www.siemens.com/industrial-controls/configurators). You can select and order the correct safety relays here and generate the complete product documentation:

- Product data sheet
- Dimension drawings
- CAD data in 2-D and 3-D model images
- Ordering data
- Product photo

3.2 Overview of components and accessory parts

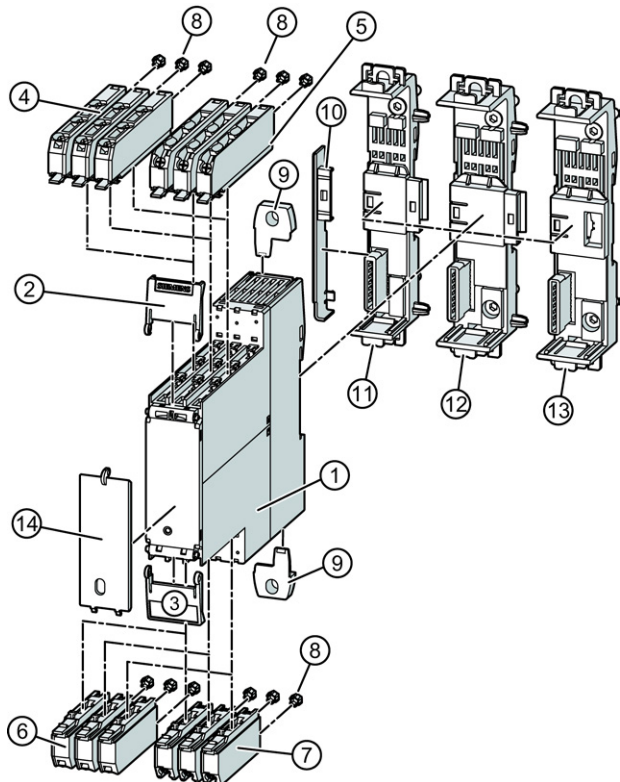

- ① 3SK1 safety relay (basic unit/expansion unit)
- ② Top cover flap
- ③ Bottom cover flap
- ④ Terminals, 3-pole, push-in, 1 x 2.5 mm²
- ⑤ Terminals, 3-pole, screw-type, 1 x 2.5 mm²
- ⑥ Terminals, 2-pole, push-in, 1 x 2.5 mm²
- ⑦ Terminals, 2-pole, screw-type, 1 x 2.5 mm²
- ⑧ Coding pins
- ⑨ Push-in lugs for wall mounting
- ⑩ Cover
- ⑪ Device connector for 3SK1 safety relay, 17.5 mm wide
- ⑫ Device connector for 3SK1 safety relay, 22.5 mm wide
- ⑬ Device termination connector for 3SK1 safety relay, 22.5 mm wide
- ⑭ Sealable cover

3.3 Functional scope of the 3SK1 basic units

Function	3SK1 Standard		3SK1 Advanced	
	Type of enabling circuits			
	Relay	Solid-state	Relay	Solid-state
Sensors				
Mechanical sensors	✓	✓	✓	✓
Non-floating sensors	✓	✓	✓	✓
Antivalent sensors	Not possible	Not possible	✓	✓
Sensor number can be increased	Not possible	Cascading only	✓	✓
Parameter				
Type of start (autostart/monitored start)	✓	✓	✓	✓
Sensor connection 2x single-channel / 1x two-channel	Using wiring	✓	✓	✓
Cross-circuit detection OFF / ON	Using wiring	✓	✓	✓
Start-up test OFF / ON	No start-up test	✓	✓	✓
Monitoring of two-hand control units	Not possible	Not possible	✓	✓
Enabling circuits				
Instantaneous	✓	✓	✓	✓
Delayed	None	None	✓	✓
Expandable with relay enabling circuits	Using wiring	Using wiring	✓	✓
Device connector	Cannot be used	Cannot be used	✓	✓
Rated control supply voltage				
24 V DC	✓	✓	✓	✓
110 ... 240 V AC/DC	✓	Not possible	✓ ¹⁾	✓ ¹⁾

¹⁾ Possible using 3SK1230 power supply and device connector

3.4 Introduction

SIRIUS 3SK1 safety relays are used mainly in autonomous safety applications that are not connected to a safety-related bus system. Here they are used to evaluate sensors and ensure safety-related shutdown when required. They also check and monitor the sensors, actuators, and the safety-related functions of the safety relay.

Applications

Depending on the version of the device and the external connection of sensors and actuators, applications up to SILCL 3 in accordance with IEC 62061, SIL 3 in accordance with IEC 61508 and PL e (Cat. 4) in accordance with ISO 13849-1 can be implemented.

- Monitoring the switch position of the sensors
- Monitoring of the sensor lines
- Monitoring of correct functioning of the safety relay
- Monitoring of the actuators
- Safety-related shutdown in case of hazards

3.5 3SK1 system

3.5.1 Standard

3.5.1.1 Typical system configuration


System configuration for 3SK1 Standard

A 3SK1 Standard system can comprise the following devices:

- Basic units (one basic unit per system)
 - Basic unit 3SK1111 Standard relay instantaneous (see also 3SK1111 Standard basic unit instantaneous (with relay outputs) (Page 48))
 - Basic unit 3SK1112 Standard solid-state instantaneous (see also 3SK1112 Standard basic unit instantaneous (with solid-state outputs) (Page 55))
- Output expansions
 - Output expansion 3SK1211 (see also Output expansion 3SK1211 (Page 86))
 - Output expansion 3SK1213 (see also Output expansion 3SK1213 (Page 90))

The devices are connected using wiring.

Typical 3SK1 Standard system configuration

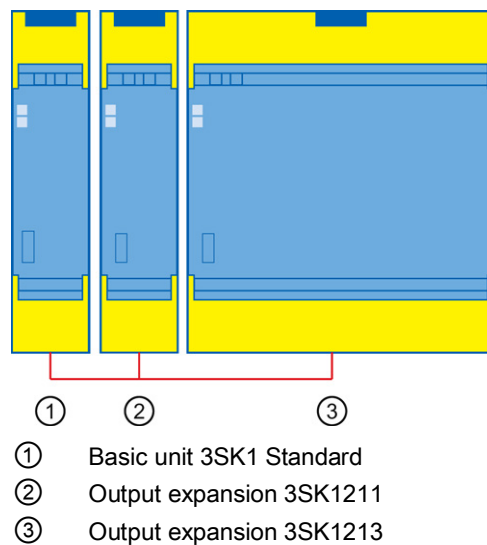

3.5.2 Advanced

3.5.2.1 Typical system configuration

System configuration for 3SK1 Advanced

A 3SK1 Advanced system can comprise the following devices:


- Basic units (one basic unit per system)
 - 3SK1121 Advanced basic unit relay instantaneous (see also 3SK1121 Advanced basic unit instantaneous (with relay outputs) (Page 66))
 - 3SK1121 Advanced basic unit relay time-delayed (see also 3SK1121 Advanced basic unit time-delayed (with relay outputs) (Page 69))
 - 3SK1122 Advanced basic unit solid-state instantaneous (see also 3SK1122 Advanced basic unit instantaneous (with solid-state outputs) (Page 73))
 - 3SK1122 Advanced basic unit solid-state time-delayed (see also 3SK1122 Advanced basic unit time-delayed (with solid-state outputs) (Page 77))
 - 3SK1120 Advanced basic unit 17.5 mm solid-state instantaneous (see also 3SK1120 Advanced basic unit instantaneous (with solid-state outputs) (Page 81))
- Input expansions
 - 3SK1230 power supply (see also Power supply 3SK1230 (Page 98))
 - 3SK1220 input expansion (see also Input expansion 3SK1220 (Page 94))
- Output expansions
 - 3SK1211 output expansion (see also Output expansion 3SK1211 (Page 86))
 - 3SK1213 output expansion (see also Output expansion 3SK1213 (Page 90))
 - 3RM1 Failsafe motor starter output expansion (you will find additional information in the manual SIRIUS 3RM1 motor starters (<http://support.automation.siemens.com/WW/view/en/66295730>))
- 3ZY12 device connector (optional) (see also 3ZY12 device connector (Page 106))

The devices are connected by means of 3ZY12 device connectors or wiring.

When a 3ZY12 device connector is used, there is no wiring whatsoever between the basic unit and the expansion unit(s). In this case, all necessary signals are exchanged via the device connector.


You will find the rules for configurations with device connectors in the section entitled "System configuration rules (Page 109)".

Typical 3SK1 Advanced system configuration

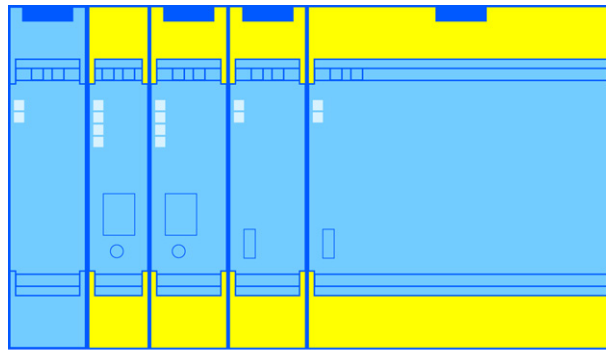


- ① 3SK1230 power supply
- ② 3SK1220 input expansion
- ③ 3SK1 basic unit Advanced
- ④ 3SK1211 output expansion
- ⑤ 3SK1213 output expansion

Typical 3SK1 Advanced system configuration with 3RM1 Failsafe motor starter

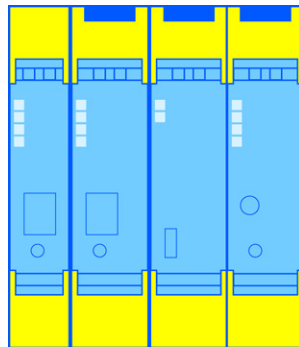

- ① 3SK1220 input expansion
- ② 3SK1 basic unit Advanced
- ③ 3SK1211 output expansion
- ④ 3RM1 Failsafe motor starter output expansion

3.5 3SK1 system

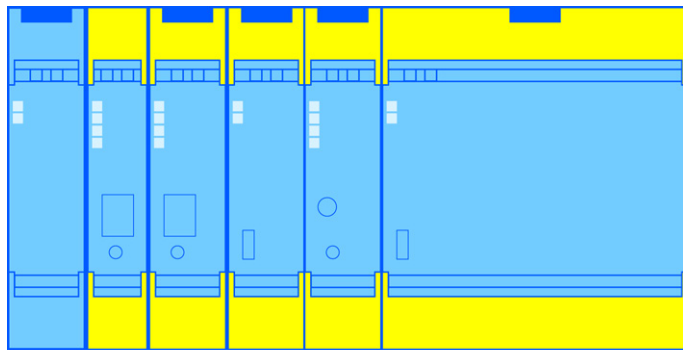

- ① 3SK1230 power supply
- ② 3SK1220 input expansion
- ③ 3SK1 basic unit Advanced
- ④ 3SK1211 output expansion
- ⑤ 3RM1 Failsafe motor starter output expansion
- ⑥ 3SK1213 output expansion

Safety systems - General information

4.1 What is safety?

Safety defines a state in which the risk of damage is reduced to a tolerable level, or which can be regarded as risk-free. Following on from this definition, functional safety concerns persons, machines and the environment.

The objective of safety systems is to reduce the risk for humans and machines that is posed by a use case to an acceptable level. The first step is, therefore, to identify the risk of a use case. In order to make a reliable assessment regarding the application, each individual function of a machine or plant must be analyzed for potential hazards.

For further information, refer to the brochure "Safety of machines and plants" which is available here as a download: Functional safety (<http://www.siemens.com/safety>).

4.2 Safety function

A safety function describes the reaction of a machine/plant to the occurrence of a specific event (e.g. opening of a protective door). Execution of the safety function(s) is carried out by a safety-related control system. This usually comprises three subsystems, **detecting**, **evaluating** and reacting.

Detecting (sensors):

- Detection of a safety requirement, e.g.: EMERGENCY STOP or a sensor for monitoring a hazardous area (light array, laser scanner, etc.) is operated.


Evaluating (safety relay):

- Detection of a safety requirement and the safe initiation of the reaction (e.g. switching off the enabling circuits).
- Monitoring the correct operation of sensors and actuators
- Initiating a reaction upon detection of faults

For the 3SK1 products described in this manual, this concerns evaluation units for safety functions.

Reacting (actuators):

- Switching off the hazard by means of downstream actuators.

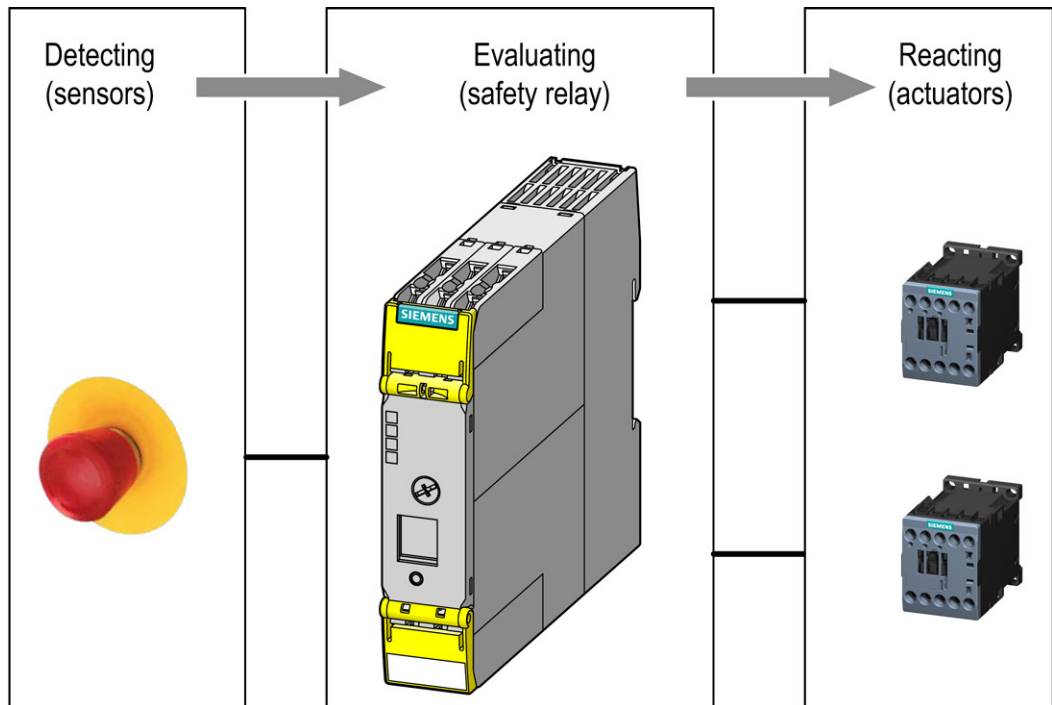

4.3 Basic terminology

4.3.1 Redundancy/single-channel and two-channel

Redundancy

With redundancy, more than one component is implemented for the same function, so a faulty function of a component is performed instead by the other component(s).

A redundant configuration reduces the probability of a function failing due to a single defective component. This requirement is essential for achieving SILCL 3 in accordance with IEC 62061, SIL 3 in accordance with IEC 61508 and PL e (Cat. 4) in accordance with ISO 13849-1 (also necessary for SIL 2 / PL d under certain circumstances).

The simplest form of redundancy is **two-channel redundancy**.

If a circuit fails, two-channel redundancy or appropriate wiring ensures that the safety function is maintained.

In a redundant system configuration, the subsystems for detecting and reacting must also be implemented with two-channel redundancy.

Note

All SIRIUS Safety devices that comply with SILCL 3 in accordance with IEC 62061, SIL 3 in accordance with IEC 61508 and PL e (Cat. 4) in accordance with DIN EN ISO 13849-1 are redundantly configured with regard to the internal logic as well as with regard to the output circuits.

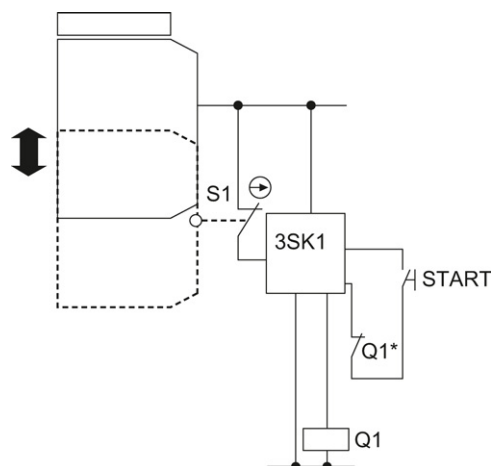


Figure 4-1 Single-channel sensor connection

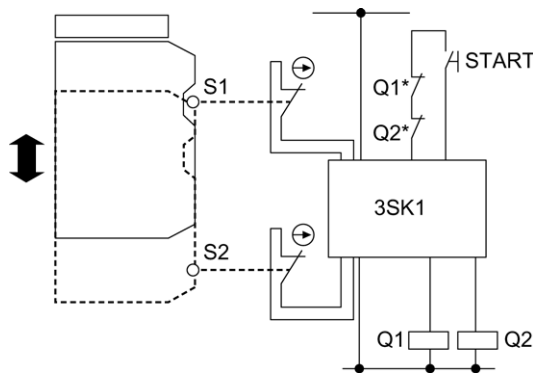


Figure 4-2 Two-channel sensor connection

* = positively-driven auxiliary contacts/mirror contacts

4.3.2 Cross-circuit detection

Cross-circuit detection is a diagnostic function of a safety relay that detects short-circuits and cross-circuits between the input channels (sensor circuits) during two-channel sensing or reading. A cross-circuit can be caused, for example, by a cable casing being squashed. In devices without cross-circuit detection, this can mean that a two-channel EMERGENCY STOP circuit does not trip even though only one NC contact is faulty (secondary error).

With 3SK1 devices, a cross-circuit is detected in the sensor circuits by means of signals with different clock pulses. If the clocked signals overlap, the device detects a cross-circuit. With 3SK1 basic units, cross-circuit detection can be deactivated to allow electronic sensors to be evaluated (that monitor themselves as well as the cable to the evaluation unit).

4.3.3 Enabling circuit

An enabling circuit provides a safety-related output signal. From an external viewpoint, enabling circuits usually act as NO contacts (however, in terms of functionality, safety-oriented opening is always the most important aspect).

An individual enabling circuit that is redundantly configured internally in the safety relay can be used for SIL 3 / PL e.

Note: Enabling current paths can also be used for signaling purposes.

3SK1 safety relays are only equipped with enabling circuits with NO functionality. This means that when the safety function is triggered, or a fault is detected, the enabling circuits will always transfer to the safe state (NO contact open).

4.3.4 Signaling circuit

A current signaling path provides a safety-related output signal. Signaling circuits can be implemented with either NC or NO contact functionality.

With 3SK1 relays, the signaling circuits are always implemented as NC circuits. This means that when the safety function is triggered, or a fault is detected, the signaling circuits will always close.

4.3.5 Feedback circuit

A feedback circuit is used to monitor controlled actuators (e.g. relays or load contactors) with positively driven contacts or mirror contacts. The enabling circuits can only be activated with the feedback circuit closed.

Note

When 3SK1 expansion units are used on 3ZY12 device connectors with 3SK1 Advanced basic units, it is not necessary to incorporate the expansion modules in the feedback circuit wiring. This is implemented internally via the device connector.

4.3.6 Stop categories

Stop category 0

Non-controlled shutdown by immediately switching off the power to the machine's drive elements.

Stop category 1

Controlled stopping where the energy feed is interrupted with a time delay, or is only interrupted once standstill has been reached.

Note

The time-delayed shutdown of enabling circuits in accordance with Stop category 1 is not guaranteed under all operating states.

In the case of some internal device faults, and when disconnecting the supply voltage, these enabling circuits are switched off **instantaneously**.

4.3.7 Automatic start

For an automatic start, the device is started without manual confirmation, but only after the input image has been checked and a positive test of the safety relay has been conducted. This function is also known as dynamic operation and is not permissible for EMERGENCY STOP devices. Safety devices for prohibited danger zones (e.g. position switches, light arrays, safety shutdown mats) can use the automatic start function if this does not pose any risk.

Note

An automatic start is not permitted for EMERGENCY STOP devices.

4.3.8 Manual start

For a manual start, the device is started by operating the START button, but only after the input image has been checked and a positive test of the safety relay has been conducted. On a manual start, the START button is not monitored for correct operation, a positive edge of the START button is sufficient for starting.

Note

The "Manual start" function is only available with the 3SK1111 safety relays (slide switch at Autostart position).

Note

Manual start is not permitted for EMERGENCY STOP devices.

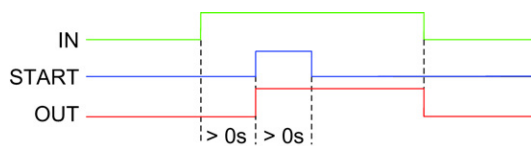


Figure 4-3 Start function "Manual start"

4.3.9 Monitored start

For a monitored start, the device is started by operating the START button, but only after the input image has been checked and a positive test of the safety relay has been conducted.

Contrary to the manual start, the monitored start evaluates a **signal change** of the START button. This means that the START button cannot be bypassed (misuse). For PL e (ISO 13849-1) as well as SIL 3 (IEC 62061), the monitored start must be used in the case of EMERGENCY STOP. For other safety sensors/functions, the necessity for a monitored start command depends on the risk assessment.

If the START button is operated for more than 2 seconds, the 3SK1 basic unit detects a wiring short-circuit in the START button and switches to the fault state (Device = green; SF = flashing red; Out = flashing yellow; IN = off)

Note

In the delivery state of the 3SK1 safety relays, the start type is set to "Monitored start".

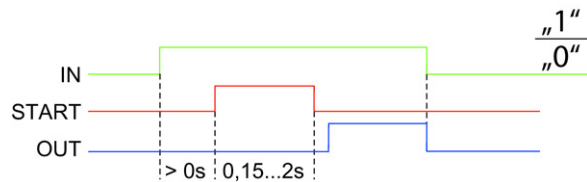


Figure 4-4 Start function "Monitored start"

4.3.10 Two-hand operation/synchronism

Synchronous sensor operation is a special form of simultaneity of sensors.

In this case, it is not sufficient for sensor contacts 1 and 2 to be switched to the closed state at different times, they must be closed within 0.5 seconds.

Synchronism of sensors is required, in particular, in the case of two-hand operation of presses. This ensures that the presses only become active when the sensors are operated simultaneously with both hands. This minimizes the risk of the operator getting a hand in the press.

When 3SK1 safety relays are used, you can achieve applications up to type IIIc in compliance with EN574 (applications up to PL e/Cat. 4 in compliance with EN 13849-1 or SILCL 3 in compliance with IEC 62061).

Note

In the delivery state of 3SK1 safety relays, monitoring of time synchronism is deactivated. Time synchronism can be activated using the following adjustable parameter for 3SK112 Advanced and 3SK122 Advanced:

- Jumper T1/PAR (NO/NC evaluation)
 - DIP switches (1) Autostart
 - DIP switches (3) 2 x single-channel
-

Note

The 3SK1 Advanced safety relays exclusively support two-hand control units with two NO contacts.

Note

The two-hand circuit must be marked in compliance with EN 574. You can find information on determining the response time in the section entitled Response times (Page 198).

4.3.11 Cascading

Cascading of safety relays is used for tripping safety relays in series.

Several safety functions can then be logically connected to a shared shutdown path. Several enabling circuits can be created for selective shutdown of drive elements.

The connection between the individual modules must be arranged on one side only, because cascading from the last relay to the first one would create a loop which would prevent starting.

Cascading is implemented within a control cabinet in a single-channel configuration; this is even permissible with SIL 3 / PL e, because cable routing within a control cabinet is protected against short-circuits and short-circuiting to P potential (fault exclusion in accordance with ISO 13849-2).

The 3SK1 Advanced device series offers an extremely convenient solution for cascading. Input expansions can be easily connected to the evaluation unit by means of device connectors.

4.3.12 Startup testing

The sensor or protection equipment must be opened and closed again after the supply voltage is restored before the enables for the 3SK1 safety relay can be switched through.

Startup testing ensures that any errors in the sensors are detected (again), because safety relays lose their ability to store errors at zero voltage.

Unauthorized manipulation of the protection equipment can also be detected through startup testing.

The plant operator decides whether startup testing should be performed (risk assessment). No general statements apply.

Note

In the delivery state of 3SK1 safety relays, startup testing is deactivated.

4.3.13 Connection of actuators

Note

To achieve the Performance Level / Safety Integrity Level given in the following examples, the actuators shown must be monitored in the feedback circuit of the corresponding safety relay.

Note

For capacitive and inductive loads, we recommend an adequate protective circuit. In this way, electromagnetic interference can be suppressed and contact service life increased.

You can find additional information in SIRIUS Innovations - SIRIUS 3RT2 Contactors/Contactor Assemblies manual (<http://support.automation.siemens.com/WW/view/en/60306557>).

Actuator wiring up to PL c / Cat. 2 in accordance with ISO 13849-1 or SILCL 1 in accordance with IEC 62061

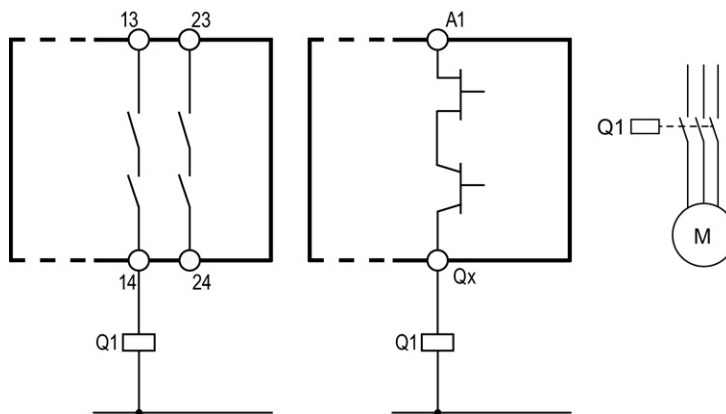


Figure 4-5 PL c / Cat. 2 in accordance with ISO 13849-1 or SILCL 1 in accordance with IEC 62061

Actuator wiring up to PL e / Cat. 4 in accordance with ISO 13849-1 or SILCL 3 in accordance with IEC 62061

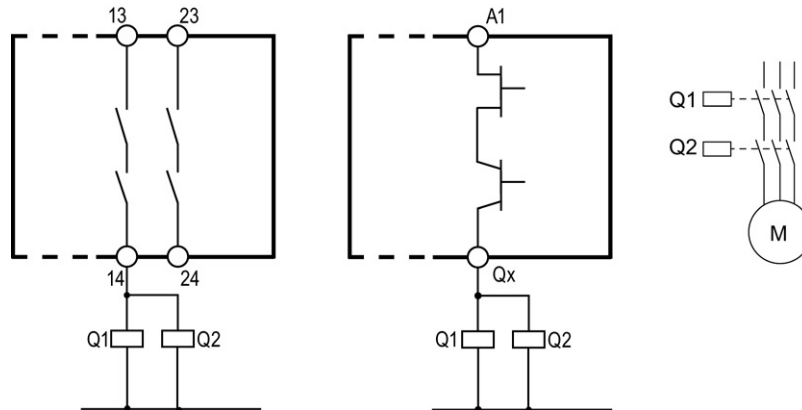


Figure 4-6 PL e/Cat. 4 in accordance with ISO 13849-1 or SILCL 3 in accordance with IEC 62061
With units that have solid-state outputs, this wiring is only possible from E02/V1.1.0.

WARNING

PL e/Cat. 4 in accordance with ISO 13849-1 or SILCL 3 in accordance with IEC 62061 can only be achieved with cross-circuit-proof/short-circuit to P-proof laying of the control cables from the relay output (e.g. 14) to the control relays/contactors (Q1 and Q2) (e.g. as a separately sheathed cable or in its own cable duct).

Note

In the case of 3SK1..2 and 3SK1120 (devices with solid-state outputs with firmware (FW) version V1.0.0 and product version E01) it is not possible to achieve PL d/e/Cat. 3/4 in accordance with ISO 13849-1 or SILCL 2/3 in accordance with IEC 62061 with the wiring shown above.

Actuator wiring up to PL e / Cat. 4 in accordance with ISO 13849-1 or SILCL 3 in accordance with IEC 62061

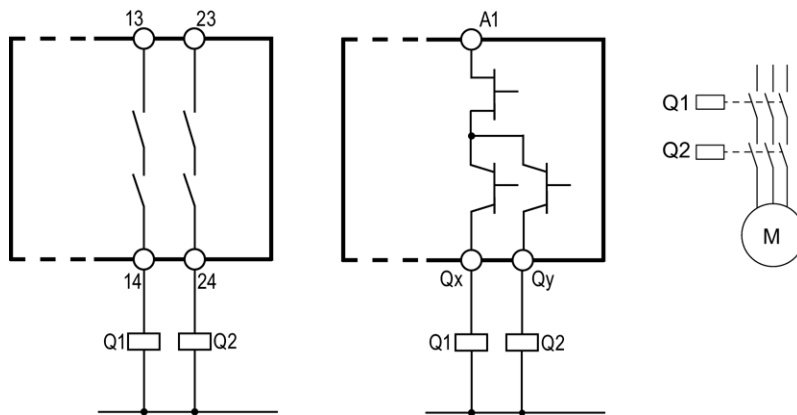


Figure 4-7 PL e / Cat. 4 in accordance with ISO 13849-1 or SILCL 3 in accordance with IEC 62061

Refer to the information on the function test interval in section General safety notes (Page 17).

Actuator wiring with 3RM1 up to PL e/Cat. 4 in accordance with ISO 13849-1 or SILCL 3 in accordance with IEC 62061

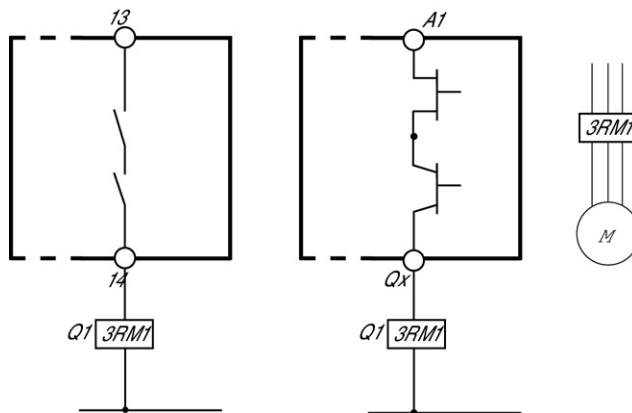


Figure 4-8 PL e / Cat. 4 in accordance with ISO 13849-1 or SILCL 3 in accordance with IEC 62061

Note

PL e/Cat. 4 in accordance with ISO 13849-1 or SILCL 3 in accordance with IEC 62061 can only be achieved with cross-circuit-proof/short-circuit to P-proof laying of the control cables from the relay output (e.g. 14) to the 3RM1 Failsafe motor starter (e.g. as a separately sheathed cable or in its own cable duct). Thanks to the intrinsic safety of the 3RM1 Failsafe motor starter, monitoring by the upstream 3SK1 safety relay (via feedback circuit) is not necessary here.

Note


In the case of 3SK1..2 and 3SK1120 (devices with solid-state outputs with firmware (FW) version V1.0.0 and product version E01) it is not possible to achieve PL d/e/Cat. 3/4 in accordance with ISO 13849-1 or SILCL 2/3 in accordance with IEC 62061 with the wiring shown above.

More detailed technical information is available in the "SIRIUS 3RM1 motor starters (<http://support.automation.siemens.com/WW/view/en/66295730>)" manual on the Internet.

4.3.14 Series connection of sensors

Series connection of EMERGENCY STOP command devices


It is possible to connect EMERGENCY STOP command elements in series up to the highest safety level (SILCL 3 in accordance with IEC 62061, SIL 3 in accordance with IEC 61508 and PL e (Cat. 4) in accordance with ISO 13849-1), because it is assumed that only one EMERGENCY STOP is operated at a time. This ensures that errors and defects can be detected.

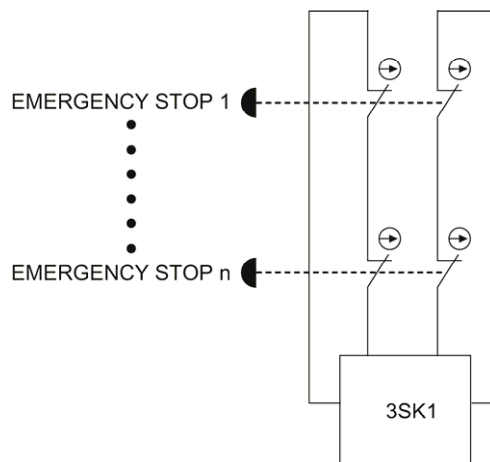

Series connection of mechanical position switches

In general, position switches may be connected in series if measures ensure that several protective doors are not regularly opened simultaneously (otherwise a fault cannot be detected).

For safety level SILCL3 in accordance with IEC 62061, SIL3 in accordance with IEC 61508, and PL e (Cat. 4) in accordance with ISO 13849-1, however, they must **never** be connected in series, because every hazardous error must be detected (independently of the operating personnel).

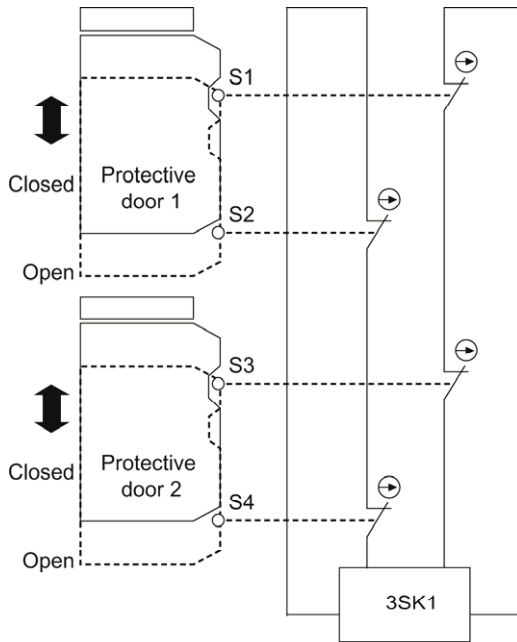

3SK1 devices

5.1 3SK1 standard

5.1.1 General information

The safety relays of the Standard series can be configured as stand-alone devices or as an expansion solution with conventional wiring technology.

The focus of the Standard series is on:

- Single devices for simple safety applications
- Output-side expansion by means of expansion units and external wiring
- No expansion on the input side

5.1.2 Applications

- EMERGENCY OFF / EMERGENCY STOP monitoring.
- Monitoring of protective doors with electromechanical position switches, solid-state position switches, or solenoid switches.
- Monitoring of contact-free protection equipment, e.g. light arrays/light barriers, or laser scanners.

3SK1 Standard safety relays can be used in EMERGENCY OFF/EMERGENCY STOP devices in accordance with ISO 13850 and in safety circuits in accordance with VDE 0113-1 and/or DIN EN 60204-1. Depending on the external circuit, it is possible to achieve SILCL 3 in accordance with IEC 62061, SIL 3 in accordance with IEC 61508 and PL e (Cat. 4) in accordance with ISO 13849-1.

The safety relays comply with DIN EN 50156-1:2004 (Electrical equipment for furnaces).

5.1.3 3SK1111 Standard basic unit instantaneous (with relay outputs)

5.1.3.1 General information

Article number (MLFB):

3SK1111-xAB30	24 V AC/DC
3SK1111-xAW20	110 ... 240 V AC / DC (wide-range supply)

(x) 1 = screw-type terminal; 2 = push-in terminal

Device features:

- 2 sensor inputs (channels 1 and 2)
- 1 input for feedback circuit and START button
- 3 enabling circuits (safety-related circuits, NO contacts)
- 1 signaling circuit (non-safety-related circuit, NC contact)
- 2 LEDs for displaying the operating states
- Slide switch for function setting
- Single-channel or two-channel connection
- Cross-circuit detection between sensor channels 1 and 2
- Enclosure width 22.5 mm
- Removable terminals

5.1.3.2 Function description


The device is a two-channel safety relay for EMERGENCY OFF and EMERGENCY STOP equipment in accordance with EN 60204-1.

The 3SK1111 Standard basic unit is equipped with a positively-driven relay and monitors itself during every ON/OFF cycle.

The safety relay has three enabling circuits (safety-related circuits) as NO circuits and a signaling circuit (non-safety-related circuit, NC contact).

On the front of the device there is a slide switch for function setting and two LEDs for displaying the operating states.

5.1.3.3 Design

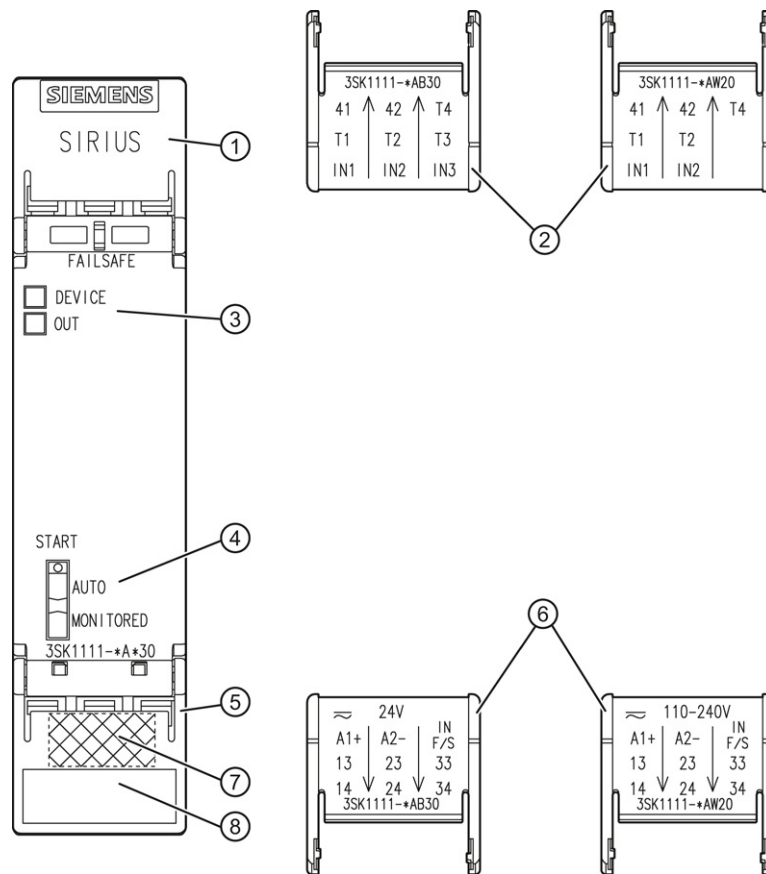

- ① Top cover flap
- ② Top cover flap; internal inscription
- ③ Display LEDs
- ④ Slide switch
- ⑤ Bottom cover flap
- ⑥ Bottom cover flap; internal inscription
- ⑦ DataMatrix code
- ⑧ Device identification label

5.1.3.4 Terminal assignment

Terminal	Explanation
A1	L+
A2	N-
IN1	Sensor channel 1
IN2	Sensor channel 2
IN3	Non-floating sensor evaluation ¹⁾
INF/S	Feedback circuit/START button
T1	Test output 1 (for IN1)
T2	Test output 2 (for IN2)
T3	Test output 3 (for IN3) ¹⁾
T4	Test output 4 (for INF/S)
13 - 14 23 - 24 33 - 34	Enabling circuits (NO, relay contact)
41 - 42	Signaling circuits (NC, relay contact)
Floating:	Sensors T1/IN1 and T2/IN2 Jumper T3/IN3
Non-floating	Sensors IN1 and IN3 ¹⁾ Jumper T2/IN2

¹⁾ For 24 V AC/DC variant only

5.1.3.5 Inputs

The device has three or four inputs for safe signal processing: IN1, IN2 or IN3 (only 24 V devices for connecting floating sensors) INF/S:

The inputs IN1 and IN2 can only be operated in two-channel mode with cross-circuit detection. Single-channel activation is only possible via the supply voltage connection (A1). In this case, circuits T1/IN1, T2/IN2 and T3/IN3 (24 V devices only) must be jumpered.

You can find additional information on single-channel sensor connection in the Typical circuits (Page 122) section.

Voltage variant 24 V:

Connecting floating sensors:

When floating sensors are used, sensor inputs T1/IN1 and T2/IN2 must be used and T3/IN3 must additionally be jumpered for two-channel sensor connection.

Connecting non-floating sensors:

With non-floating sensors, cross-circuit detection must be deactivated. This is implemented by the following pin assignment on the 3SK1111-.AB30:

IN1 and IN3 must be used as the input terminal for the two-channel non-floating sensor. In addition, T2/IN2 must be jumpered.

Voltage variant 110 V ... 240 V AC/DC:

Only **floating sensors** can be connected to the 3SK1111-.AW20 device version.

The 2-channel sensor is connected via T1/IN1 and T2/IN2.

5.1.3.6 Outputs

The safety relay has the following outputs:

- Safety-related outputs (enabling circuits, relays), NO contacts: 13/14, 23/24, 33/34
- Non-safety-related outputs (enabling circuit; relays), NC contacts: 41/42

5.1.3.7 Display of the operating state

Two LEDs and a slide switch indicate the operating state and functioning of the device:

- DEVICE
- OUT

LED displays

LED		Operation			
DEVICE	OUT	Line supply	Sensor	START button	Enabling circuit
Green	Green	ON	Not pressed	Pressed	Closed
Green	OFF		Pressed	Not pressed	Open
Green	OFF		Not pressed	Not pressed	Open
		Error			
OFF	OFF	Cross-circuit or no power supply			Open



5.1.3.8 Function setting



Setting the functions

Slide switch		
Start	AUTO	Autostart
<input type="checkbox"/> AUTO <input checked="" type="checkbox"/> MONITORED	MONITORED	Monitored start

In the delivery state, the slide switch is at the bottom (monitored start).

State diagrams 3SK1111

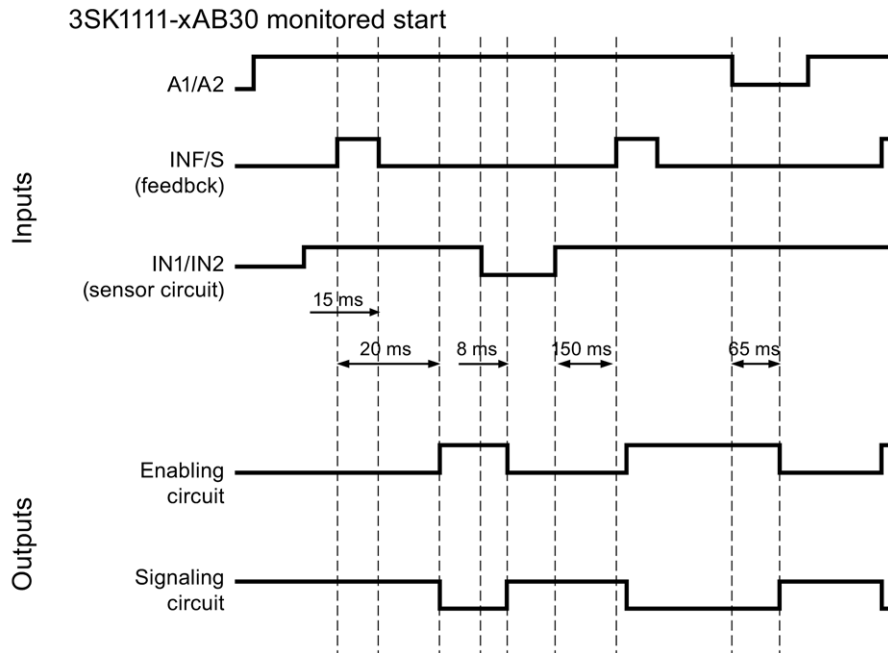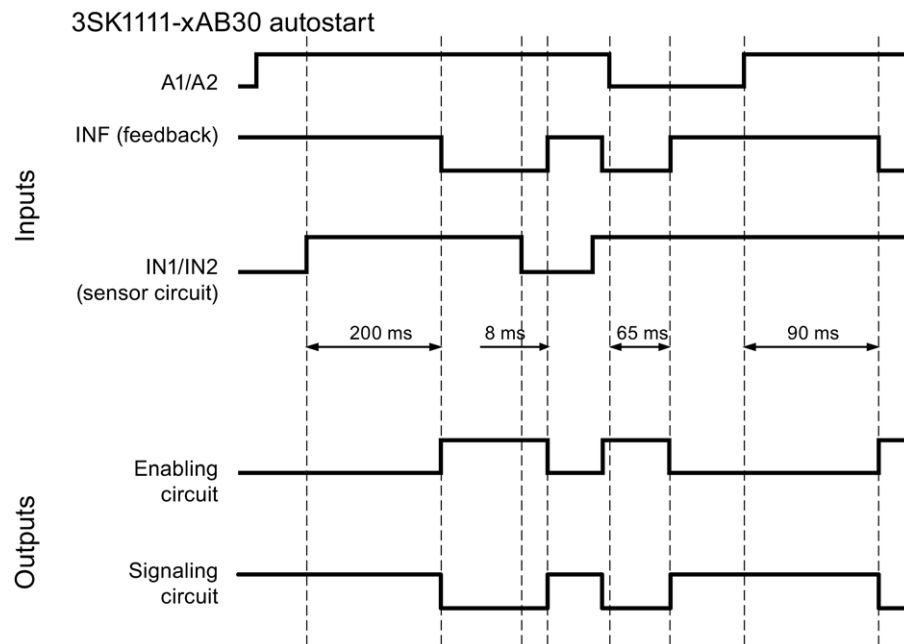

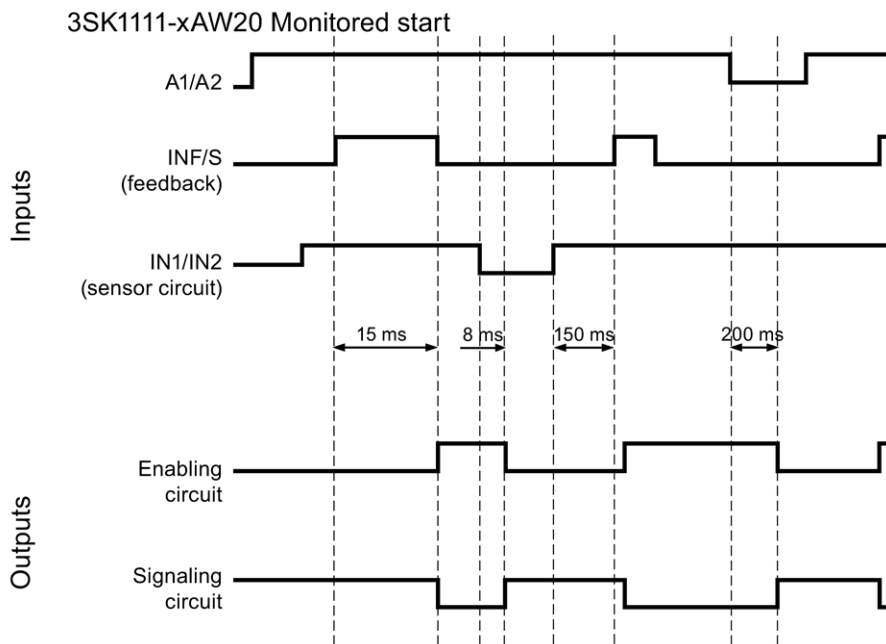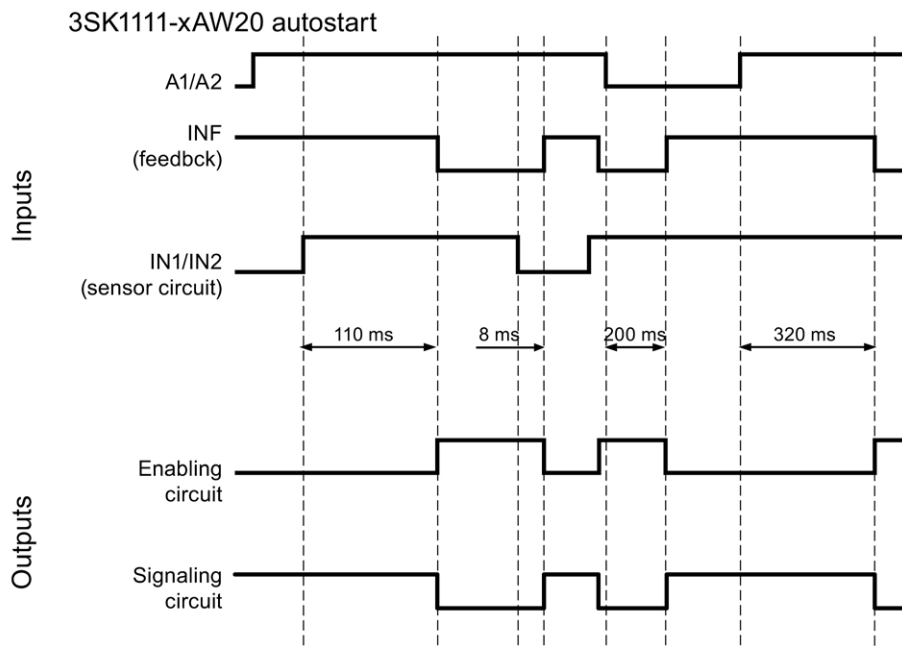

5.1.4 3SK1112 Standard basic unit instantaneous (with solid-state outputs)

5.1.4.1 General information


Article number MLFB:

3SK1112-xBB40	24 V DC
---------------	---------

(x) 1 = screw-type terminal; 2 = push-in terminal

Device features:

- 4-way DIP switch for function setting (parameterization)
- SET/RESET button
- 4 LEDs for status and function display
- 2 sensor inputs (channels 1 and 2)
- 1 input (cascading circuit)
- 1 input (START pushbutton circuit)
- 1 input (feedback circuit)
- 2 test outputs
- 2 safe solid-state outputs
- 1 solid-state signaling circuit
- Enclosure width 22.5 mm
- Removable terminals

 WARNING
Continuous operation Devices up to E01/V1.0.0: In continuous operation for PL e/Cat. 4 in accordance with ISO 13849-1 or SILCL 3 in accordance with IEC 62061, the key safety values apply where the function test interval (state change of the outputs) ≤ 1 year. Devices from E02/V1.1.0: In continuous operation for PL e/Cat. 4 in accordance with ISO 13849-1 or SILCL 3 in accordance with IEC 62061, the key safety values apply where the function test interval (state change of the outputs) ≤ 20 years.


5.1.4.2 Function description

The 3SK1112 safety relay has two safety-related solid-state safe outputs and one non-safety-related signaling circuit.

On the front of the device there is a 4-way DIP switch for function setting and 4 LEDs for status and function display.

The SET/RESET button is used to load function settings and to restart the device (reset). On commissioning, the device runs through a self-test. This checks that the internal electronics and firmware are functioning correctly. All internal safety-critical parts of the circuit are cyclically monitored for faults during operation. The semiconductor outputs cyclically run through a light/dark test for up to 2.5 ms (dynamically) to verify their correct functioning.

5.1.4.3 Design

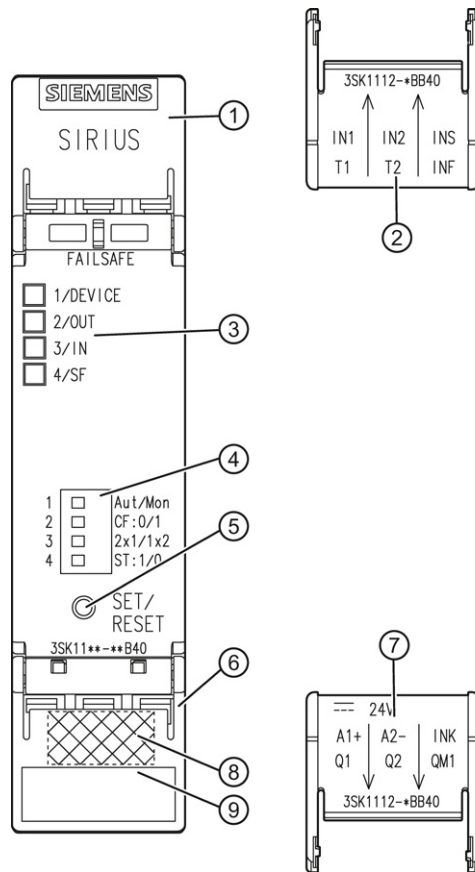

- ① Top cover flap
- ② Top cover flap; internal inscription
- ③ Display LEDs
- ④ DIP switch
- ⑤ SET/RESET button
- ⑥ Bottom cover flap
- ⑦ Bottom cover flap; internal inscription
- ⑧ DataMatrix code
- ⑨ Device identification label

5.1.4.4 Terminal assignment

Terminal	Explanation
A1	+
A2	-
IN1	Sensor channel 1
IN2	Sensor channel 2
INS	START pushbutton circuit
INF	Feedback circuit
INK	Cascading circuit
T1	Test output 1 (for IN1)
T2	Test output 2 (for IN2, INF)
Q1	Safe output 1 (switching to P potential, 24 V DC solid-state)
Q2	Safe output 2 (switching to P potential, 24 V DC solid-state)
QM1	Signaling circuit 1 (switching to P potential, 24 V DC solid-state)

5.1.4.5 Inputs

The device has five inputs for safe signal processing: IN1, IN2, INS, INF, INK:

- IN1: sensor input channel 1
- IN2: sensor input channel 2
- INS: START pushbutton circuit (start after rising and falling edge)
- INF: feedback circuit (checked for closed state: before switching on)
- INK: cascading circuit (cascading input/normal switching duty)
- The cascading circuit is AND-connected with the IN1 and IN2 sensor inputs.
- ON-button circuit and cascading circuit are activated with a static +24 V DC signal.
- With cross-circuit detection activated, the following inputs are checked for cross-circuits and short-circuits to P: IN1/T1 to IN2/T2 and INF/T2. The inputs then receive their supplies from the test outputs T1 and T2.
- If "without cross-circuit detection" is set on the device, inputs IN1 and IN2 are not checked for cross-circuits. Inputs IN1 and IN2 must not be supplied via T1/T2 here, otherwise a fault will be generated via input INF. It is therefore essential that inputs IN1 and IN2 are supplied via an external + 24 V DC current source from which the device is also supplied.
- If the unit is parameterized to 2 x 1-channel with DIP switch 3, the sensor circuit that is not used (T1/IN1 or T2/IN2) must be bypassed.

Note

Observe the following special points during commissioning of the 3SK1112 safety relay:

The cascading input must be connected to terminal A1 if it is not to be used.

Monitoring of the feedback circuits is not optional.

5.1.4.6 Outputs

The safety relay has the following outputs:

- Q1, Q2: safety-related solid-state outputs with dynamic monitoring, switching to P potential
- QM1: non-safety-related solid-state signaling circuit, switching to P potential

The safe outputs and the safety-related signaling circuit are short-circuit proof.

5.1.4.7 Display of the operating state

Four LEDs and one DIP switch indicate the operating state and functioning of the device:

- (1) DEVICE
- (2) OUT
- (3) IN
- (4) SF


The four LEDs show the following:

- Operating mode: Diagnostics
- Configuration mode: DIP setting

For an explanation of the operating state display, see Section Display and diagnostics (Page 203)

5.1.4.8 Function setting

Table 5- 1 DIP switch

Switch position: left	Schematic	DIP switch No.	Switch position: right
Autostart		1	Monitored start
Cross-circuit detection deactivated		2	Cross-circuit detection activated
2 x single-channel sensor connection		3	1 x two-channel sensor connection
Start-up test ON		4	Start-up test OFF

In the delivery state, all the DIP switches are in switch position: right.



Table 5- 2 SET/RESET button

Function of the SET/RESET button	Status of the indicating LEDs	Function
SET	"DEVICE" LED flashing yellow	<ul style="list-style-type: none"> Press key for about 1 s The parameterization is loaded
RESET	"DEVICE" LED red	<ul style="list-style-type: none"> Press key for about 1 s => The device restarts without the supply voltage having to be switched off
	"DEVICE" LED flashing green yellow	
	"SF" LED red	

Note

The SET/RESET pushbutton only triggers a reset for the device on which the button is pressed.

State diagrams 3SK1112

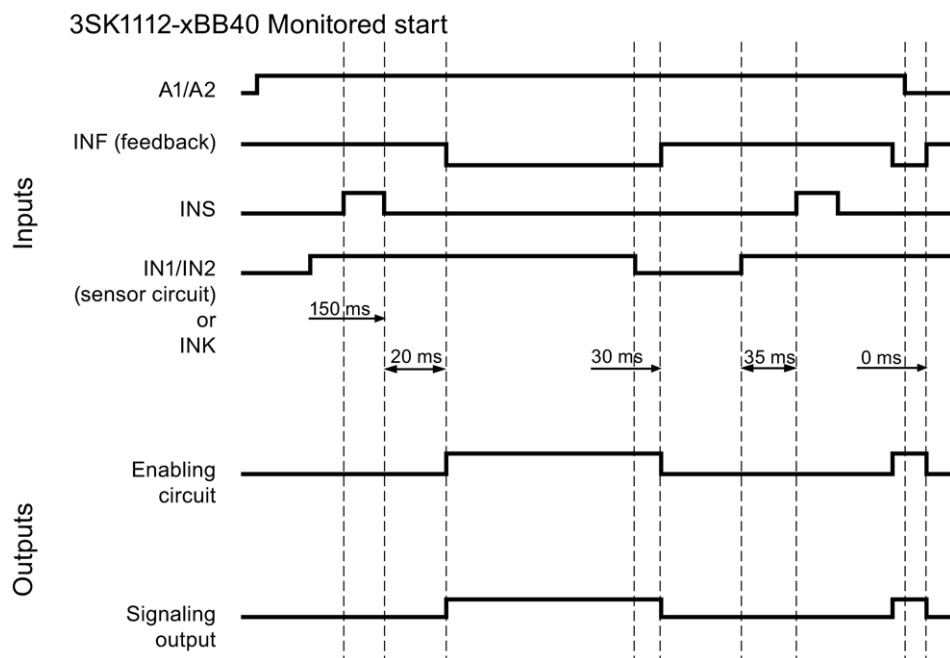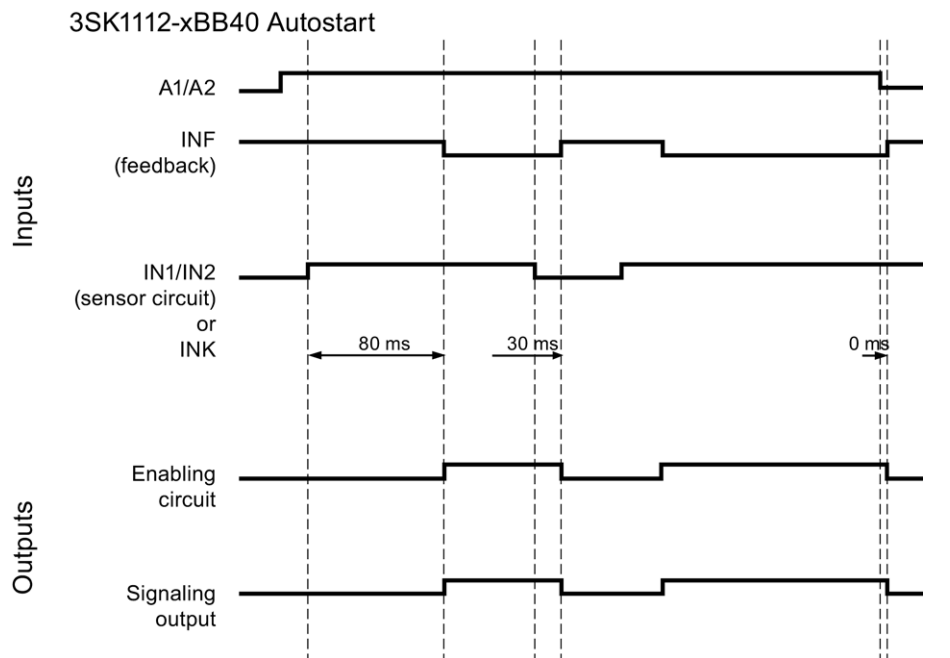

5.2 3SK1 Advanced

5.2.1 General information

The safety relays of the Advanced device series comprise basic devices and input and output expansions. The Advanced safety relays can be connected by means of a 3ZY12 device connector.

When configuring the system, it must be ensured that input expansions are always mounted on the left, and output expansions (3SK121 or 3RM1 Failsafe motor starter) on the right of the basic unit. For control supply voltages of 110 ... 240 V AC/DC, the Advanced device series can be supplied with the necessary 24 V DC voltage from the 3SK1230 power supply (which must be positioned on the extreme left in the system).

The focus of the Advanced relay series is on:

- Single devices that can be flexibly parameterized
- Expandability using 3ZY12 device connector on both input and output side
- Basic units with time-delayed enabling circuits / outputs

5.2.2 Applications

- EMERGENCY OFF / EMERGENCY STOP monitoring.
- Monitoring of protective doors with electromechanical position switches, solid-state position switches, or solenoid switches.
- Monitoring of contact-free protection equipment, e.g. light arrays/light barriers, or laser scanners.

The 3SK1 safety relays Advanced can be used in EMERGENCY OFF and EMERGENCY STOP devices in accordance with EN 60204-1 and in safety circuits in accordance with VDE 0113-1 and/or EN 60204-1, e.g. in circuits in which controlled shutdown, STOP Category 1, is necessary. Depending on the external circuit, it is possible to achieve SILCL 3 in accordance with IEC 62061, SIL 3 in accordance with IEC 61508 and PL e (Cat. 4) in accordance with ISO 13849-1.

The safety relays comply with DIN EN 50156-1:2004 (Electrical equipment for furnaces). You can use the 3SK1 safety relays Advanced to achieve two-hand switching applications up to type IIIc in compliance with EN 574:1996+A1:2008.

5.2.3 General device features

Device properties:

- 4-way DIP switch for function setting (parameterization)
- SET/RESET button
- 4 LEDs for status and function display
- 2 sensor inputs (channels 1 and 2)
- 1 input (cascading circuit)
- 1 input (START pushbutton circuit)
- NO contact/NC contact evaluation via external jumper (T1/PAR)
- Connecting interface for 3ZY12 device connectors
- Removable terminals

5.2.4 Function description

There is a 4-way DIP switch for function setting and 4 LEDs for status and function display on the front of the 3SK1 Advanced basic units. A SET/RESET button can be used to load function settings and to perform a device restart (reset). On commissioning, the devices runs a self-test in which the internal electronics and firmware are checked for correct functioning. All internal parts of the circuit are cyclically monitored for faults during operation. In the case of units with semiconductor outputs, they cyclically run through a light/dark test for up to 2.5 ms (dynamically) to verify their correct functioning. The safety relays can be expanded using 3ZY12 device connectors with input and output expansions.

3SK1 Advanced basic unit time-delayed only:

These basic units have two time-delayed and two instantaneous enabling circuits as NO circuits or outputs switching to P potential.

Display of the operating state

Four LEDs and one DIP switch indicate the operating state and functioning of the device:

- (1) DEVICE
- (2) OUT
- (3) IN
- (4) SF


The four LEDs show the following:

- Operating mode: Diagnostics
- Configuration mode: DIP setting

For an explanation of the operating state display, see Section Display and diagnostics (Page 203)

5.2.5 Functions

Table 5- 3 DIP switch

Switch position: left	Schematic	DIP switch No.	Switch position: right
Autostart		1	Monitored start
Cross-circuit detection deactivated		2	Cross-circuit detection activated
2 x single-channel sensor connection		3	1 x two-channel sensor connection
Start-up test ON		4	Start-up test OFF

In the delivery state, all the DIP switches are in switch position: right.

Terminal parameterization:

Jumper on terminals T1/PAR = NO/NC evaluation

Table 5- 4 **SET/RESET button**

Function of the SET/RESET button	Status of the indicating LEDs	Function
SET	"DEVICE" LED flashing yellow	<ul style="list-style-type: none"> • Press key for about 1 s The parameterization is loaded
RESET	"DEVICE" LED red	<ul style="list-style-type: none"> • Press key for about 1 s => The device restarts without the supply voltage having to be switched off
	"DEVICE" LED flashing green yellow	
	"SF" LED red	

Note

The SET/RESET pushbutton only triggers a reset for the device on which the button is pressed.

Potentiometer for time setting

Potentiometer for infinite time setting of the time-delayed enabling circuits on the Advanced basic units (with time-delayed enabling circuits).

- 3SK112.-.CB41 setting range: 0,05 ... 3 s
- 3SK112.-.CB42 setting range: 0,5 ... 30 s
- 3SK112.-.CB44 setting range: 5 ... 300 s

Note

The delay time ends when the voltage is disconnected. The time-delayed contacts change switch position.

Using the cascading input

The cascading input must be controlled with a 24 V DC signal. The voltage source of the 24 V DC signal must correspond to the voltage source of the safety relay's supply voltage (A1).

Note

Observe the following during commissioning of 3SK1 Advanced safety relays:

The cascading input must be connected to terminal A1 if it is not to be used.

Monitoring of the feedback circuits is not optional.

"2 x single-channel" parameterization

If the unit is parameterized to 2 x 1-channel with DIP switch 3, the sensor circuit that is not used (T1/IN1 or T2/IN2) must be bypassed.

5.2.6 3SK1121 Advanced basic unit instantaneous (with relay outputs)

5.2.6.1 Device features

Article number (MLFB):


3SK1121-xAB40	24 V DC
---------------	---------

(x) 1 = screw-type terminal; 2 = push-in terminal

5.2.6.2 Function description

The 3SK1121 Advanced basic unit has three safety-related relay enabling circuits and one non-safety-related signaling circuit.

5.2.6.3 Design

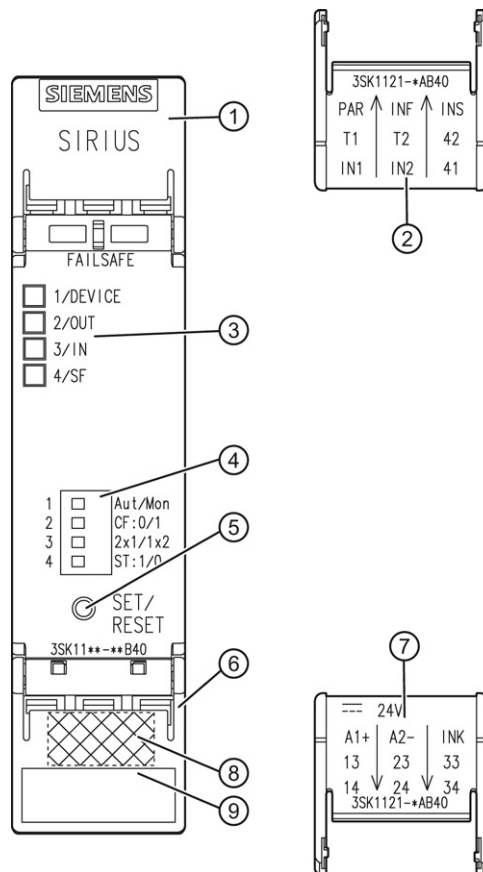


- ① Top cover flap
- ② Top cover flap; internal inscription
- ③ Display LEDs
- ④ DIP switch
- ⑤ SET/RESET button
- ⑥ Bottom cover flap
- ⑦ Bottom cover flap; internal inscription
- ⑧ DataMatrix code
- ⑨ Device identification label

5.2.6.4 Terminal assignment

Terminal	Explanation
A1	+
A2	-
IN1	Sensor channel 1
IN2	Sensor channel 2
PAR	NO contact/NC contact evaluation
INS	START pushbutton circuit
INF	Feedback circuit
INK	Cascading circuit
T1	Test output 1 (for IN1, PAR)
T2	Test output 2 (for IN2, INF)
13 - 14 23 - 24 33 - 34	Enabling circuits (NO, relay contact)
41 - 42	Signaling circuits (NC, relay contact)

State diagram 3SK1121

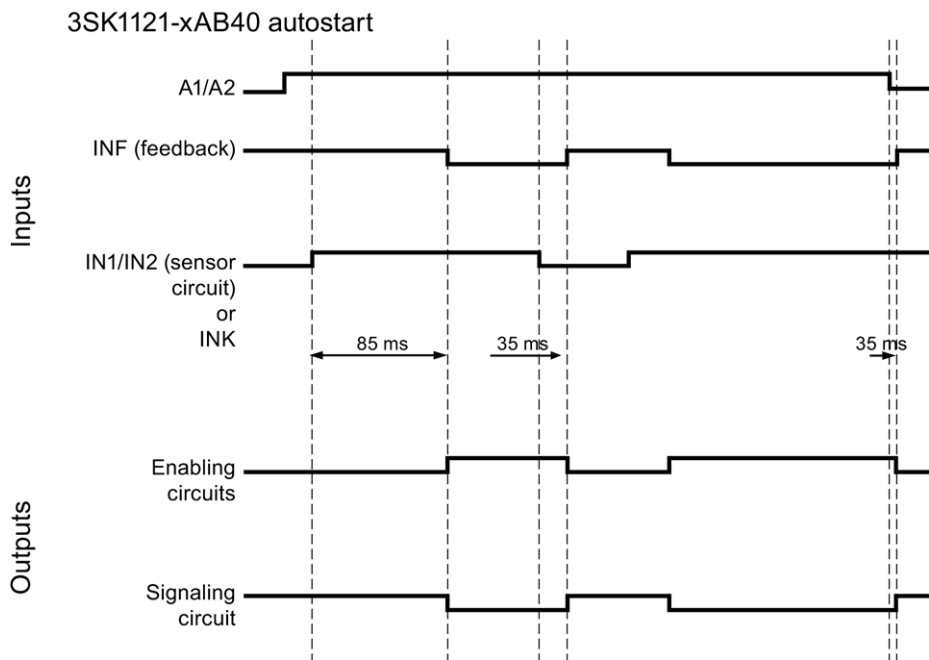

5.2.7 3SK1121 Advanced basic unit time-delayed (with relay outputs)

5.2.7.1 Device features

Article number (MLFB):

3SK1121-xCB4y	24 V DC
---------------	---------


(x) 1 = screw-type terminal; 2 = push-in terminal

(y) time delay 1 = 0.05 ... 3 s; 2 = 0.5 ... 30 s; 4 = 5 ... 300 s

Additional / alternative device characteristics

- 2 instantaneous enabling circuits (safety-related circuits, NO contacts)
- 2 time-delayed enabling circuits (safety-related circuits, NO contacts)
- Potentiometer for setting the delay time
- Time function: With OFF-delay

5.2.7.2 Design


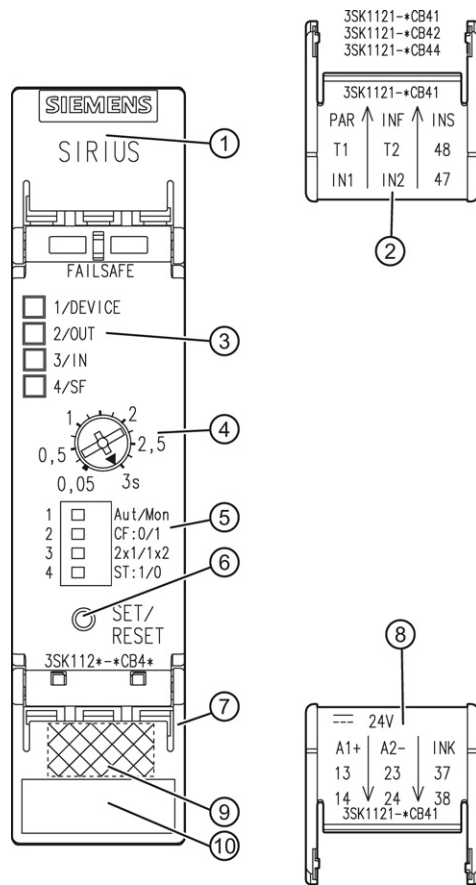


- ① Top cover flap
- ② Top cover flap; internal inscription
- ③ Display LEDs
- ④ Potentiometer for setting the delay time
- ⑤ DIP switch
- ⑥ SET/RESET button
- ⑦ Bottom cover flap
- ⑧ Bottom cover flap; internal inscription
- ⑨ DataMatrix code
- ⑩ Device identification label

5.2.7.3 Terminal assignment

Terminal	Explanation
A1	+
A2	-
IN1	Sensor channel 1
IN2	Sensor channel 2
PAR	NO contact/NC contact evaluation
INS	START pushbutton circuit
INF	Feedback circuit
INK	Cascading circuit
T1	Test output 1 (for IN1, PAR)
T2	Test output 2 (for IN2, INF)
13 - 14	Instantaneous enabling circuit 1 (NO, relay contact)
23 - 24	Instantaneous enabling circuit 2 (NO, relay contact)
37 - 38	Time delayed enabling circuit 1 (NO, relay contact)
47 - 48	Time delayed enabling circuit 2 (NO, relay contact)

State diagrams 3SK1121-xCB4y

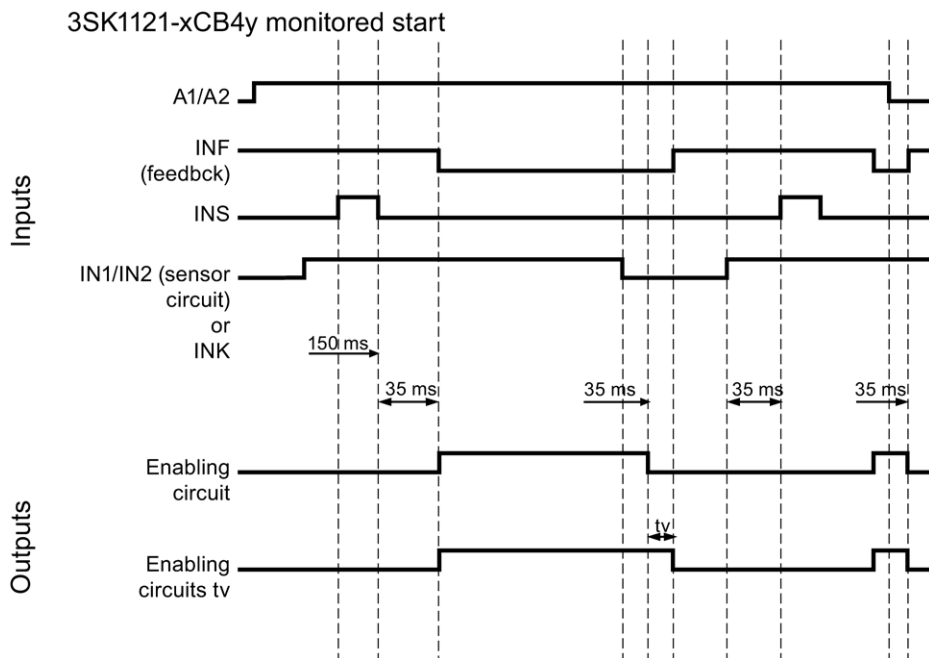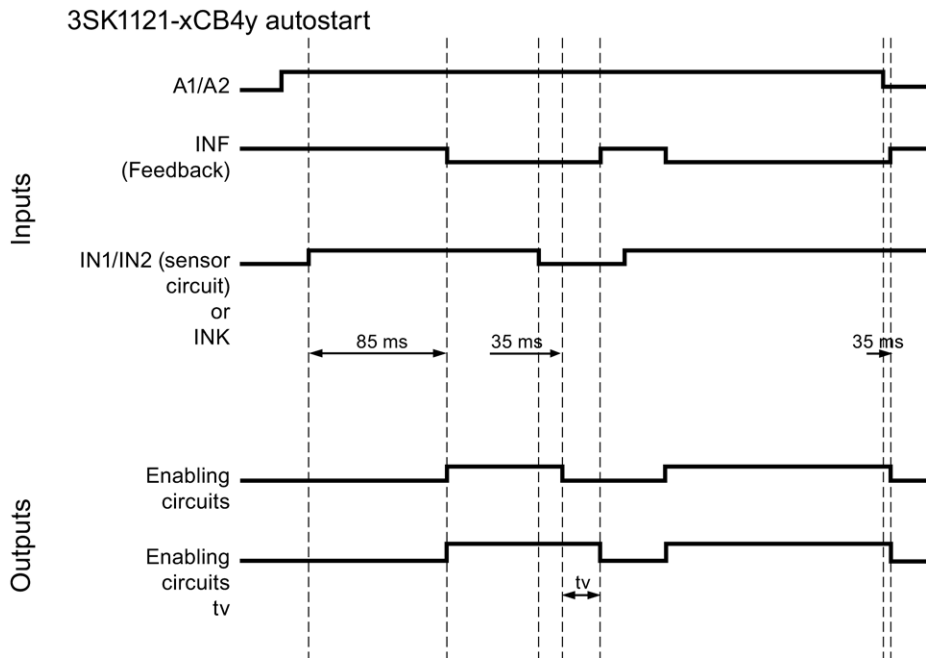

5.2.8 3SK1122 Advanced basic unit instantaneous (with solid-state outputs)

5.2.8.1 Device features


Article number (MLFB):

3SK1122-xAB40	24 V DC
---------------	---------


(x) 1 = screw-type terminal; 2 = push-in terminal

Additional or alternative device features

- 3 safety-related solid-state outputs
- 1 solid-state signaling circuit

 WARNING
Continuous operation Devices up to E01/V1.0.0: In continuous operation for PL e/Cat. 4 in accordance with ISO 13849-1 or SILCL 3 in accordance with IEC 62061, the key safety values apply where the function test interval (state change of the outputs) \leq 1 year. Devices from E02/V1.1.0: In continuous operation for PL e/Cat. 4 in accordance with ISO 13849-1 or SILCL 3 in accordance with IEC 62061, the key safety values apply where the function test interval (state change of the outputs) \leq 20 years.

5.2.8.2 Design


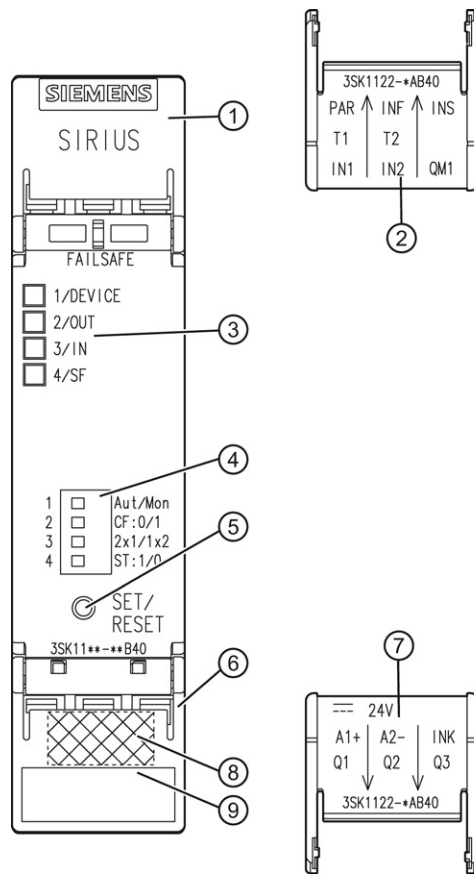


- ① Top cover flap
- ② Top cover flap; internal inscription
- ③ Display LEDs
- ④ DIP switch
- ⑤ SET/RESET button
- ⑥ Bottom cover flap
- ⑦ Bottom cover flap; internal inscription
- ⑧ DataMatrix code
- ⑨ Device identification label

5.2.8.3 Terminal assignment

Terminal	Explanation
A1	+
A2	-
IN1	Sensor channel 1
IN2	Sensor channel 2
PAR	NO contact/NC contact evaluation
INS	START pushbutton circuit
INF	Feedback circuit
INK	Cascading circuit
T1	Test output 1 (for IN1, PAR)
T2	Test output 2 (for IN2, INF)
Q1	Safety-related output 1 (switching to P potential, 24 V DC solid-state)
Q2	Safety-related output 2 (switching to P potential, 24 V DC solid-state)
Q3	Safety-related output 3 (switching to P potential, 24 V DC solid-state)
QM1	Signaling circuit 1 (switching to P potential, 24 V DC solid-state)

State diagrams 3SK1122-xAB40

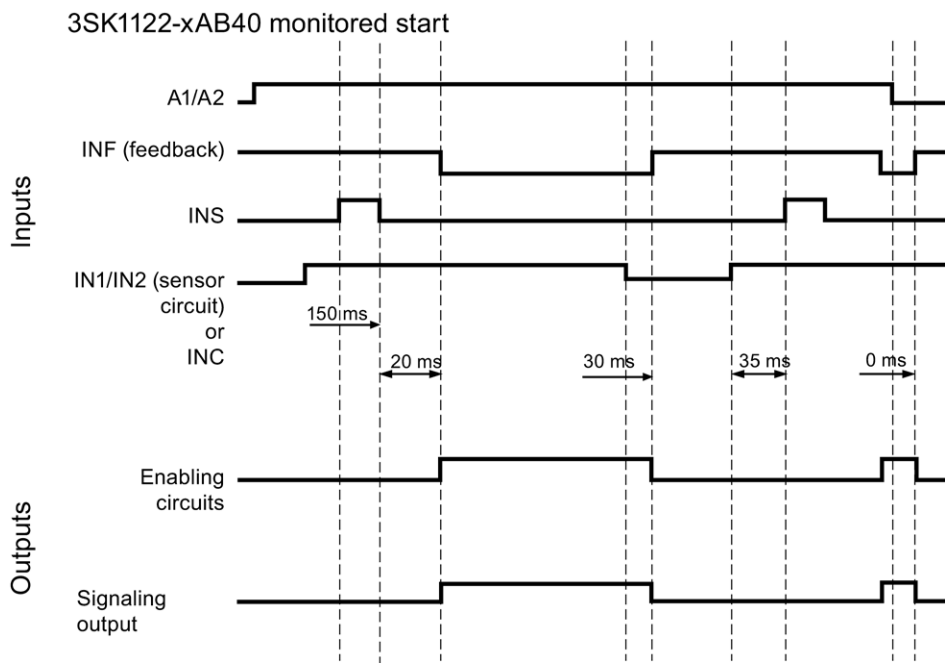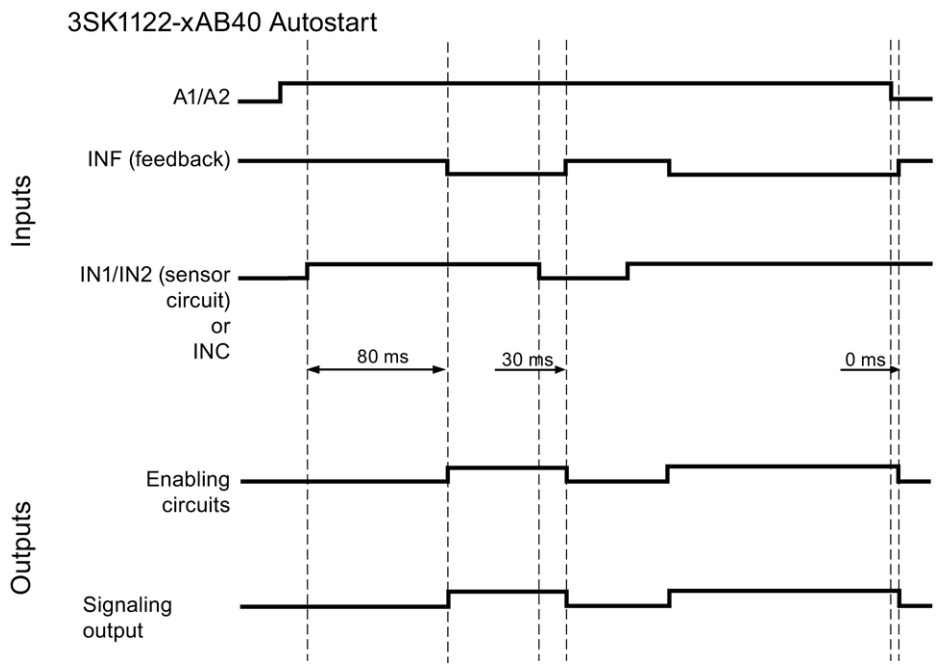

5.2.9 3SK1122 Advanced basic unit time-delayed (with solid-state outputs)

5.2.9.1 Device features

Article number (MLFB):

3SK1122-xCB4y	24 V DC
---------------	---------

(x) 1 = screw-type terminal; 2 = push-in terminal

(y) time delay 1 = 0.05 ... 3 s; 2 = 0.5 ... 30 s; 4 = 5 ... 300 s

Additional / alternative device characteristics

- 2 instantaneous solid-state outputs
- 2 time-delayed solid-state outputs
- Potentiometer for setting the delay time
- Time function: With OFF-delay

WARNING

Continuous operation


Devices up to E01/V1.0.0:

In continuous operation for PL e/Cat. 4 in accordance with ISO 13849-1 or SILCL 3 in accordance with IEC 62061, the key safety values apply where the function test interval (state change of the outputs) \leq 1 year.

Devices from E02/V1.1.0:

In continuous operation for PL e/Cat. 4 in accordance with ISO 13849-1 or SILCL 3 in accordance with IEC 62061, the key safety values apply where the function test interval (state change of the outputs) \leq 20 years.

5.2.9.2 Design


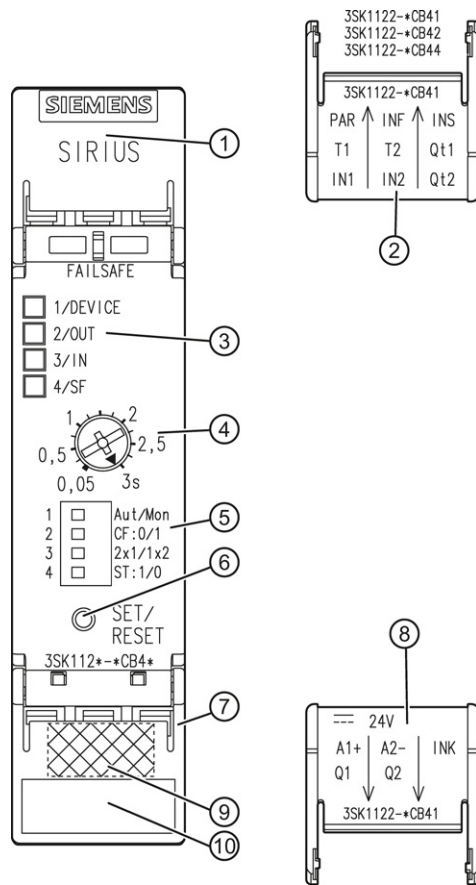


- ① Top cover flap
- ② Top cover flap; internal inscription
- ③ Display LEDs
- ④ Potentiometer for setting the delay time
- ⑤ DIP switch
- ⑥ SET/RESET button
- ⑦ Bottom cover flap
- ⑧ Bottom cover flap; internal inscription
- ⑨ DataMatrix code
- ⑩ Device identification label

5.2.9.3 Terminal assignment

Terminal	Explanation
A1	+
A2	-
IN1	Sensor channel 1
IN2	Sensor channel 2
PAR	NO contact/NC contact evaluation
INS	START pushbutton circuit
INF	Feedback circuit
INK	Cascading circuit / normal switching duty
T1	Test output 1 (for IN1, PAR)
T2	Test output 2 (for IN2, INF)
Q1	Instantaneous safety-related output 1 (switching to P potential, 24 V DC solid-state)
Q2	Instantaneous safety-related output 2 (switching to P potential, 24 V DC solid-state)
Qt1	Time-delayed safety-related output 1 (switching to P potential, 24 V DC solid-state)
Qt2	Time-delayed safety-related output 2 (switching to P potential, 24 V DC solid-state)

State diagrams 3SK1122-xCB4y

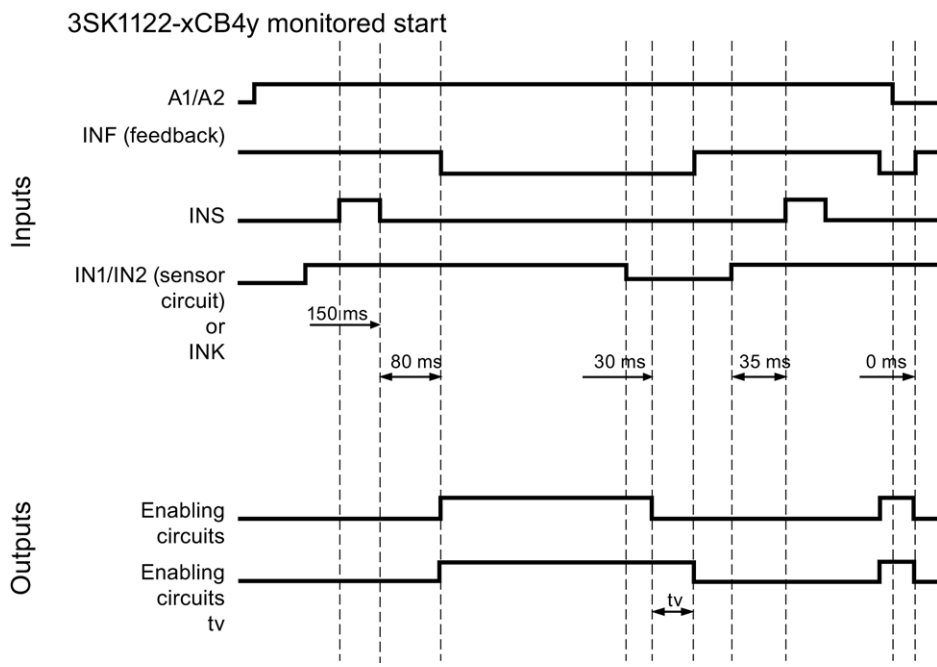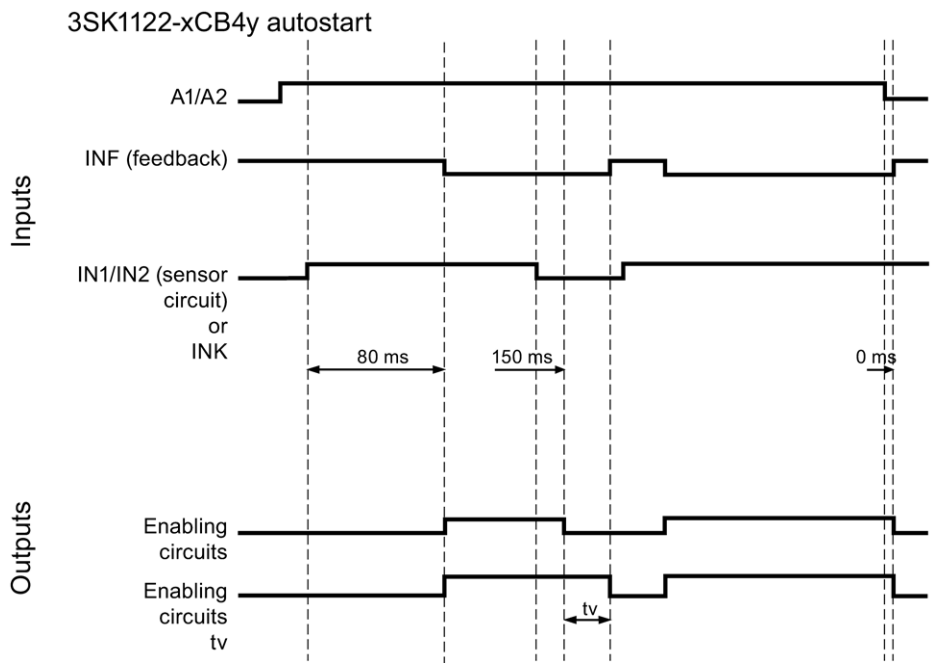

5.2.10 3SK1120 Advanced basic unit instantaneous (with solid-state outputs)

5.2.10.1 Device features

Article number (MLFB):

3SK1120-xAB40	24 V DC
---------------	---------

(x) 1 = screw-type terminal; 2 = push-in terminal

Additional or alternative device features

- 1 safety-related solid-state output
- The following design variants are possible for the 3SK1120 Advanced basic unit:
 - In operation without using device connectors, up to PL e/Cat. 4 in accordance with ISO 13849-1 or SILCL 3 in accordance with IEC 62061 can be achieved for devices from E02/V 1.1.0.

WARNING

Operation without using device connectors for E01/V1.0.0 devices

In operation without using device connectors, up to PL c / Cat. 2 in accordance with ISO 13849-1 or SILCL 2 in accordance with IEC 62061 can be achieved.

- Operation using device connectors

In operation using device connectors and using at least one output expansion (3SK1211, 3SK1213) or one 3RM1 Failsafe motor starter, up to PL e/Cat. 4 in accordance with ISO 13849-1 or SILCL 3 in accordance with IEC 62061 can be achieved.

WARNING

Continuous operation


Devices up to E01/V1.0.0:

In continuous operation for PL e/Cat. 4 in accordance with ISO 13849-1 or SILCL 3 in accordance with IEC 62061, the key safety values apply where the function test interval (state change of the outputs) \leq 1 year.

Devices from E02/V1.1.0:

In continuous operation for PL e/Cat. 4 in accordance with ISO 13849-1 or SILCL 3 in accordance with IEC 62061, the key safety values apply where the function test interval (state change of the outputs) \leq 20 years.

5.2.10.2 Design

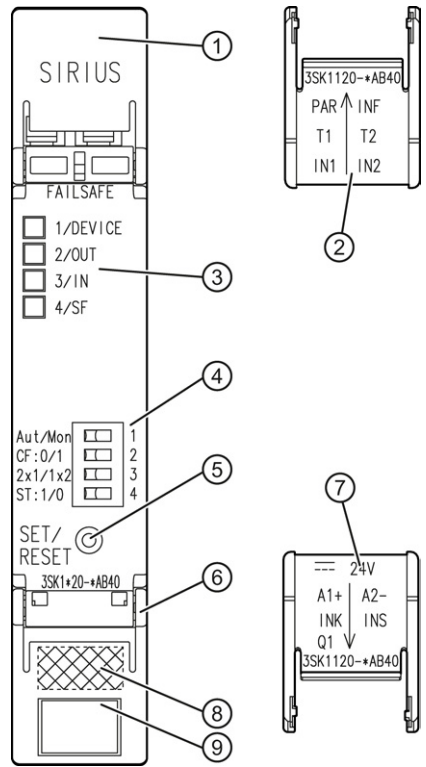

- ① Top cover flap
- ② Top cover flap; internal inscription
- ③ Display LEDs
- ④ DIP switch
- ⑤ SET/RESET button
- ⑥ Bottom cover flap
- ⑦ Bottom cover flap; internal inscription
- ⑧ DataMatrix code
- ⑨ Device identification label

5.2.10.3 Terminal assignment

Terminal	Explanation
A1	+
A2	-
IN1	Sensor channel 1
IN2	Sensor channel 2
PAR	NO contact/NC contact evaluation
INS	START pushbutton circuit
INF	Feedback circuit
INK	Cascading circuit
T1	Test output 1 (for IN1, PAR)
T2	Test output 2 (for IN2, INF)
Q1	Safety-related output 1 (switching to P potential, 24 V DC solid-state)

5.3 3SK1 output expansions

5.3.1 Applications

The 3SK1 output expansions are used to expand the enabling circuits. The maximum achievable Performance Level PL/Cat. in accordance with ISO 13849-1, SILCL in accordance with IEC 62061, SIL in accordance with IEC 61508 corresponds to the Performance Level PL and SIL of the basic unit when the external wiring (connection between basic unit and output expansion) is configured as fail-safe (e.g. basic unit and output expansion are connected using 3ZY12 device connector).

The output expansions can be activated via the supply voltage (A1/A2) or using 3ZY12 device connectors¹⁾.

1) For 24 V DC variant only

Note

If expansion units are controlled via the 3ZY12 device connector, additional feeding of the control supply voltage (A1/A2) at one of the output expansions leads to a fault in the system configuration.

Note

Use of the output expansions on 3ZY12 device connectors

You can switch between instantaneous or delayed control of the basic unit using the slide switch of the output expansion (see also the chapter "System configuration rules (Page 109)").

Note

Using the output expansions with conventional wiring

The slide switch has **no** function here.

If you require Stop category 1 outputs for the output expansion, terminals A1/A2 of the output expansion must be connected to outputs 38 or 48 on 3SK1 basic units with relay outputs or to Q1t/Q2t (in the case of 3SK1 with solid-state outputs).

5.3.2 Function description

The operating state of the 3SK1 output expansions is displayed on the DEVICE LED.

The 3SK1211 output expansions (4RO) have four safety-related enabling circuits as NO circuits, and the 3SK1213 output expansions (3RO) have three. They each have one positively-driven NC circuit. The output expansions can be activated via any enabling circuit / output of the basic unit via (A1). The NC circuit 51/52 of 3SK1211 (4RO) or 41/42 of 3SK1213 (3RO) is used for monitoring the output expansions.

In the 24 V DC variants, the expansion units can be activated and evaluated via the 3ZY12 device connectors.

5.3.3 Display of the operating state

Display of the operating state

The operating state and functioning of the device are indicated by an LED:

- (1) DEVICE

Operating states

LED	State	Meaning
DEVICE	Control supply voltage	Enabling circuits
OFF	OFF	Open
Green	ON	Closed

5.3.4 Function setting

Setting the activation (slide switch only for 24 V variants)

The interface input for activating the output expansion can be selected using a slide switch on the front of the device.

Slide switch	Interface input
Top	Outputs switch with time delay (as in basic unit)
Bottom	Outputs switch instantaneously

When using an instantaneous basic unit, the slide switch must be in the instantaneous position (bottom).

5.3.5 Output expansion 3SK1211

5.3.5.1 Device features

Article number (MLFB):

3SK1211-xBB00	24 V AC
3SK1211-xBB40	24 V DC
3SK1211-xBW20	110 ... 240 V AC / DC (wide-range supply)

(x) 1 = screw-type terminal; 2 = push-in terminal

Supply:

24 V AC:

- Activation via 24 V transformer is possible

24 V DC:

- An SELV / PELV power supply must be used for the infeed

110 ... 240 V AC/DC:


- Direct line supply connection L/N

Device properties:

- Slide switch for selecting the activation type (time-delayed / instantaneous)*
- 1 LED for status display
- 4 enabling circuits (safe circuits, NO contacts)
- 1 NC circuit as feedback contact for the 3SK1211 output expansion to the upstream basic unit
- 3ZY12* device connectors
- Enclosure width 22.5 mm
- Removable terminals


* For 24 V DC variant only

5.3.5.2 Design of 3SK1211-.B..0

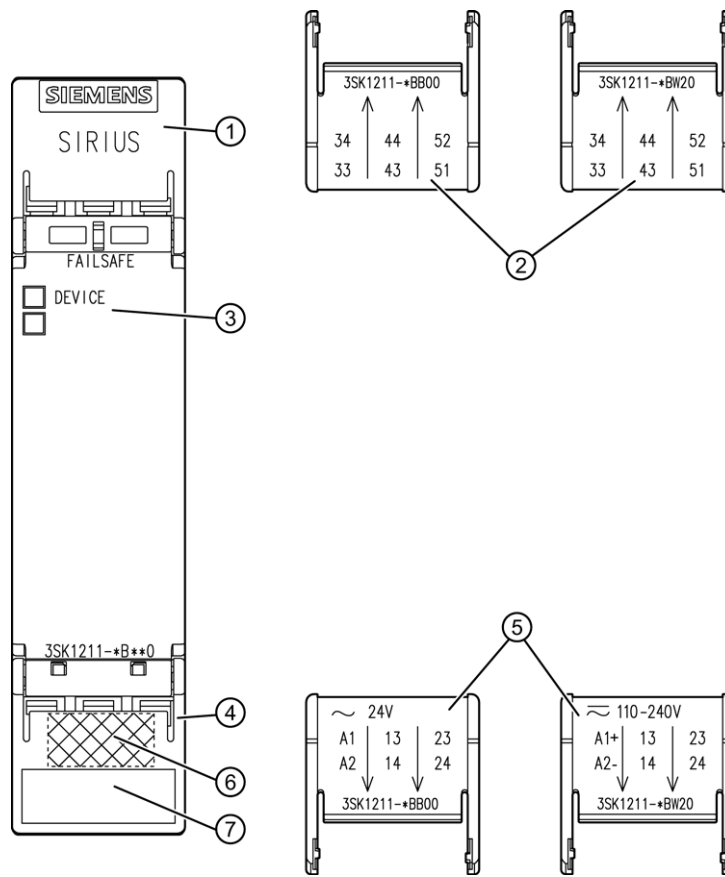

- ① Top cover flap
- ② Top cover flap; internal inscription
- ③ Display LEDs
- ④ Bottom cover flap
- ⑤ Bottom cover flap; internal inscription
- ⑥ DataMatrix code
- ⑦ Device identification label

5.3.5.3 Design of 3SK1211-.BB40

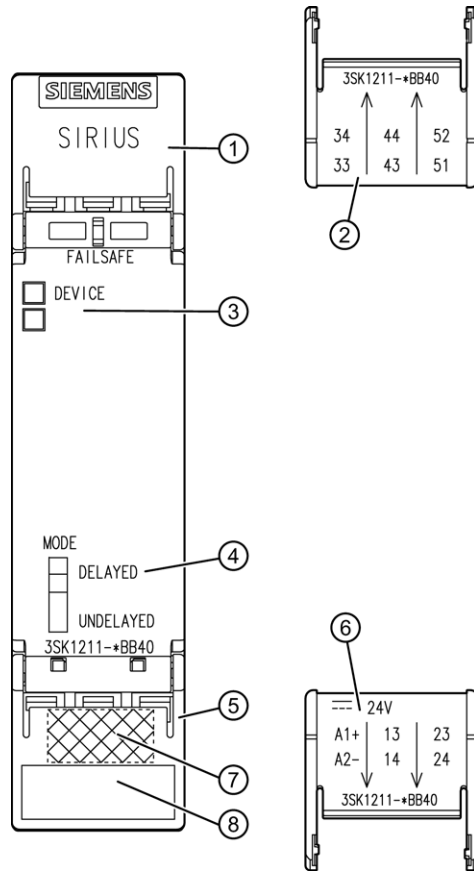

- ① Top cover flap
- ② Top cover flap; internal inscription
- ③ Display LEDs
- ④ Slide switch
- ⑤ Bottom cover flap
- ⑥ Bottom cover flap; internal inscription
- ⑦ DataMatrix code
- ⑧ Device identification label

5.3.5.4 Terminal assignment

Terminal	Explanation
A1	+ (L+ for 3SK1211-.BW20)
A2	- (N- for 3SK1211-.BW20)
13 - 14	Enabling circuit 1 (NO, relay contact)
23 - 24	Enabling circuit 2 (NO, relay contact)
33 - 34	Enabling circuit 3 (NO, relay contact)
43 - 44	Enabling circuit 4 (NO, relay contact)
51 - 52	NC circuit as feedback contact (NC, relay contact)

5.3.6 Output expansion 3SK1213

5.3.6.1 Device features

Article number (MLFB):

3SK1213-xAB40	24 V DC
3SK1213-xAJ20	115 V AC
3SK1213-xAL20	230 V AC

(x) 1 = screw-type terminal; 2 = spring-loaded terminal

Supply:

24 V DC:

- An SELV / PELV power supply must be used for the infeed

115 V AC and 230 V AC

- Direct line supply connection L/N

Device properties:


- Slide switch for selecting the activation type (time-delayed / instantaneous)*
- 1 LED for status display
- 3 enabling circuits (safe circuits, NO contacts)
- 1 NC circuit as feedback contact for the 3SK1213 output expansion for the upstream basic unit
- 3ZY12* device connectors
- Enclosure width 90 mm
- Removable terminals

* For 24 V DC variant only

Using 3ZY12 device connectors


The 3SK1213 output expansion must always be terminated with a device termination connector set for the 3SK1 safety relay, size > 45 mm (3ZY1212-0FA01). Expansion on the right-hand side is then no longer possible.

5.3.6.2 Design of 3SK1213-.AB40

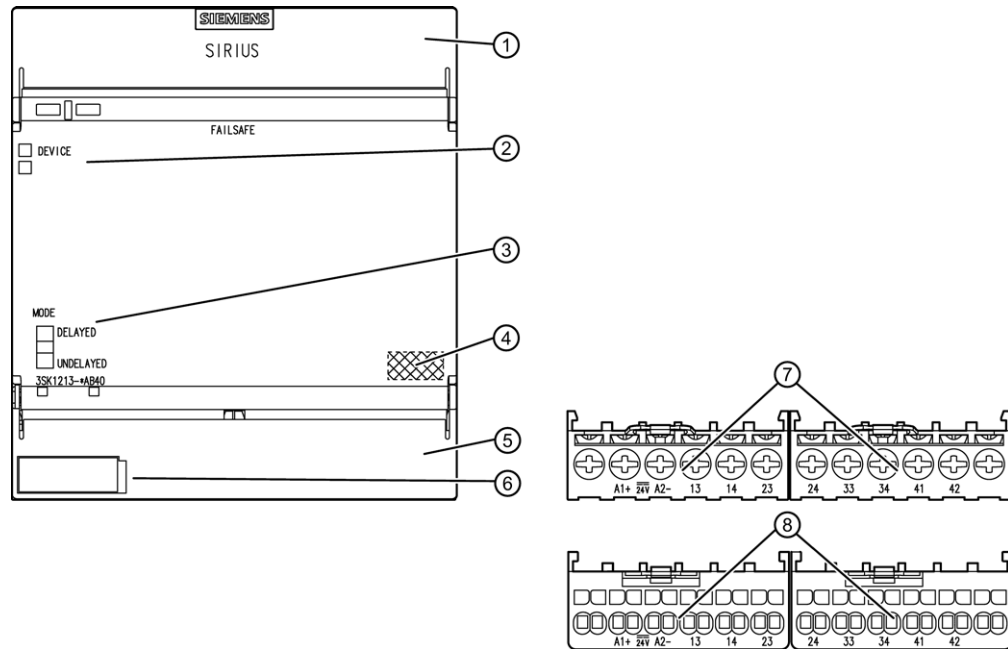

- ① Top cover flap
- ② Display LEDs
- ③ Slide switch
- ④ DataMatrix code
- ⑤ Bottom cover flap
- ⑥ Device identification label
- ⑦ Screw-type terminals
- ⑧ Spring-loaded terminals

5.3.6.3 Design of 3SK1213-A.20

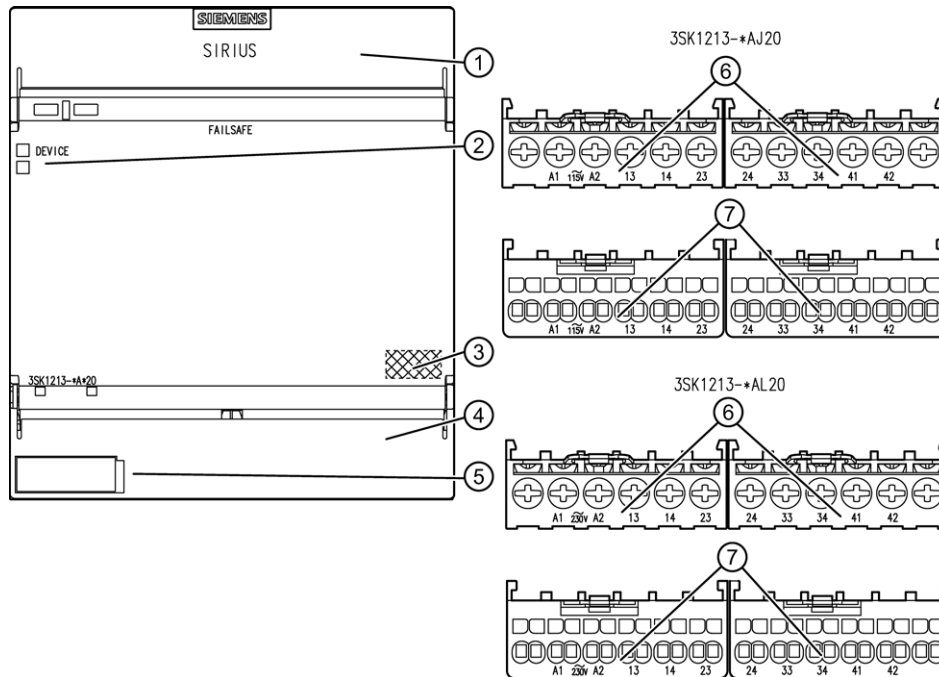

- ① Top cover flap
- ② Display LEDs
- ③ DataMatrix code
- ④ Bottom cover flap
- ⑤ Device identification label
- ⑥ Screw-type terminals
- ⑦ Spring-loaded terminals

5.3.6.4 Terminal assignment

Terminal	Description
A1	+
A2	-
13 - 14	Enabling circuit 1 (NO, relay contact)
23 - 24	Enabling circuit 2 (NO, relay contact)
33 - 34	Enabling circuit 3 (NO, relay contact)
41 - 42	NC circuit as feedback contact (NC, relay contact)

5.3.7 3RM1 Failsafe motor starters

3RM1 Failsafe motor starters can be used wherever combinations of contactors and overload relays were previously used.

3RM1 Failsafe motor starters are used in the following areas, for example:

- Conveyor technology
- Logistics systems
- Production machines
- Machine tools
- Small elevators

Thanks to the additional functionality of safety-related shutdown, the 3RM11 Failsafe and 3RM13 Failsafe motor starter variants are ideally suited to safety-related applications in the 3SK1 system up to SILCL 3 in accordance with IEC 62061 and PL e/Cat. 4 in accordance with ISO 13849-1.

The maximum achievable Performance Level PL/Cat. in accordance with ISO 13849-1, SILCL in accordance with IEC 62061, SIL in accordance with IEC 61508 corresponds to the Performance Level PL and SIL of the 3SK1 basic unit when the external wiring (connection between basic unit and output expansion) is configured as fail-safe (e.g. basic unit and 3RM1 Failsafe motor starter are connected using 3ZY12 device connector).

3RM1 Failsafe motor starters can be controlled via the supply voltage (A1/A2) or via 3ZY12 device connectors (24 V DC variant only).

Note

If expansion units are controlled via the 3ZY12 device connector, additional feeding of the control supply voltage (A1/A2) at one of the output expansions leads to a fault in the system configuration.

Note

In the configuration with a 3SK1 Advanced basic unit on a 3ZY12 device connector, 3RM1 Failsafe motor starters can only be controlled by the instantaneous enable signal of the 3SK1 unit. If control of the 3RM1 Failsafe motor starter by means of the time-delayed output is desired, this can only be done by wiring the time-delayed enabling circuit of the 3SK1 basic unit.

More detailed technical information is available in the SIRIUS 3RM1 motor starters (<http://support.automation.siemens.com/WW/view/en/66295730>) manual on the Internet.

5.4 3SK1 input expansions

5.4.1 Input expansion 3SK1220

5.4.1.1 Device features

Article number (MLFB):

3SK1220-xAB40	24 V DC
---------------	---------

(x) 1 = screw-type terminal; 2 = push-in terminal

Device properties:

- 4-way DIP switch for function setting (parameterization)
- NO contact/NC contact evaluation via external jumper
- SET/RESET button
- 4 LEDs for status and function display
- 1 input (ON button circuit)
- 2 test outputs
- Enclosure width 17.5 mm
- Removable terminals
- Mounting exclusively on 3ZY12 device connectors

5.4.1.2 Applications


The number of sensor inputs for a basic unit can be expanded using input expansions. Input expansions must always be mounted to the left of a basic unit.

The input expansion 3SK1220 is certified to SIL 3/PL e.

The SILCL/PL achieved by the overall system depends on the external connection of sensors and actuators.

The input expansion 3SK1220 is supplied via the 3ZY12 device connectors.

5.4.1.3 Design

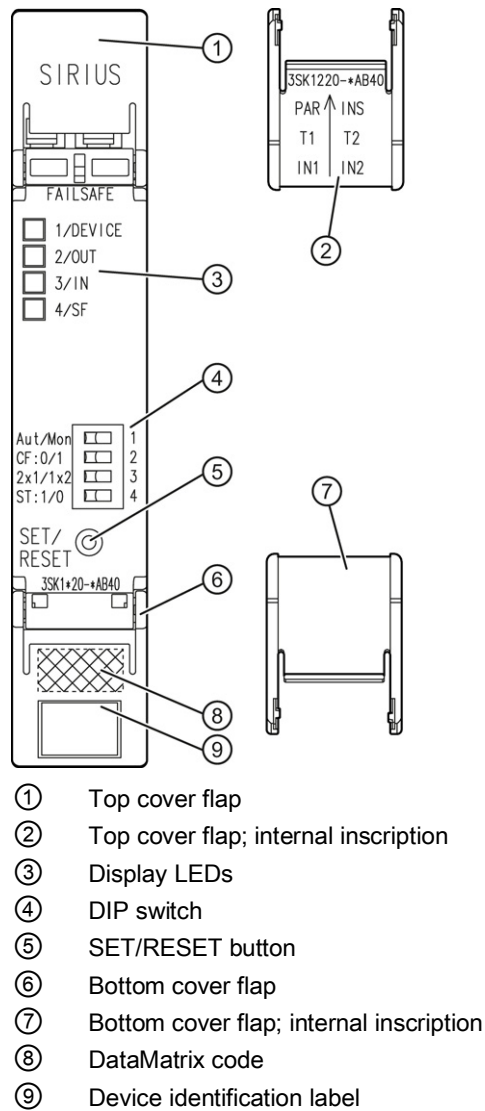

5.4.1.4 Terminal assignment

Terminal	Explanation
IN1	Sensor channel 1
IN2	Sensor channel 2
PAR	NO contact/NC contact evaluation
INS	ON button circuit
T1	Test output 1 (for IN1, PAR)
T2	Test output 2 (for IN2, INF)

5.4.1.5 Display of the operating state

You can find additional information on this under "Advanced" in the Chapter Function description (Page 63).


5.4.1.6 Function setting

DIP switch settings


You can find additional information on this under "Advanced" in the Chapter Functions (Page 64).

State diagrams 3SK1220

3SK1220 Autostart

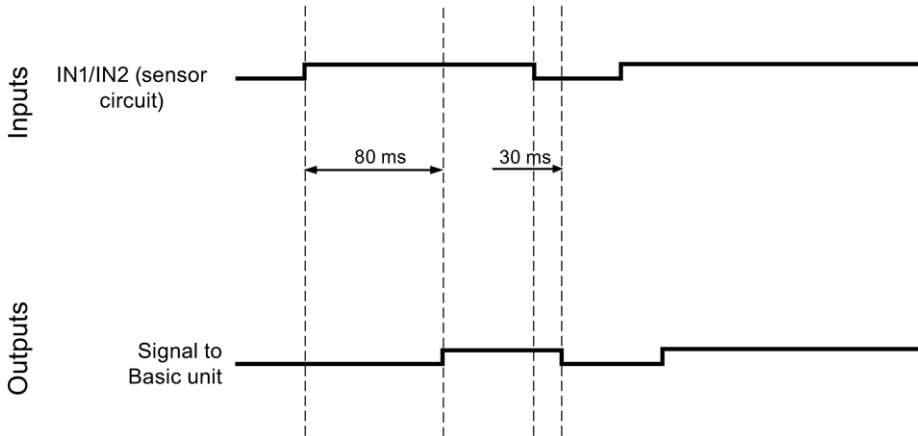

3SK1220 Monitored start

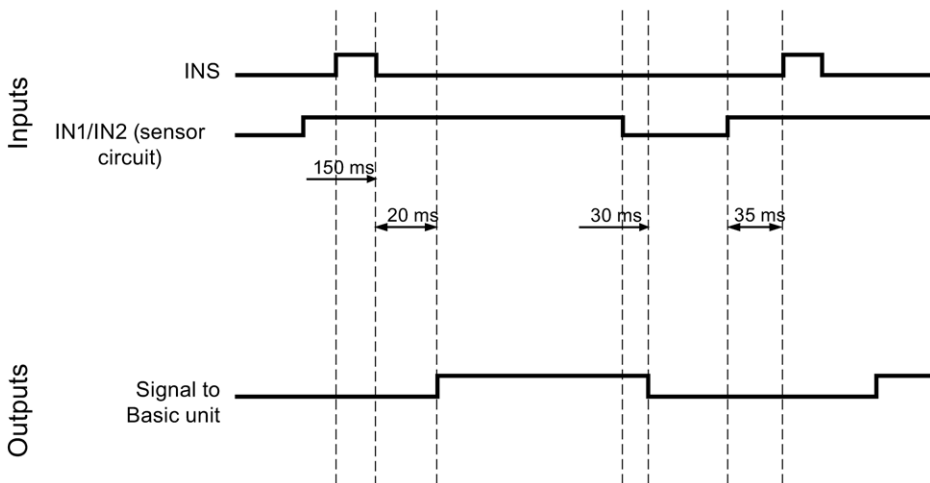

5.4.2 Power supply 3SK1230

5.4.2.1 Device features

Article number (MLFB):

3SK1230-xAW20	110 ... 240 V AC/DC
---------------	---------------------

(x) 1 = screw-type terminal; 2 = push-in terminal

Device properties:

- Wide-range input: 110 ... 240 V AC/DC
- Rated output voltage: 24 V DC
- Rated output current: 0.6 A
- 1 LED for status display
- Connection interface
- Enclosure width 22.5 mm
- Removable terminals

Note

Due to the output current of the 3SK1230 power supply (= 0.6 A), the use of 3SK1 basic units with solid-state **outputs** is only possible to a limited extent. The output current of all semiconductor outputs can be **up to 0.4 A** here (depending on the system configuration).

5.4.2.2 Applications


The 3SK1230 power supply generates a stabilized output voltage of 24 V DC from 110 ... 240 V AC/DC. The 3SK1230 power supply can supply the 3SK1 Advanced device series with 24 V DC via 3ZY12 device connectors or via the +/- output terminals.

The "INS" START pushbutton input of the 3SK1 device series must be supplied from the 3SK1230 power supply.

NOTICE

Two power supplies in parallel are not permissible! Only one 3SK1230 power supply is permitted in each system configuration.
--

5.4.2.3 Design

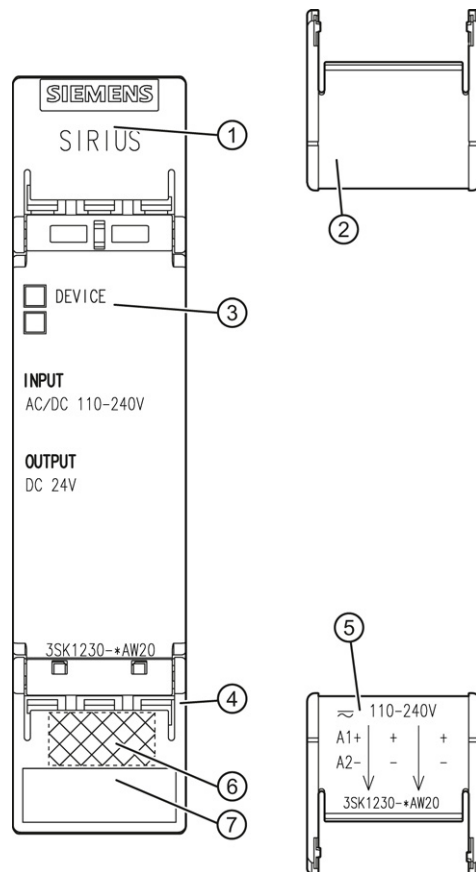

- ① Top cover flap
- ② Top cover flap; internal inscription
- ③ Display LEDs
- ④ Bottom cover flap
- ⑤ Bottom cover flap; internal inscription
- ⑥ DataMatrix code
- ⑦ Device identification label

5.4.2.4 Terminal assignment

Terminal	Explanation
A1	L+
A2	N-
+	+24 V DC
+	+24 V DC
-	- Mass
-	- Mass

5.4.2.5 Display of the operating state

Display of the operating state

The operating state and functioning of the device are indicated by an LED:

- (1) DEVICE

Operating states

LED	State	Meaning
DEVICE	Green	Output voltage OK
	Flashing	Overload
	OFF	No voltage

System configuration

6.1 General information

6.1.1 General notes on the Standard system

- Expanding enabling circuits using external wiring.
- Output expansions must be activated via a safe enabling circuit/output of the basic unit.
- The NC circuit (51/52 for 3SK1211; 41/42 for 3SK1213) of the output expansion must be looped into the feedback circuit (T2/INF) of the basic unit.

6.1.2 General information on the Advanced system

- Expansion of the enabling circuits of 3SK1 Advanced basic units by means of external wiring is always possible.
- Expandable using 3ZY12 device connectors on both the input and output sides.
- The output expansions are activated and the feedback circuit is evaluated via the connection interface. Therefore, external wiring of the output expansions in the feedback circuit is not necessary.
- When using the Advanced device series with output expansion on the device connector described, all enabling and signaling circuits of the basic unit and output expansion can be used as required.
- The input expansions, as well as the output expansions mounted on the 3ZY12 device connector, are supplied with voltage via the 3ZY12 device connector. The supply voltage is only connected once on the basic unit (24 V DC) or the 3SK1230 power supply (110 ... 240 V AC/DC).
- Motor feeders up to 3 kW (400 V) can be implemented quickly and easily using 3RM1 Failsafe motor starters. The motor starters can be easily connected as output expansions in the 3SK1 system.

Note

In the configuration with a 3SK1 Advanced basic unit on a 3ZY12 device connector, 3RM1 Failsafe motor starters can only be controlled by the instantaneous enable signal of the 3SK1 unit. If control of the 3RM1 Failsafe motor starter by means of the time-delayed output is desired, this can only be done by wiring the time-delayed enabling circuit of the 3SK1 basic unit.

6.1.3 Maximum system configuration


Changes to the system configuration

Changes to the system configuration in safety mode always result in a device error. Restarting, by disconnecting and reconnecting the operating voltage (Power OFF/ON), is a mandatory requirement.


Maximum system configuration when supplying with 24 V DC on the basic unit

⚠ WARNING
Only one 3SK1 basic unit is permitted per system
The safety function is not guaranteed when more than one basic unit is used.

Connection of 24 V DC to the basic unit:
up to 5 expansions are permitted to the left of the basic unit and 5 expansions are permitted on the right.

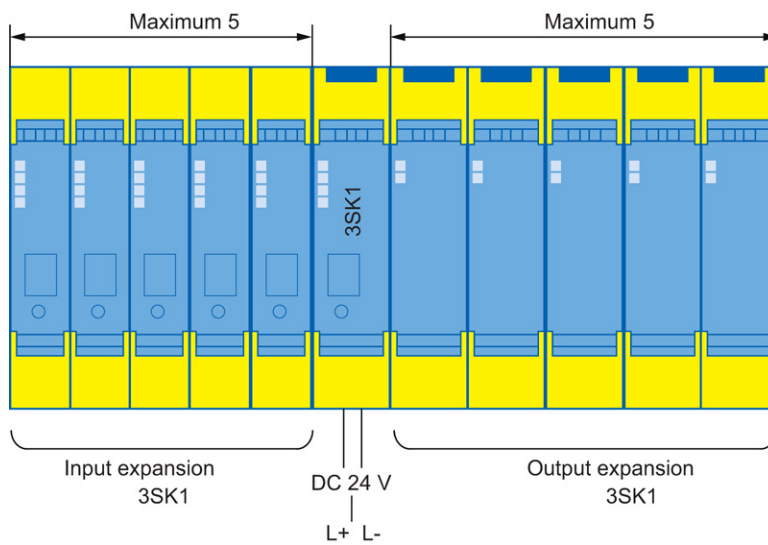

Example of a configuration with connection of 24 V DC on the basic unit and 3RM1 Failsafe motor starter

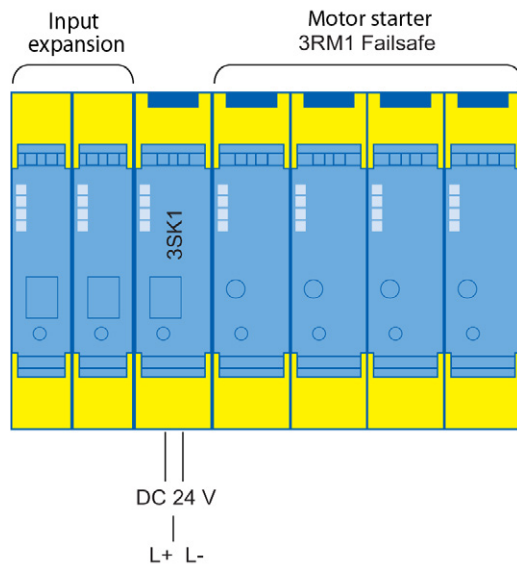

Maximum system configuration when supplying with 24 V DC using the 3SK1230 power supply

When using the 3SK1230 power supply, the maximum system configuration can be calculated as follows:

Up to 10 "system units" can be connected to a 3SK1230 power supply.
Individual devices occupy a different number of system units.


Note

With this configuration too, up to 5 expansions are permitted to the left of the basic unit and 5 expansions are permitted on the right.

Device	System unit
3SK1220 input expansion	1
3SK1230 power supply	0
3SK112 basic units	0
3SK1211 output expansion	2
3SK1213 output expansion	2
3RM1 Failsafe motor starters	4


Example 1)

1 x 3SK1230 power supply; 5 x 3SK1220 input expansion; 1 x 3SK112 basic unit;
2 x 3SK1211 output expansion

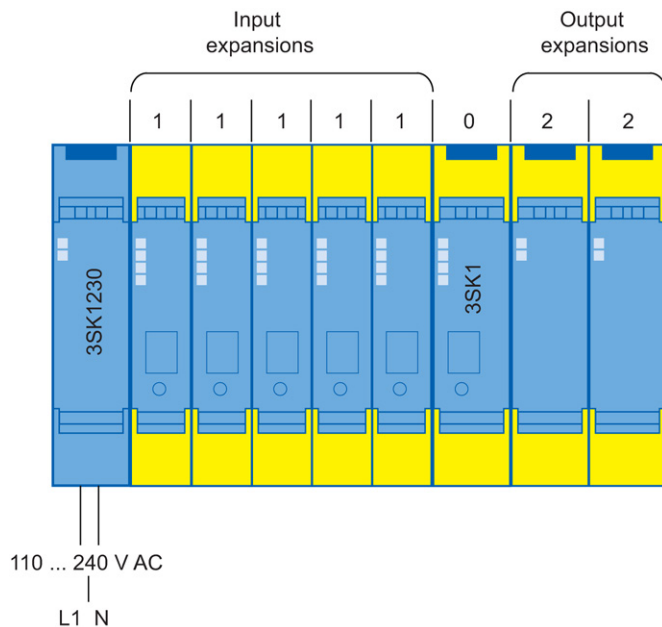


Example 2)

1 x 3SK1230 power supply; 5 x 3SK1220 input expansion; 1 x 3SK112 basic unit;
1 x 3RM1 Failsafe motor starter

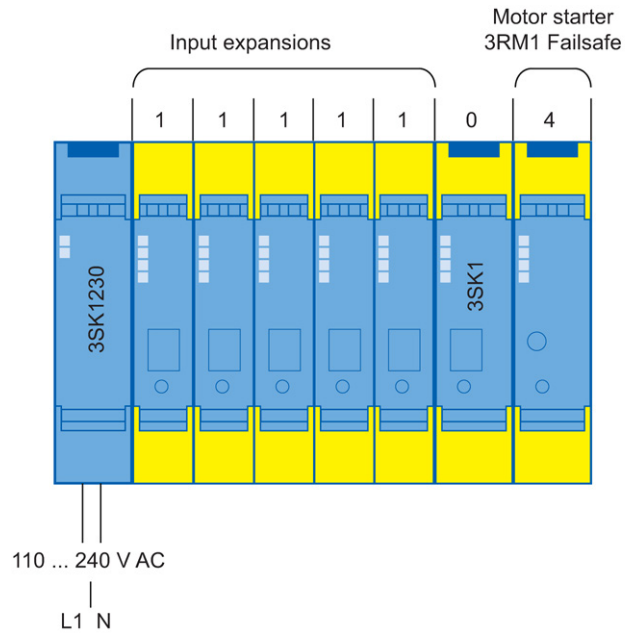

Example 3)

1 x 3SK1230 power supply; 2 x 3SK1220 input expansion; 1 x 3SK112 basic unit;
2 x 3RM1 Failsafe motor starter

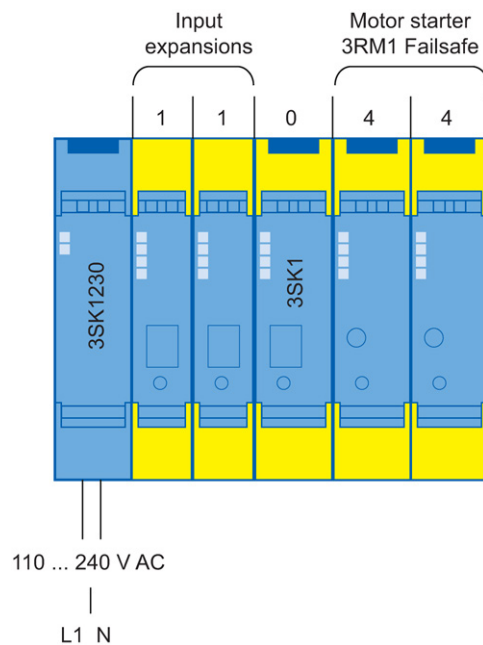

6.2 3ZY12 device connector

6.2.1 Device features

Article number:

Article number	Type of device connector
3ZY1212-1BA00	Device connector for 3SK1 safety relay, 17.5 mm wide
3ZY1212-2BA00	Device connector for 3SK1 safety relay, 22.5 mm wide
3ZY1212-2EA00	Device connector for 3RM1 motor starters, 22.5 mm wide
3ZY1212-2FA00	Device termination connector for 3RM1 motor starters, 22.5 mm wide
3ZY1212-2DA00	Device termination connector for 3SK1 safety relay, 22.5 mm wide
3ZY1212-0FA01	Device termination connector set for 3SK1 safety relay, > 45 mm wide (set consists of 3ZY1212-2EA00 device connector and 3ZY1210-2AA00 device connector)
3ZY1212-2AB00	Device connector for looping through signals, 22.5 mm wide
3ZY1210-2AA00	Device connector without a function, 22.5 mm wide

Use of device connectors

- A device connector is always necessary when other devices have to be plugged in.
- A device termination connector is always required in the system for the last module on the right.

Note

Use of the device connectors to expand the Advanced basic units is optional.

The device connectors cannot be used with the Standard series.

Note

Only safety relays with a supply voltage of **24 V DC** may be used on the 3ZY12 device connectors.

Note

If expansion units are controlled via the 3ZY12 device connector, additional feeding of the control supply voltage (A1/A2) at one of the output expansions leads to a fault in the system configuration.

The following device connectors are required for the various enclosure widths of the Advanced device series:

Devices	Device connector for 3SK1 safety relay 17.5 mm 3ZY1212-1BA00	Device connector for 3SK1 safety relay 22.5 mm 3ZY1212-2BA00	Device termination connector for 3SK1 safety relay 22.5 mm 3ZY1212-2DA00
3SK1 Advanced basic units			
3SK1121	-	x	x
3SK1122	-	x	x
3SK1120	x	-	-
Output expansions 3SK1			
3SK1211 (4RO)	-	x	x
3SK1213 (3RO)	-	-	-
Input expansions 3SK1			
3SK1220	x	-	-
3SK1230 power supply	-	x	-
3RM1 Failsafe motor starters			
3RM1	-	-	-

Devices	Device connectors for 3RM1 motor starter 22.5 mm 3ZY1212-2EA00	Device termination connectors for 3RM1 motor starter 22.5 mm 3ZY1212-2FA00	Device termination connector, set for enclosures > 45 mm ¹⁾ 3ZY1212-0FA01	Device connector for looping through signals 22.5 mm 3ZY1212-2AB00
3SK1 Advanced basic units				
3SK1121	-	-	-	-
3SK1122	-	-	-	-
3SK1120	-	-	-	-
Output expansions 3SK1				
3SK1211 (4RO)	-	-	-	-
3SK1213 (3RO)	-	-	x	-
Input expansions 3SK1				
3SK1220	-	-	-	-
3SK1230 power supply	-	-	-	-
3RM1 Failsafe motor starters				
3RM1	x	x	-	x

¹⁾ Set consists of 3ZY1212-2EA00 device connector and 3ZY1210-2AA00 device connector

Note

If a basic unit is expanded on the right, the last output expansion must be terminated with a device termination connector of the corresponding device.

If a basic unit is only expanded on the left, a device termination connector for 3SK1 safety relays must be mounted below the basic unit.

6.2.2 Applications

The 3SK1 Advanced basic unit can be expanded on the input and output sides using 3ZY12 device connectors (connecting plugs) without any additional wiring outlay. When configuring the system, it is important to ensure that input expansions are connected on the left and output expansions/3RM1 Failsafe motor starters on the right of a basic unit.

6.3 System configuration rules

General information

- If a basic unit is operated as a stand-alone device, no device connector or device termination connector is necessary.
- 3SK1220 input expansions and the 3SK1230 power supply must always be connected on the left of the basic unit and output expansions (3SK121 and 3RM1 Failsafe motor starters) on the right.

Expansion on the input side

- The 3SK1230 power supply must always be plugged into the system on the extreme left.
- No more than one 3SK1230 power supply is admissible for each system.
- If a 3SK1230 power supply is used, **no** additional, external 24 V DC voltage is permitted to be connected to a basic unit.
- If an (additional) input expansion is detected on the left when the basic device or an input expansion powers up, it will be loaded into the device configuration.
- An input expansion evaluates the sensor states and generates an enable signal for the basic unit depending on the start condition. The enable signal is then acquired by an input expansion on the right-hand side, or acquired by the basic unit and ANDed with its sensor statuses.
- The 3ZY12 device connector used below the final device must be fitted with a cover on the left side (included with the device termination connectors).

Output expansion

- If an output expansion is detected on the right when the device powers up, this will be loaded into the device configuration. The internal feedback circuit of the contact extension is evaluated and checked.
- If both 3SK1211 and 3RM1 Failsafe motor starters are used in one system, the 3RM1 Failsafe motor starters must be placed on the right of the 3SK1211 devices.
- If a 3SK1213 output expansion is used in the system, this must always be the final station in the system (on the right) and must be fitted with a 3ZY1212-0FA01 device termination connector. Only one 3SK1213 output expansion can be used in the system with a device connector; further 3SK1213 output expansions can be optionally interfaced by wiring.
- On the 3SK121 output expansions, a slide switch on the device front must be used to set whether the UNDELAYED, or DELAYED output signal of the basic unit is to trigger a response. If a purely instantaneous 3SK112 basic unit is used, the slide switch MUST be set to the "UNDELAYED" position.
- In the case of a change to the device configuration during operation, error mode is activated immediately. Restarting must be triggered via Power OFF/ON.
- If output expansions are used, a device termination connector for the 3SK1 safety relay must ALWAYS be used under the final device on the right (for 3SK1211) with the switch setting: "1" (switch in top position), device termination connector set for 3SK1 safety relay, > 45 mm wide (for 3SK1213) or device termination connector for 3RM1 motor starters must be used.
- 22.5 mm device termination connector for 3SK1 safety relays:
 - Below basic unit: the switch of the device termination connector must be open, i.e. in position 2 at the bottom.
 - Below 3SK1211 output expansion: the switch of the device termination connector must be closed, i.e. in position 1 at top
- No switch needs to be set on the device termination connector for 3RM1 motor starters
- As from certain load limits/temperature ranges, clearances must be observed for 3RM1 Failsafe motor starters. To this end, there are appropriate device connectors for looping through signals (3ZY1212-2AB00).
- In the configuration with a 3SK1 Advanced basic unit on a 3ZY12 device connector, 3RM1 Failsafe motor starters can only be controlled by the instantaneous enable signal of the 3SK1 unit. If control of the 3RM1 Failsafe motor starter by means of the time-delayed output is desired, this can only be done by wiring the time-delayed enabling circuit of the 3SK1 basic unit.


You will find further information on the configuration guidelines for 3RM1 Failsafe motor starters in the SIRIUS 3RM1 motor starters (<http://support.automation.siemens.com/WW/view/en/66295730>) manual, in the section entitled "Load feeders - protection against short circuit".

Configuration notes for using device connectors

3ZY12 device connectors can only be used with devices of the Advanced device series.

Further configuration notes:

NOTICE
Only one 3SK1 Advanced basic unit is permitted in each system
The safety function is not guaranteed when more than one basic unit is used.

 WARNING
Supply voltage must only be fed in on the basic unit
The supply voltage of 24 V DC must only be fed in on the basic unit, otherwise the safety function is bypassed.

Note

If expansion units are controlled via the 3ZY12 device connector, additional feeding of the control supply voltage (A1/A2) at one of the output expansions leads to a fault in the system configuration.

Power supply by means of the 3SK1230 power supply

- When device connectors are used, only one 3SK1230 power supply is permitted in each system.
- The 3SK1230 power supply must always be located on the extreme left.
- If a 3SK1230 power supply is used, an additional (external) 24 V DC connection is not permitted (this also applies to the cascading input, as well as to non-floating sensors).

24 V DC supply voltage from an external power supply unit


- It is only permitted to connect a voltage of 24 V DC to the terminals on the basic unit.
- It is not permitted to supply 24 V DC to an expansion component or 3RM1 Failsafe motor starter.

Circuit diagrams


7.1 Internal circuit diagrams

7.1.1 Internal circuit diagrams for 3SK1 Standard basic units


Basic unit 3SK1111-.AB30 Standard relay instantaneous (24 V)

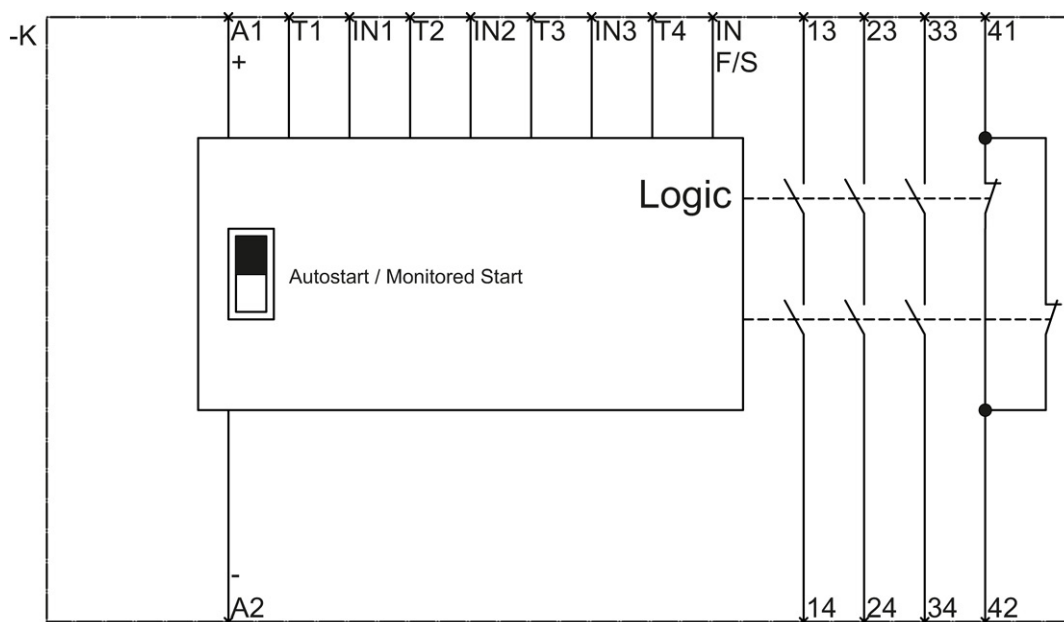

Basic unit 3SK1111-.AW20 Standard relay instantaneous (110 - 240 V)

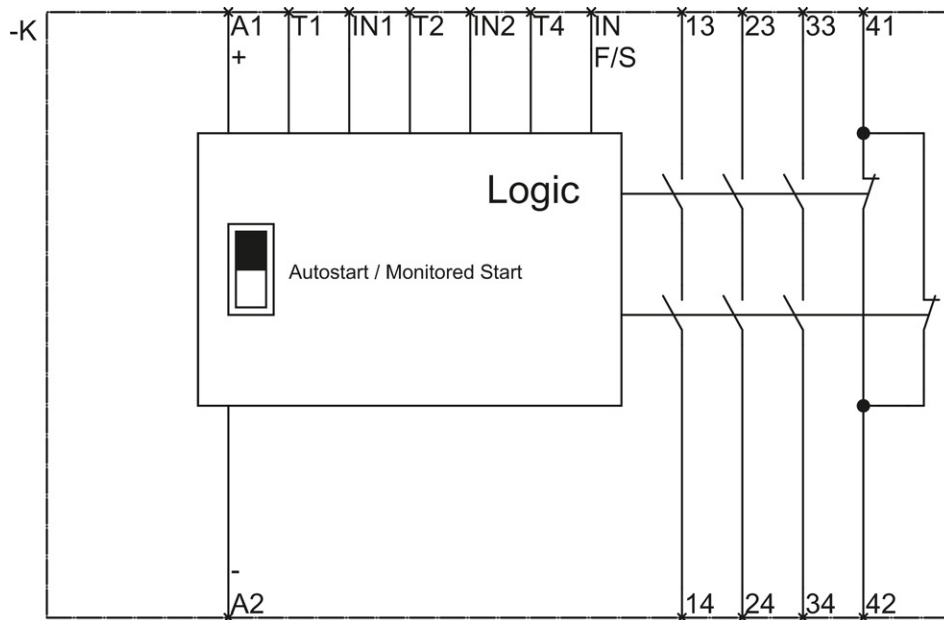


Basic unit 3SK1112-.BB40 Standard solid-state

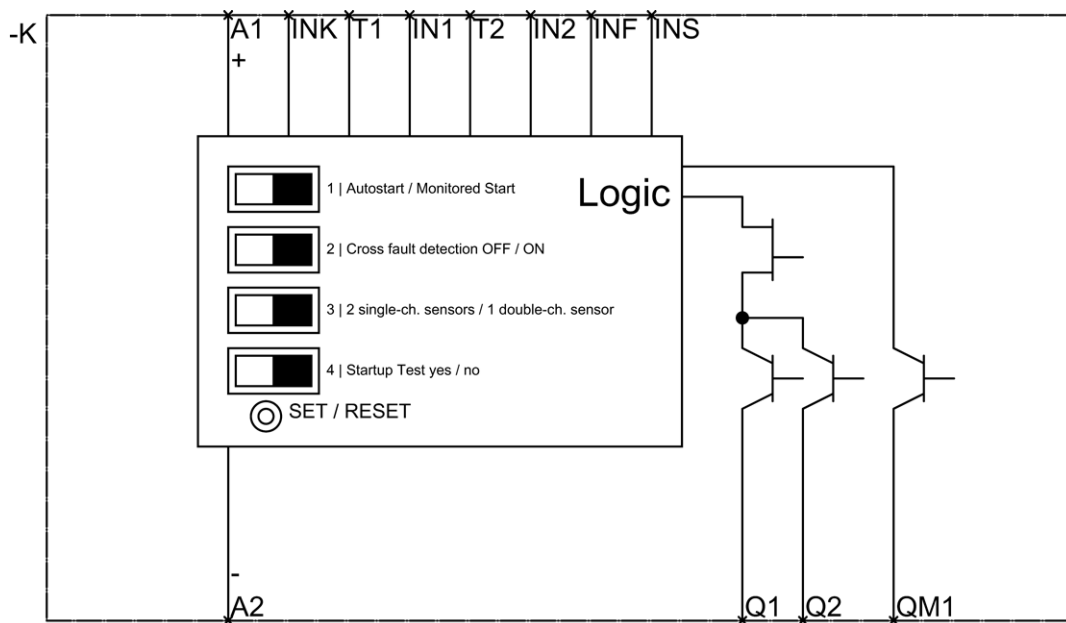


7.1.2 Internal circuit diagrams for 3SK1 Advanced basic units


Basic unit 3SK1121-.AB40 Advanced relay instantaneous

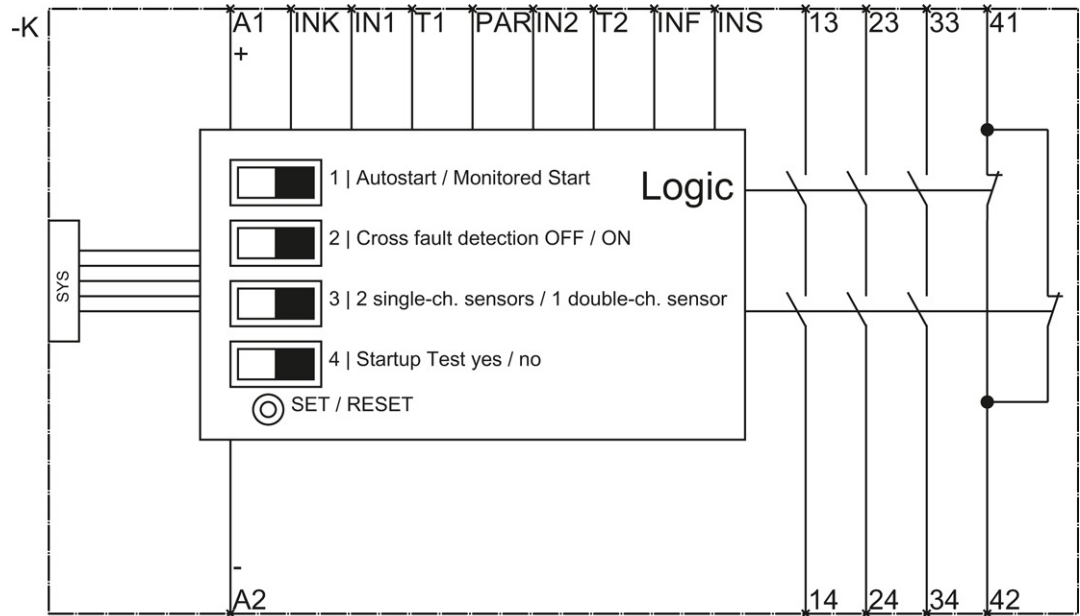


Basic unit 3SK1121-.CB4. Advanced relay time-delayed

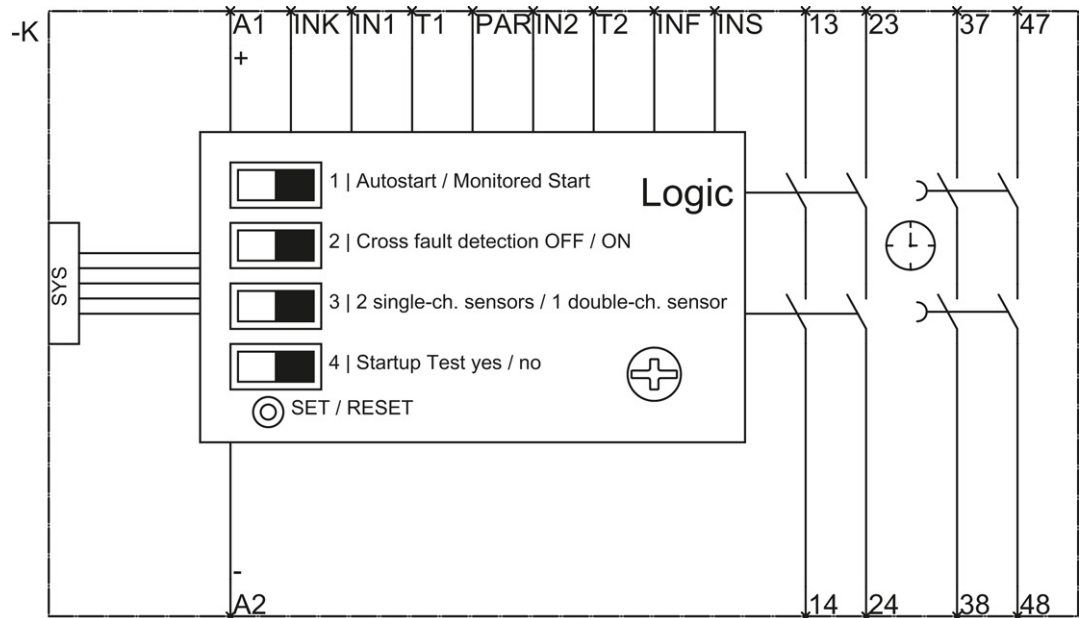


Basic unit 3SK1122-.AB40 Advanced solid-state instantaneous

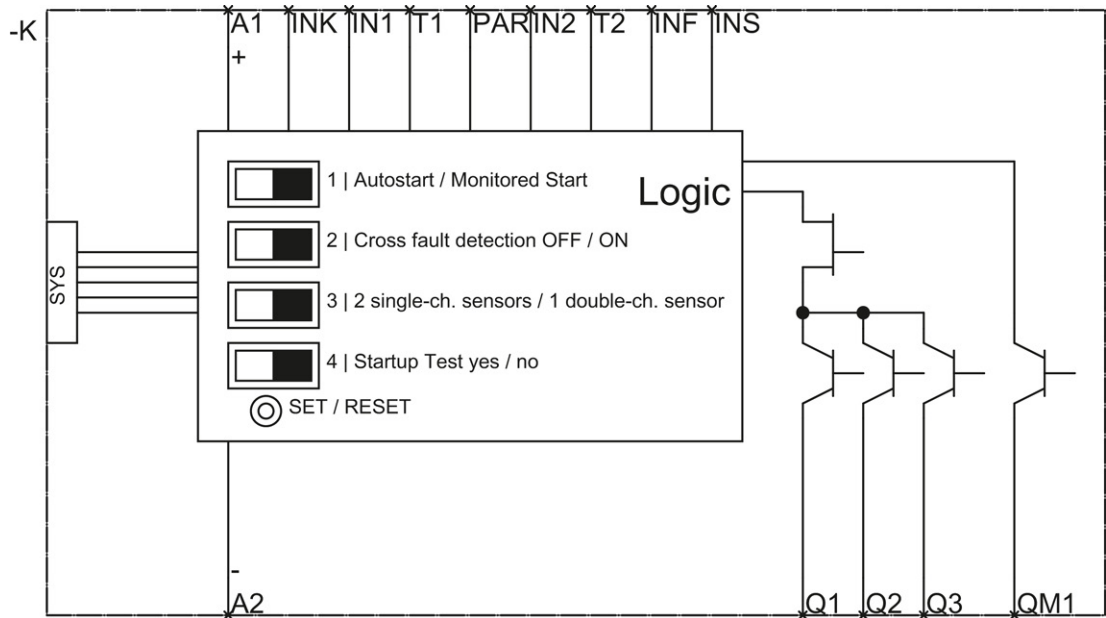

Basic unit 3SK1122-.CB4. Advanced solid-state time-delayed

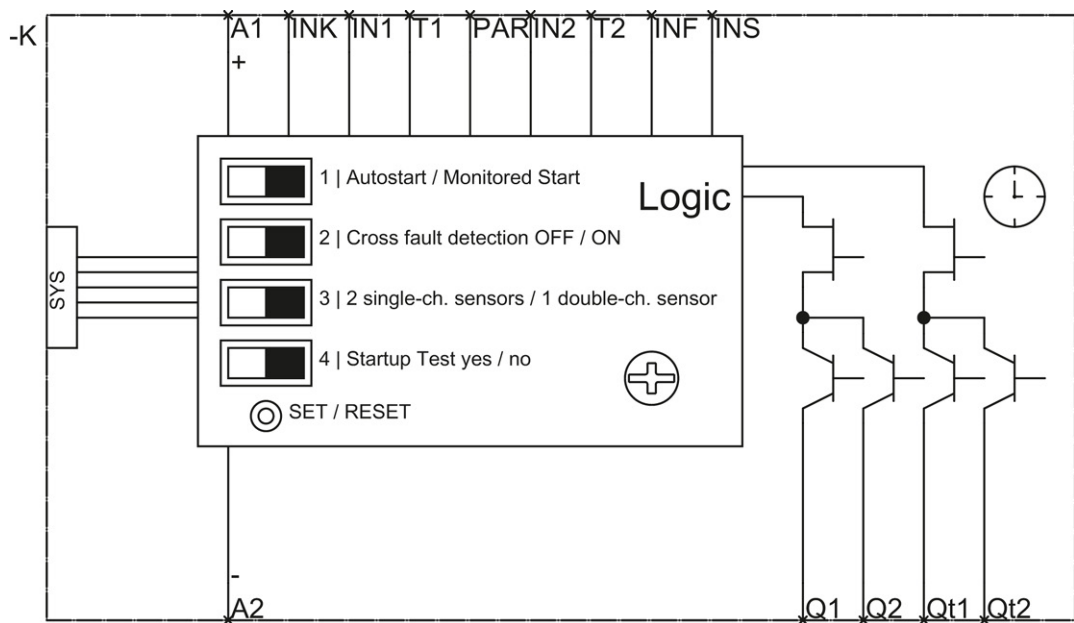


Basic unit 3SK1120-.AB40 Advanced 17.5 mm solid-state instantaneous

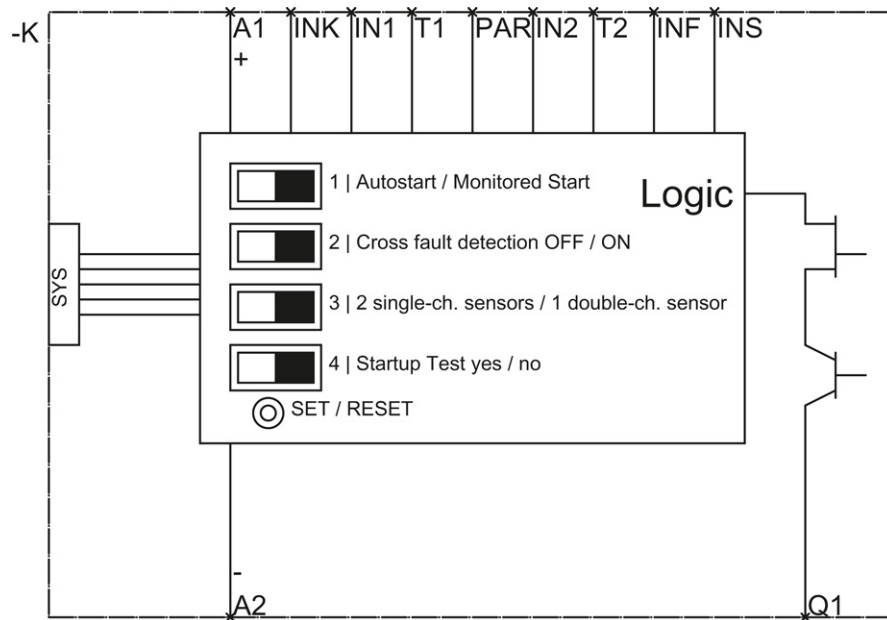


7.1.3 Internal circuit diagrams for expansion units


3SK1211 output expansion (110 - 240 V)

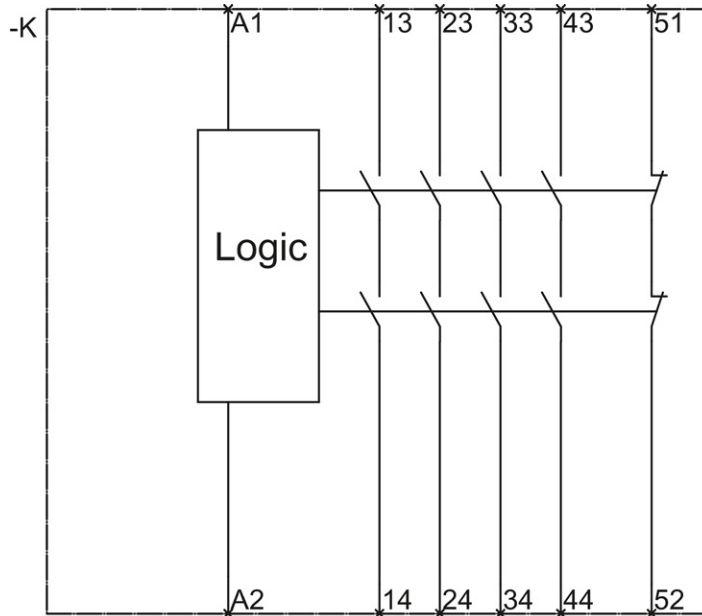


3SK1211 output expansion (24 V DC)

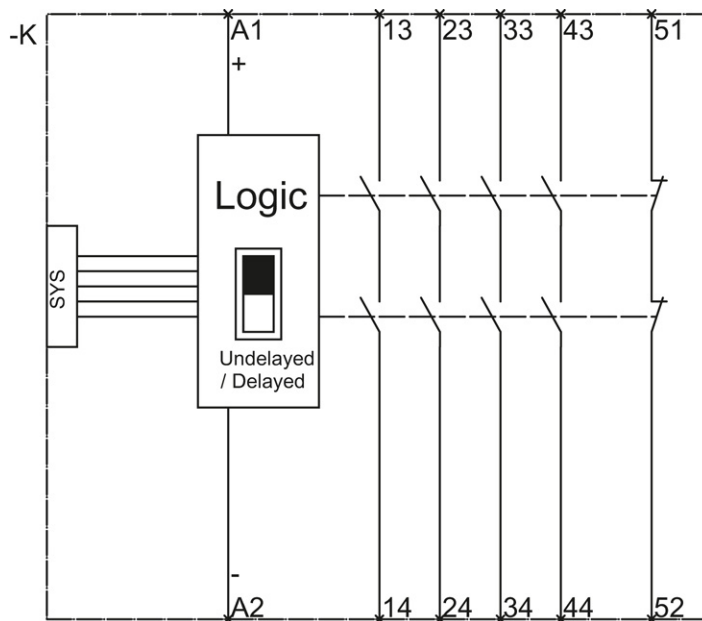


3SK1213-.A.20 output expansion (110 - 240 V)

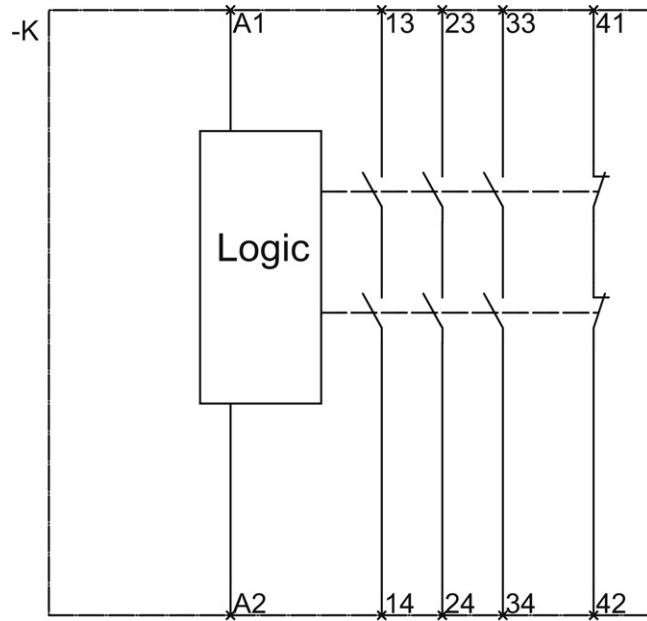


3SK1213-.AB40 output expansion (24 V DC)

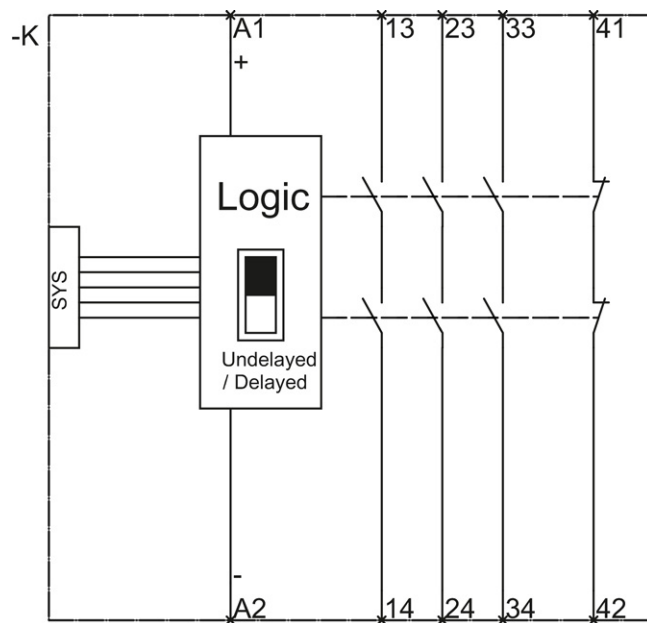

3SK1220 input expansion

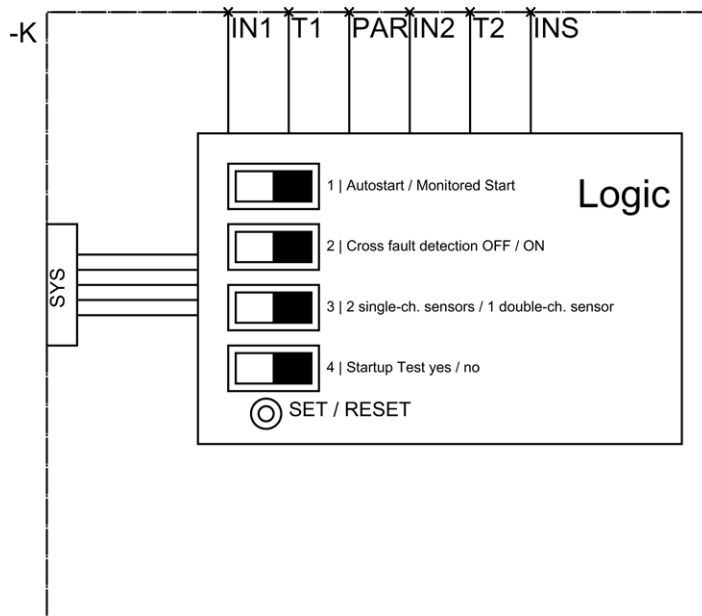


3SK1230 power supply

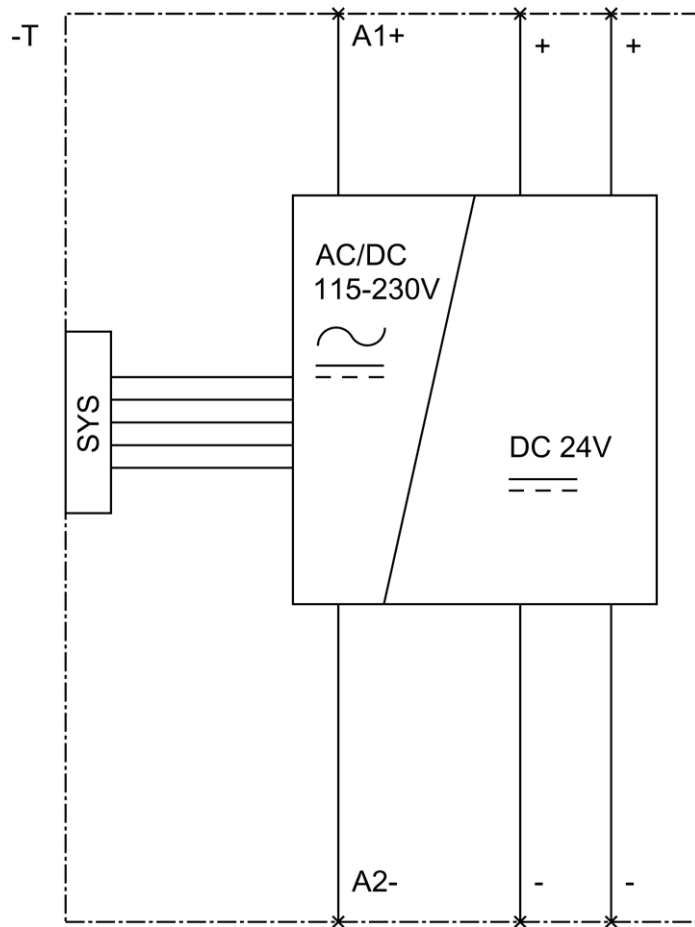

7.2 Typical circuits

7.2.1 Typical circuits

The black fields show the positions of the switches. Here, "Autostart" in each case.

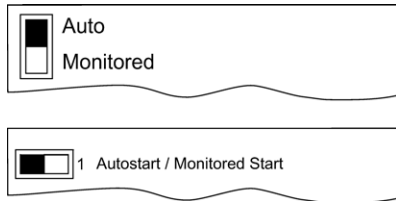

Typical circuits for 3SK1111 Standard basic unit relays

Table 7- 1 Typical circuit 1:
Single-channel, with monitored start

	<ul style="list-style-type: none"> • Monitored start • 3SK1111 Standard relay • Sensor: 1 NC contact 	
	Slide switch	
	Auto	Monitored
	—	ON bottom
	Up to PL in accordance with ISO 13849-1	c
Up to Safety Integrity Level (SILCL) to IEC 62061	1	

Table 7- 2 Typical circuit 2:
Single-channel, with monitored start

	<ul style="list-style-type: none"> • Monitored start • 3SK1111 Standard relay • Sensor: 1 NC contact 	
	Slide switch	
	Auto	Monitored
	—	ON bottom
	Up to PL in accordance with ISO 13849-1	c
Up to Safety Integrity Level (SILCL) to IEC 62061	1	

Table 7- 3 Typical circuit 3:
single-channel, with autostart

<p>* For 3SK1111-.AB30 basic unit only</p>	<ul style="list-style-type: none"> • Autostart • 3SK1111 Standard relay • Sensor: 1 NC contact 	
	Slide switch	
	Auto	Monitored
	ON top	—
	Up to PL in accordance with ISO 13849-1	c
Up to Safety Integrity Level (SILCL) to IEC 62061	1	

Table 7- 4 Typical circuit 4:
single-channel, with autostart

	<ul style="list-style-type: none"> Autostart 3SK1111 Standard relay Sensor: 1 NC contact 	
	Slide switch	
	Auto	Monitored
	ON top	—
	Up to PL in accordance with ISO 13849-1	c
Up to Safety Integrity Level (SILCL) to IEC 62061		1

Table 7- 5 Typical circuit 5:
2-channel EMERGENCY STOP, with cross-circuit detection, with monitored start

	<ul style="list-style-type: none"> Monitored start With cross-circuit detection Sensor: 2 NC contacts 3SK1111 Standard relay 	
	Slide switch	
	Auto	Monitored
	—	ON bottom
	Up to PL in accordance with ISO 13849-1	e
Up to Safety Integrity Level (SILCL) to IEC 62061		3

* For 3SK1111-.AB30 basic unit only

7.2 Typical circuits

Table 7- 6 Typical circuit 6:
Two-channel, with cross-circuit detection, with autostart

The diagram shows a safety relay with terminals A1 (+), A2 (-), T1, IN1, T2, IN2, T3, IN3, T4, and IN F/S. A slide switch selects between 'Auto' (black) and 'Monitored' (white) modes. Two normally closed (NC) contacts, Q1 and Qn, are connected to the relay. A motor (M) is connected to the output. A note indicates: '* For 3SK1111-.AB30 basic unit only'.

<ul style="list-style-type: none"> Autostart With cross-circuit detection Sensor: 2 NC contacts 3SK1111 Standard relay 	
Slide switch	
Auto	Monitored
ON top	—
Up to PL in accordance with ISO 13849-1	e
Up to Safety Integrity Level (SILCL) to IEC 62061	3

Table 7- 7 Typical circuit 7:
Sensors with solid-state outputs, without cross-circuit detection, with autostart

	<ul style="list-style-type: none"> • Autostart • Without cross-circuit detection • Sensor: 2-channel non-floating • 3SK1111 Standard relay 					
	Slide switch					
	<table border="1"> <thead> <tr> <th>Auto</th> <th>Monitored</th> </tr> </thead> <tbody> <tr> <td>ON top</td> <td>—</td> </tr> </tbody> </table>	Auto	Monitored	ON top	—	
	Auto	Monitored				
	ON top	—				
Up to PL in accordance with ISO 13849-1	e					
Up to Safety Integrity Level (SILCL) to IEC 62061	3					

Typical circuits for 3SK1 Standard solid-state basic units or 3SK1 Advanced basic units

Table 7- 8 Typical circuit 8: EMERGENCY STOP two-channel, with cross-circuit detection, with monitored start

	<ul style="list-style-type: none"> • Monitored start • With cross-circuit detection • 1 x two-channel • Sensor: 2 NC contacts • 3SK1112 Standard solid-state and 3SK112/3SK122 Advanced <table border="1"> <thead> <tr> <th colspan="4">DIP switch</th> </tr> <tr> <th>1</th> <th>2</th> <th>3</th> <th>4</th> </tr> </thead> <tbody> <tr> <td>ON right</td> <td>ON right</td> <td>ON right</td> <td>—</td> </tr> <tr> <td colspan="3">Up to PL in accordance with ISO 13849-1</td> <td>e</td> </tr> <tr> <td colspan="3">Up to Safety Integrity Level (SILCL) to IEC 62061</td> <td>3</td> </tr> </tbody> </table>	DIP switch				1	2	3	4	ON right	ON right	ON right	—	Up to PL in accordance with ISO 13849-1			e	Up to Safety Integrity Level (SILCL) to IEC 62061			3
DIP switch																					
1	2	3	4																		
ON right	ON right	ON right	—																		
Up to PL in accordance with ISO 13849-1			e																		
Up to Safety Integrity Level (SILCL) to IEC 62061			3																		

Table 7- 9 Typical circuit 9: Two-channel, with cross-circuit detection, with autostart

	<ul style="list-style-type: none"> • Autostart • With cross-circuit detection • 1 x two-channel • Sensor: 2 NC contacts • 3SK1112 Standard solid-state and 3SK112/3SK122 Advanced <table border="1"> <thead> <tr> <th colspan="4">DIP switch</th> </tr> <tr> <th>1</th> <th>2</th> <th>3</th> <th>4</th> </tr> </thead> <tbody> <tr> <td>OFF left</td> <td>ON right</td> <td>ON right</td> <td>—</td> </tr> <tr> <td colspan="3">Up to PL in accordance with ISO 13849-1</td> <td>e</td> </tr> <tr> <td colspan="3">Up to Safety Integrity Level (SILCL) to IEC 62061</td> <td>3</td> </tr> </tbody> </table>	DIP switch				1	2	3	4	OFF left	ON right	ON right	—	Up to PL in accordance with ISO 13849-1			e	Up to Safety Integrity Level (SILCL) to IEC 62061			3
DIP switch																					
1	2	3	4																		
OFF left	ON right	ON right	—																		
Up to PL in accordance with ISO 13849-1			e																		
Up to Safety Integrity Level (SILCL) to IEC 62061			3																		

Table 7- 10 Typical circuit 10:
Electronic sensor, 2-channel, without cross-circuit detection, with monitored start


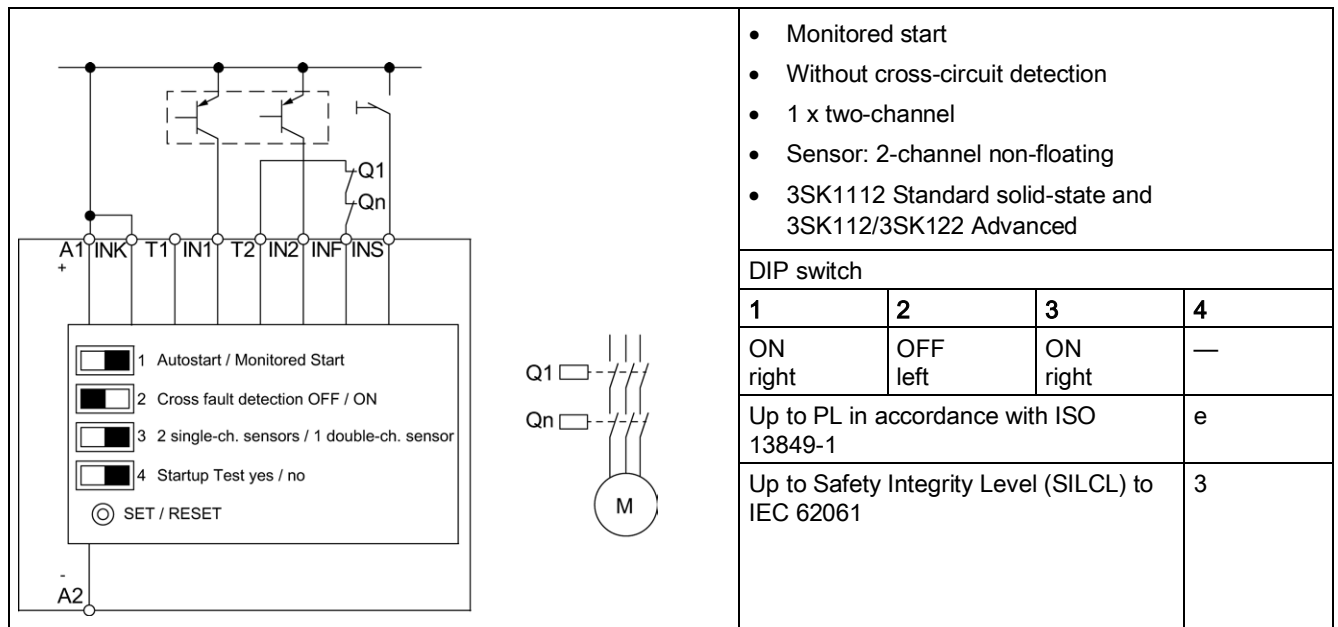


Table 7- 11 Typical circuit 11:
Electronic sensor, two-channel, without cross-circuit detection, with autostart

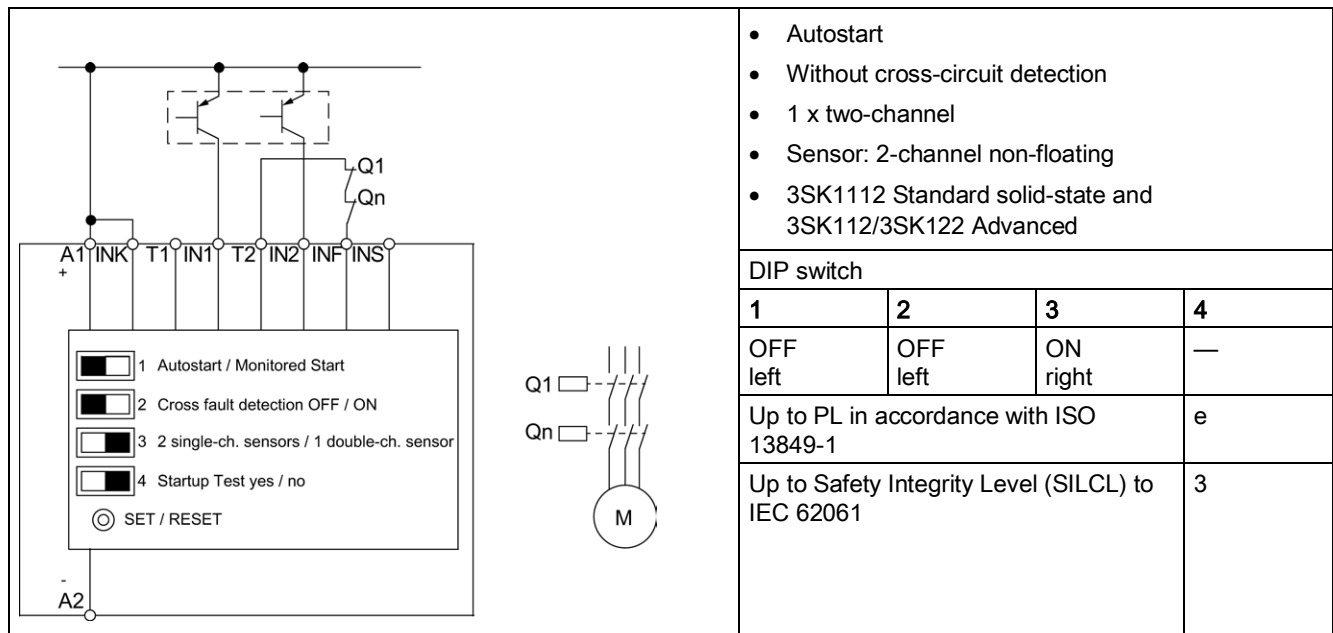

Note

Single-channel connection

If only one single-channel sensor is used, the other sensor circuit must be jumpered.

Table 7- 12 Typical circuit 12: 2 x single-channel, without cross-circuit detection, with monitored start

<p>Legend:</p> <ul style="list-style-type: none"> <input type="checkbox"/> 1 Autostart / Monitored Start <input type="checkbox"/> 2 Cross fault detection OFF / ON <input type="checkbox"/> 3 2 single-ch. sensors / 1 double-ch. sensor <input type="checkbox"/> 4 Startup Test yes / no ⊙ SET / RESET 	<ul style="list-style-type: none"> • Monitored start • Without cross-circuit detection • 2 x single-channel • Sensor: two single-channel NC sensors • 3SK1112 Standard solid-state and 3SK112/3SK122 Advanced <table border="1" data-bbox="885 520 1471 661"> <thead> <tr> <th colspan="4">DIP switch</th> </tr> <tr> <th>1</th> <th>2</th> <th>3</th> <th>4</th> </tr> </thead> <tbody> <tr> <td>ON right</td> <td>OFF left</td> <td>OFF left</td> <td>—</td> </tr> </tbody> </table> <p>Up to PL in accordance with ISO 13849-1</p> <p>Up to Safety Integrity Level (SILCL) to IEC 62061</p>	DIP switch				1	2	3	4	ON right	OFF left	OFF left	—
DIP switch													
1	2	3	4										
ON right	OFF left	OFF left	—										

Table 7- 13 Typical circuit 13: 2x single-channel, without cross-circuit detection, with autostart

<p>Legend:</p> <ul style="list-style-type: none"> <input type="checkbox"/> 1 Autostart / Monitored Start <input type="checkbox"/> 2 Cross fault detection OFF / ON <input type="checkbox"/> 3 2 single-ch. sensors / 1 double-ch. sensor <input type="checkbox"/> 4 Startup Test yes / no ⊙ SET / RESET 	<ul style="list-style-type: none"> • Autostart • Without cross-circuit detection • 2 x single-channel • Sensor: two single-channel NC contacts • 3SK1112 Standard solid-state and 3SK112/3SK122 Advanced <table border="1" data-bbox="885 1323 1471 1463"> <thead> <tr> <th colspan="4">DIP switch</th> </tr> <tr> <th>1</th> <th>2</th> <th>3</th> <th>4</th> </tr> </thead> <tbody> <tr> <td>OFF left</td> <td>OFF left</td> <td>OFF left</td> <td>—</td> </tr> </tbody> </table> <p>Up to PL in accordance with ISO 13849-1</p> <p>Up to Safety Integrity Level (SILCL) to IEC 62061</p>	DIP switch				1	2	3	4	OFF left	OFF left	OFF left	—
DIP switch													
1	2	3	4										
OFF left	OFF left	OFF left	—										

Typical circuits for 3SK1 Advanced basic units only

Table 7- 14 Typical circuit 14:
1NC/1NO sensor, with cross-circuit detection, with monitored start

- Monitored start
- With cross-circuit detection
- 1 x two-channel
- Jumper T1/PAR for NC/NO evaluation
- Sensor: NC/NO sensor
- 3SK112/3SK122 Advanced


DIP switch			
1	2	3	4
ON right	ON right	ON right	—
Up to PL in accordance with ISO 13849-1			e
Up to Safety Integrity Level (SILCL) to IEC 61508			3

Table 7- 15 Typical circuit 15:
1NC/1NO sensor, with cross-circuit detection, with autostart

- Autostart
- With cross-circuit detection
- 1 x two-channel
- Jumper T1/PAR for NC/NO evaluation
- Sensor: NC/NO sensor
- 3SK112/3SK122 Advanced

DIP switch			
1	2	3	4
OFF left	ON right	ON right	—
PL in accordance with ISO 13849-1			e
Safety Integrity Level (SILCL) to IEC 61508			3

Table 7- 16 Typical circuit 16:
Two-hand operation with cross-circuit detection, with autostart

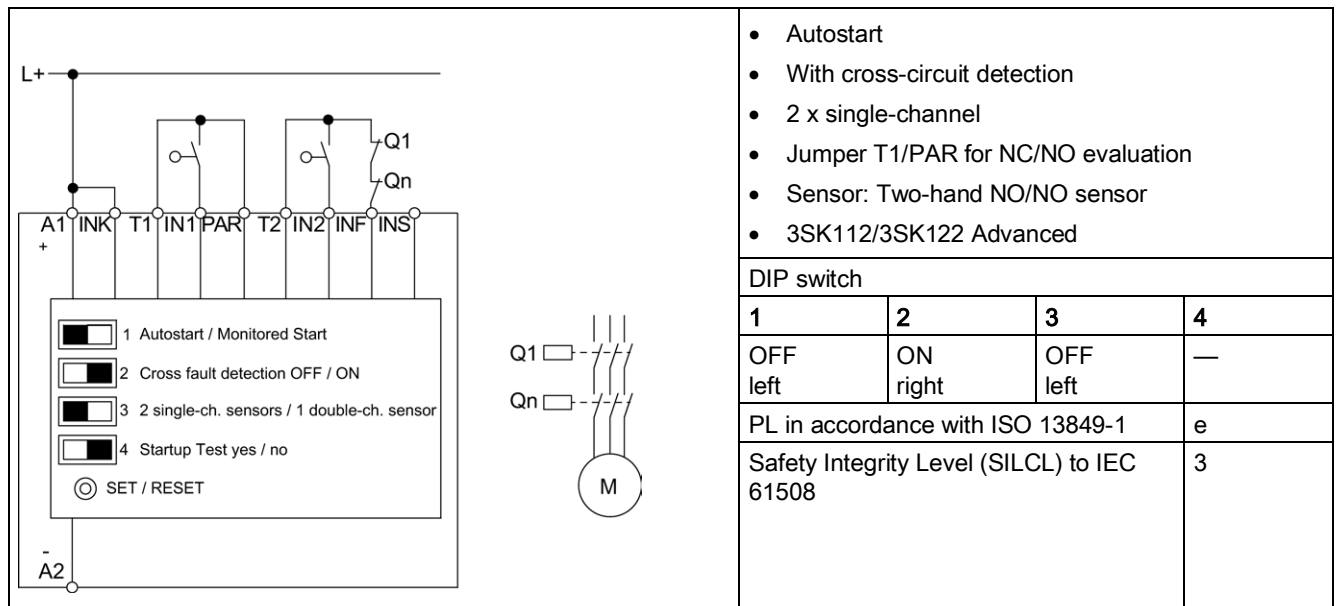

You can find further information on two-hand operation in Section Two-hand operation/synchronism (Page 40).

7.3 Typical circuits of 3SK1 safety relays with 3RM1 Failsafe motor starters

7.3.1 3SK1 safety relay with 3RM1 Failsafe motor starter via device connector

The 3RM13 Failsafe motor starter (24 V DC variant) is connected to a 3SK112 safety relay via a 3ZY12 device connector.

The two directions of rotation are switched on and off operationally via IN1 and IN2, e.g. with a PLC.

The control supply voltage (L+ and L-) to the motor starters is deactivated by the 3SK112 safety relay and the system is in a safe state.

Note

SILCL 3 in accordance with EN 62061/PL e in accordance with EN ISO 13849-1

A safety-related application up to SILCL 3 to EN 62061:2005, PL e/Cat. 4 to EN ISO 13849-1 can be realized in this way.

To achieve SILCL 3/PL e/Cat. 4 for the safety-related application, all components of the safety functions (detecting/evaluating/reacting) must be designed accordingly.


 WARNING
--

Bypassing the safety function when using device connectors

When operating with a 3SK112 safety relay and a device connector, the supply voltage for 3RM1 Failsafe motor starters is established via the device connectors.

To prevent bypassing of the safety function, do not connect anything to terminals A1 and A2 of the Failsafe 3RM1 motor starters in this case.

7.3 Typical circuits of 3SK1 safety relays with 3RM1 Failsafe motor starters

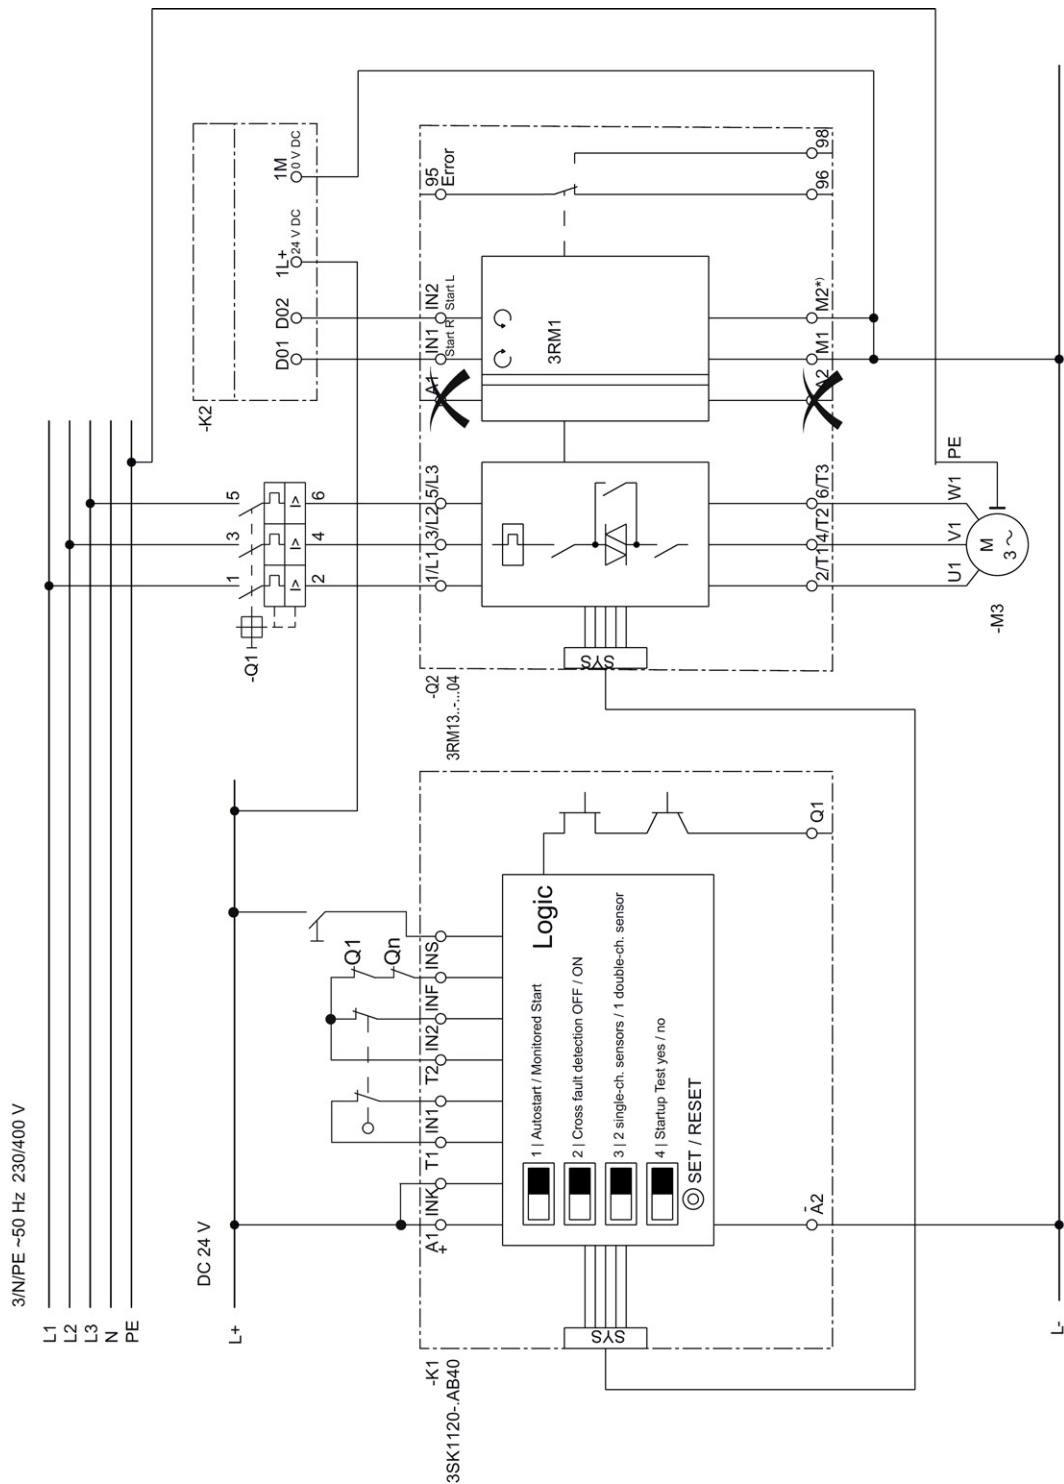

*) If there is a common reference potential for the two inputs, it suffices to establish a ground connection.
If there are separate potentials or controls, both connections must be assigned.

7.3.2 3SK1 safety relay wired with 3RM1 Failsafe motor starter

The 3RM13 Failsafe motor starter (230 V supply voltage) is connected to a 3SK1 safety relay.

The two directions of rotation are switched on and off operationally via IN1 and IN2, e.g. with separate switches.

 **WARNING**

Bypassing the safety function in the event of a fault in the case of 3RM11/3RM13 Failsafe motor starters with 110 to 230 V AC/110 V DC control supply voltage

The control signal for the control inputs in the case of 3RM11/3RM13 Failsafe motor starters with 110 to 230 V AC control supply voltage must come from A1. Otherwise, the safety function is bypassed in the event of a fault. Thus, only relay outputs are admissible when using a PLC.

Do not use a separate control voltage. Only use the relay outputs when using a PLC.

The control supply voltage (L1 and N) to the motor starters is deactivated by the 3SK1 safety relay and the system is in a safe state.

Note

SILCL 3 in accordance with EN 62061, PL e/Cat. 4 in accordance with EN ISO 13849-1

A safety-related application up to SILCL 3 to EN 62061, PL e/Cat. 4 to EN ISO 13849-1 can be realized in this way.

To achieve SILCL 3/PL e/Cat. 4 for the safety-related application, all components of the safety functions (detecting/evaluating/reacting) must be designed accordingly.

Note

A fuse must be fitted as short-circuit protection (4 A gL/gG) in the supply line to the supply voltage of 3RM1 (L1).

7.3 Typical circuits of 3SK1 safety relays with 3RM1 Failsafe motor starters

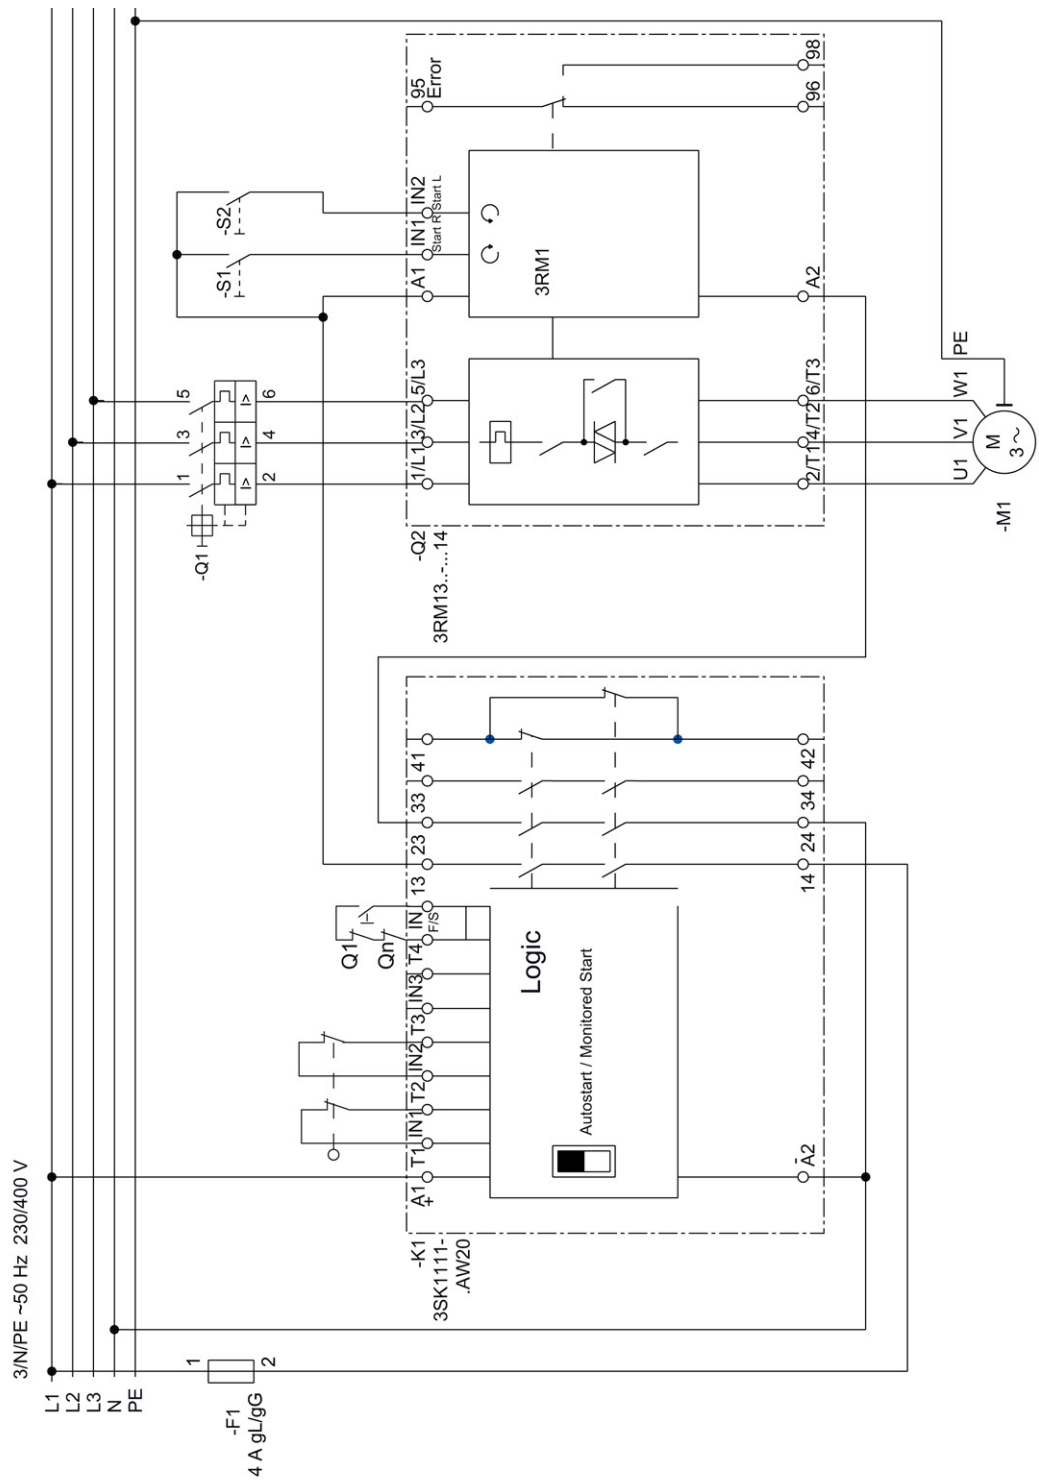


Figure 7-1 3SK1 safety relay with 3RM13 reversing starter

Mounting

8.1 Warning notices

Warning notices before installation, wiring, and commissioning

 WARNING
--

Hazardous voltage! Can cause electric shock and burns. Turn off and lock out all power supplying this device before working on this device.

8.2 Terminal coding

You can provide the terminals with coding pins (3ZY1440-1AA00). This helps you to avoid errors when replacing the terminals.

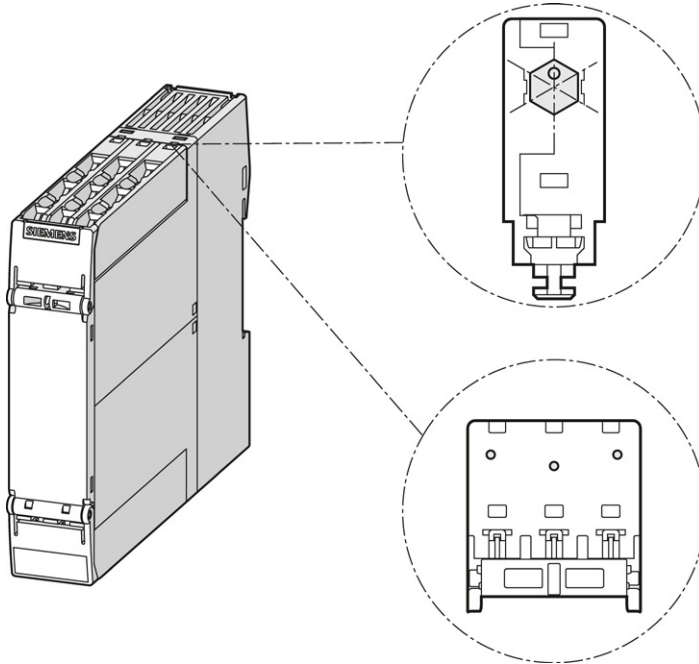


Figure 8-1 Module with coding pins

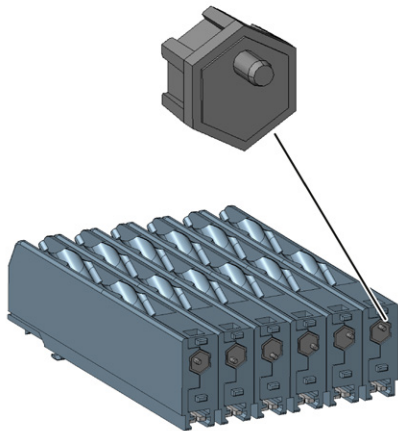


Figure 8-2 Stud position rotated by 60° in each case

8.3 Mounting the devices on a level surface

Requirements

Please note the following requirements for mounting on a level surface:

- Please observe the information about the mounting position in the chapter "General technical data (Page 209)".


- Two properly executed drill holes with thread or plug on the level surface.

For details of the distances between the drilled holes, please refer to the relevant dimension drawings in the chapter "Dimension drawings for 3SK1 devices (Page 263)".


- Two screws (17.5 mm or 22.5 mm devices)/or four screws (90 mm devices) to fit the holes M4 x 12 in accordance with DIN 784.
- Two plastic securing brackets.

Refer to the accessories list for the relevant article number in the chapter "Accessories (Page 279)".

Procedure

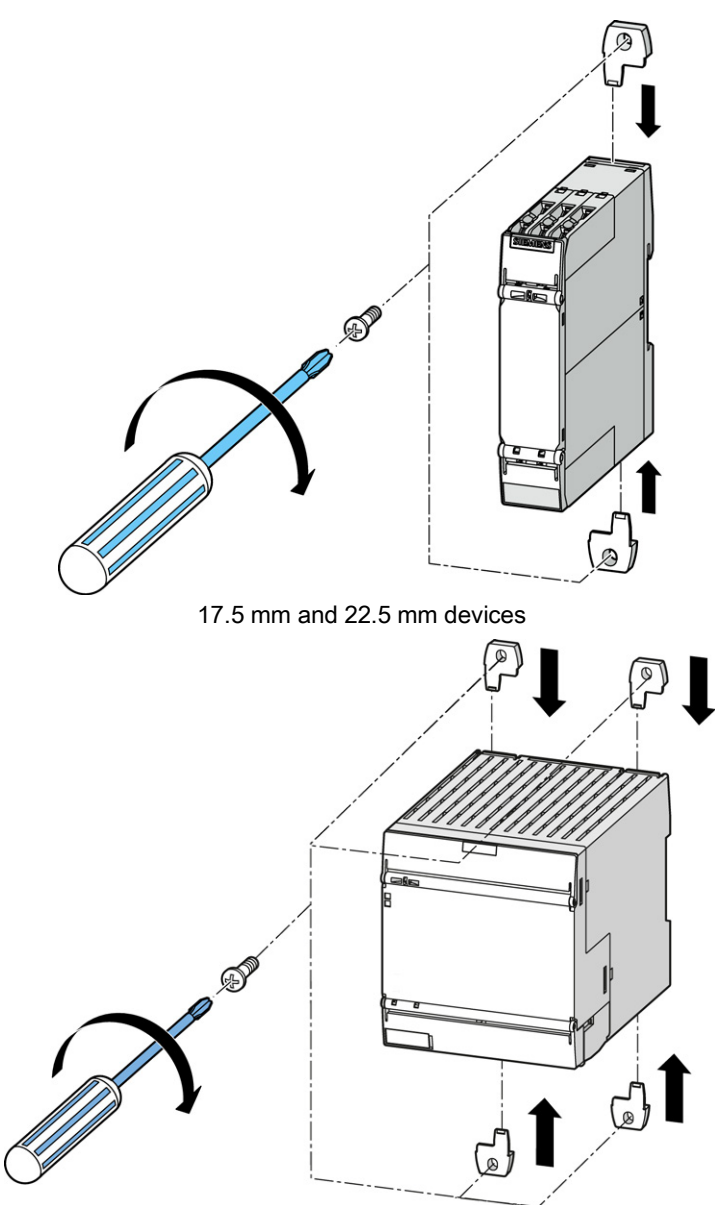Step	Instructions	Figure
1	Insert the securing brackets into the openings provided on the device until they engage.	 <p data-bbox="877 966 1212 997">17.5 mm and 22.5 mm devices</p> <p data-bbox="957 1575 1117 1606">90 mm device</p>
2	Hold the device up to the surface prepared for screw fastening.	
3	Insert the screws through the oblong holes in the securing brackets.	
4	Screw the device onto the level surface so that it is secure. Tightening torque: 1 Nm	



8.4 Disassembling devices from a level surface

 WARNING
Hazardous Voltage Can Cause Death, Serious Injury, or Property Damage. Before starting work, therefore, disconnect the system and devices from the power supply.

Requirements

- The terminals have been removed or disconnected.

Procedure

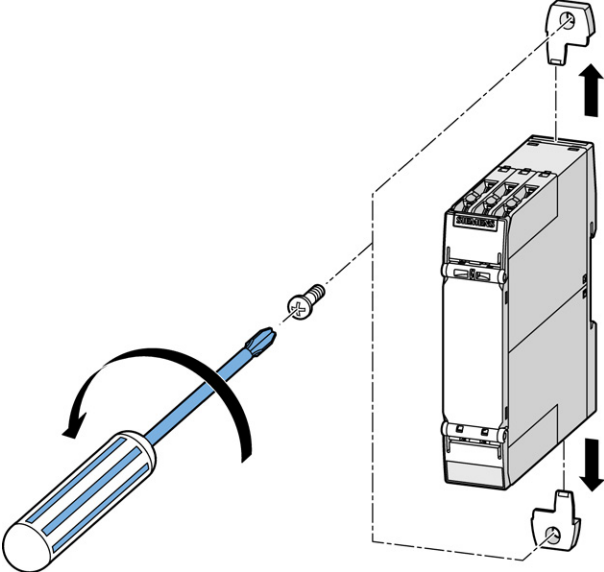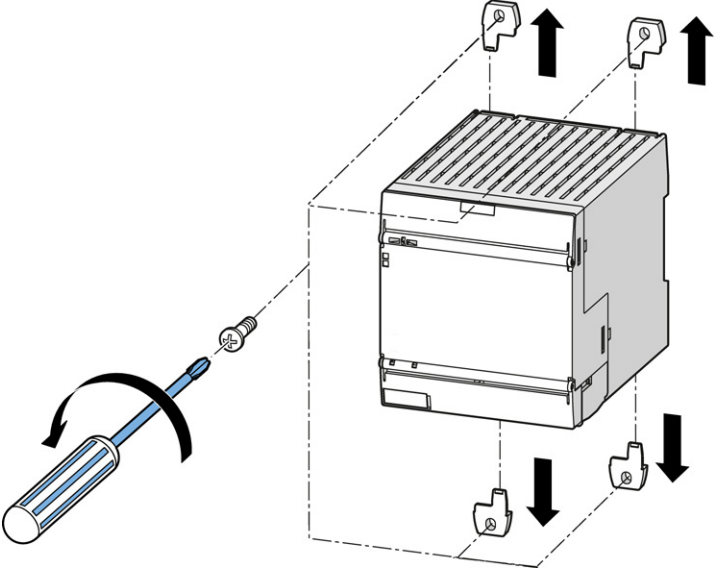Step	Instructions	Figure
1	Hold the device firmly.	 <p data-bbox="678 997 1173 1029">Disassembling 17.5 mm and 22.5 mm devices</p>
2	Unscrew the cap screws.	
3	Lift the device from the level surface.	
4	Remove the securing brackets from the device.	
		 <p data-bbox="678 1690 1013 1722">Disassembling 90 mm devices</p>


8.5 Mounting 22.5 mm/17.5 mm devices on a standard mounting rail

Requirements

- A horizontal 35-mm wide mounting rail in accordance with DIN EN 60715 has been properly secured at the installation location.
- Please observe the information about the mounting position in the chapter "General technical data (Page 209)".

Procedure

The figures show 22.5 mm devices. The 17.5 mm devices are mounted correspondingly.

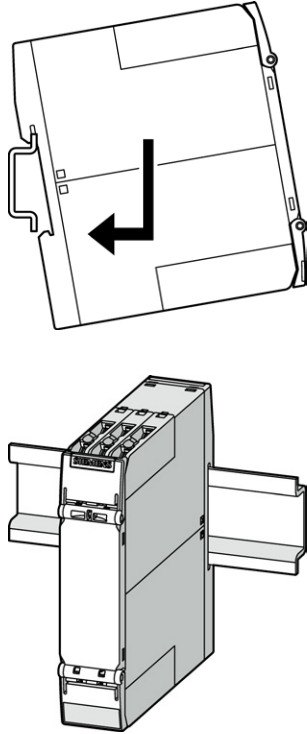
Step	Instructions	Figure
1	Place the back of the device onto the upper edge of the standard mounting rail.	
2	Press the lower half of the device against the DIN rail until the device engages.	

8.6 Mounting the 90 mm devices on a standard mounting rail


Requirements

- A horizontal 35-mm wide mounting rail in accordance with DIN EN 60715 has been properly secured at the installation location.
- Please observe the information about the mounting position in the chapter "General technical data (Page 209)".

Procedure

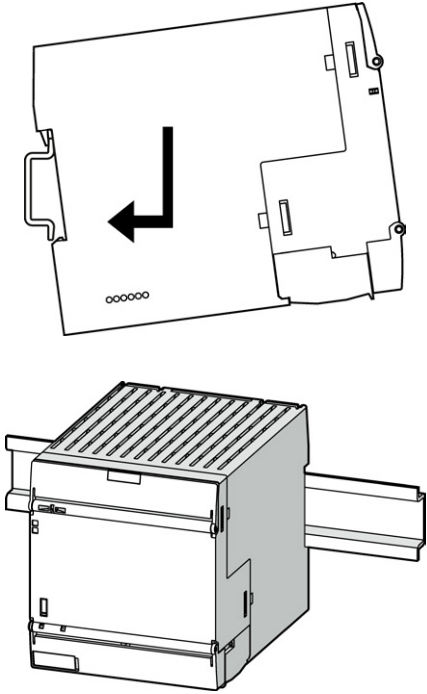Step	Instructions	Figure
1	Place the back of the device onto the upper edge of the standard mounting rail.	
2	Press the lower half of the device against the DIN rail until the device engages.	


8.7 Removing devices from a standard mounting rail

 WARNING
Hazardous Voltage Can Cause Death, Serious Injury, or Property Damage.
Before starting work, therefore, disconnect the system and devices from the power supply.

Requirements

- The terminals have been removed or disconnected.

Procedure

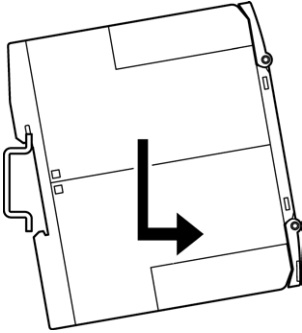Step	Instructions	Figure
1	Press the device downwards.	
2	Pull the lower half of the device away from the standard mounting rail.	
3	Lift the device from the upper edge of the standard mounting rail.	

8.8 Mounting 22.5 mm/17.5 mm devices with device connectors on a standard mounting rail



Requirements



- A horizontal 35-mm wide mounting rail in accordance with DIN EN 60715 has been properly secured at the installation location.
- Please observe the information about the mounting position in the chapter "General technical data (Page 209)".
- Device connectors:
Refer to the accessories list for the relevant article number in the chapter "Accessories (Page 279)".

8.8 Mounting 22.5 mm/17.5 mm devices with device connectors on a standard mounting rail

Procedure

The figures show 22.5 mm devices. The 17.5 mm devices are mounted correspondingly.

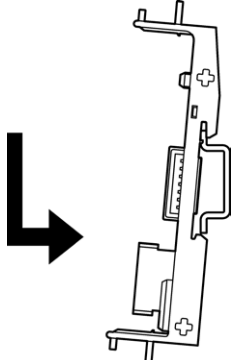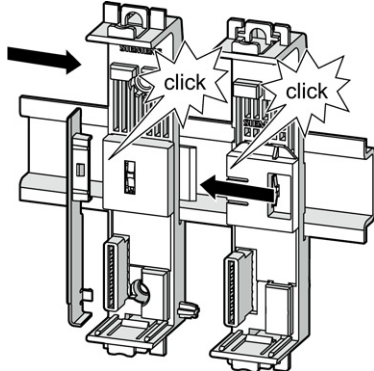Step	Instructions	Figure
1	Place the back of the device connector on the upper edge of the standard mounting rail.	
2	Press the lower half of the device connector against the standard mounting rail until the connector engages.	
3	Repeat the procedure with all the required device connectors.	
4	Push the device connectors together until they engage.	
5	Mount the cover on the left of the first device connector. The cover is included in the scope of supply of the device terminator.	

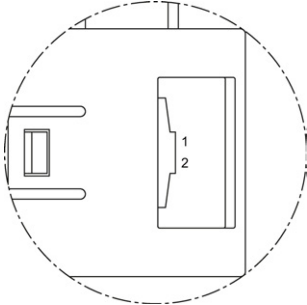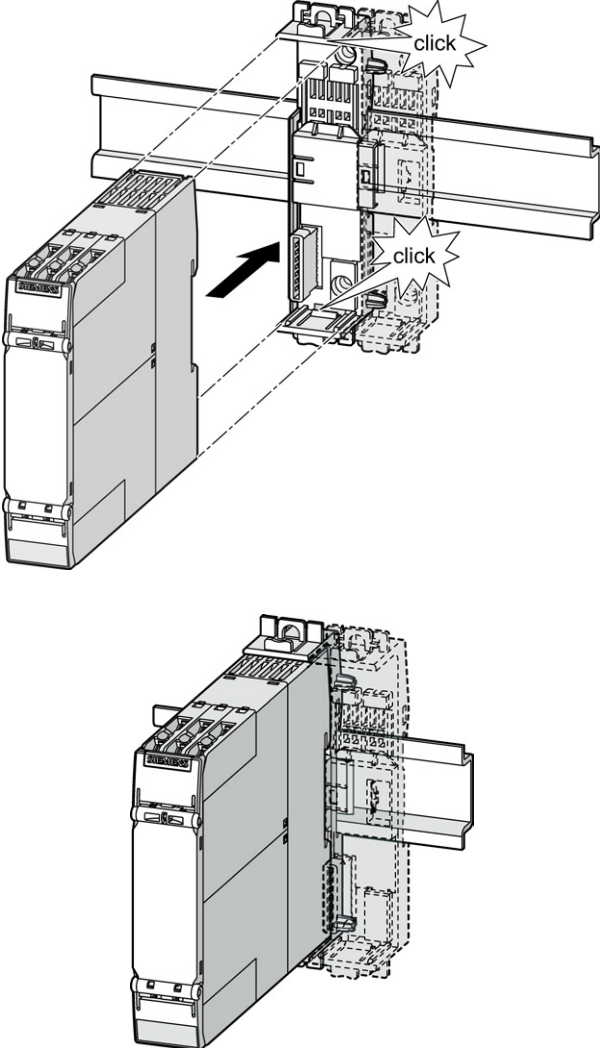Step	Instructions	Figure
<p>6 (not applicable when mounting 3RM1 Failsafe motor starters)</p>	<p>Set the slide switch in the device termination connector for the 3SK1 safety relay to the following positions:</p> <ul style="list-style-type: none"> • below 3SK1 basic device position 2 (bottom; i.e. open) • Below 3SK1211 output expansion position 1 (top; i.e. closed) 	 <p>A circular inset diagram showing a slide switch mechanism. The switch is in position 2, which is the bottom position and is labeled as 'open'. Position 1 is the top position and is labeled as 'closed'.</p>
<p>7</p>	<p>Mount the device on the device connector.</p>	 <p>The figure illustrates the mounting process of a 3SK1 safety relay onto a device connector on a standard mounting rail. The top part shows the relay being pushed onto the connector, with two 'click' callouts indicating the locking mechanism. The bottom part shows the relay fully seated on the connector.</p>
<p>8</p>	<p>Mount all the devices required for the system configuration in accordance with the respective installation guidelines on the device connectors.</p>	

8.9 Removing 22.5 mm/17.5 mm devices with device connectors from a standard mounting rail

 WARNING
--

Hazardous Voltage

Can Cause Death, Serious Injury, or Property Damage.

Before starting work, therefore, disconnect the system and devices from the power supply.

Requirements



- The terminals have been removed or disconnected.

Procedure

The figures show 22.5 mm devices. The 17.5 mm devices are removed correspondingly.

Step	Instructions	Figure
1	Unlock the device using a screwdriver.	
2	Pull the lower half of the device away from the device connector.	
3	Unlock the device using a screwdriver.	
4	Pull the device away from the device connector.	

8.9 Removing 22.5 mm/17.5 mm devices with device connectors from a standard mounting rail

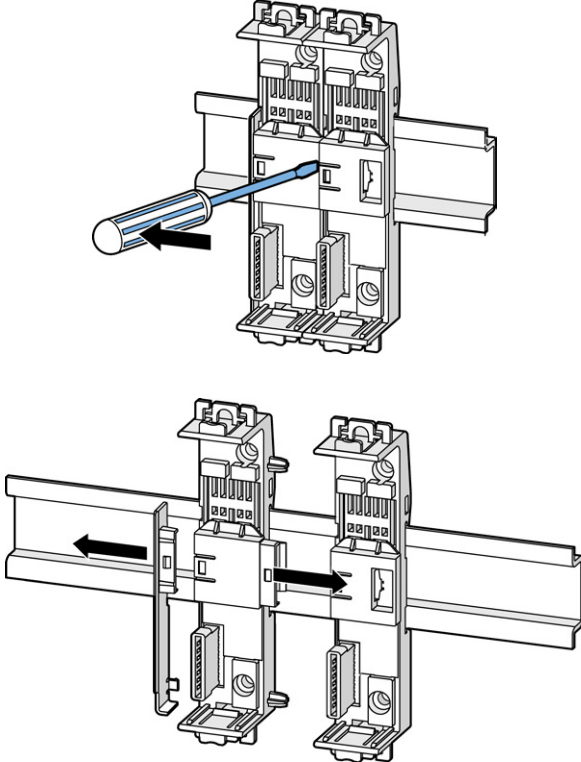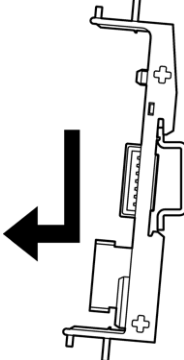Step	Instructions	Figure
5	Separate the device connectors using a screwdriver.	
6	Remove the cover.	
7	Press the device connector down.	
8	Pull the lower half of the device connector away from the standard mounting rail.	
9	Lift the connector from the upper edge of the standard mounting rail.	




8.10 Mounting 90 mm devices with device connectors on a standard mounting rail

Requirements


- A horizontal 35-mm wide mounting rail in accordance with DIN EN 60715 has been properly secured at the installation location.
- Please observe the information about the mounting position in the chapter "General technical data (Page 209)".
- Use the device termination connector set for 3SK1 safety relays, > 45 mm wide. Refer to the accessories list for the relevant article number in the chapter "Accessories (Page 279)".
- Please observe the obligatory mounting rules in Section: "System configuration rules (Page 109)".

8.10 Mounting 90 mm devices with device connectors on a standard mounting rail

Procedure

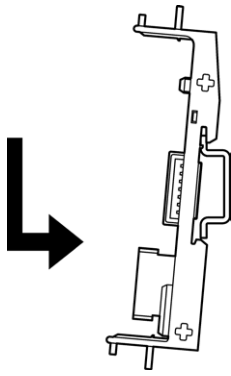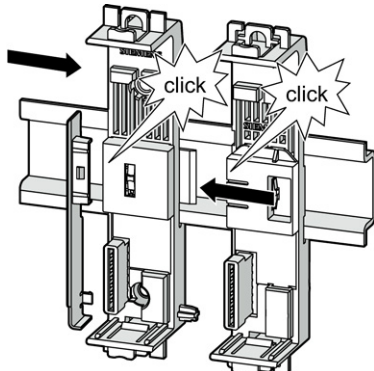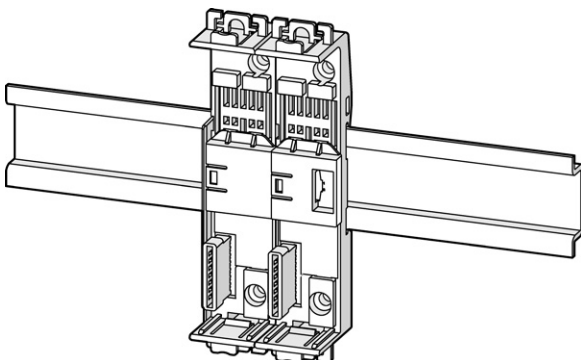Step	Instructions	Figure
1	Hang the back of the device connector onto the upper edge of the standard mounting rail.	
2	Press the lower half of the device connector against the standard mounting rail until the connector engages.	
3	Repeat the procedure with all the required device connectors.	
4	Push the device connectors together until they engage.	
5	Mount the cover on the left of the first device connector piece and the device connectors supplied in the set for enclosures of 45 mm upwards (right-hand side).	
		

8.10 Mounting 90 mm devices with device connectors on a standard mounting rail

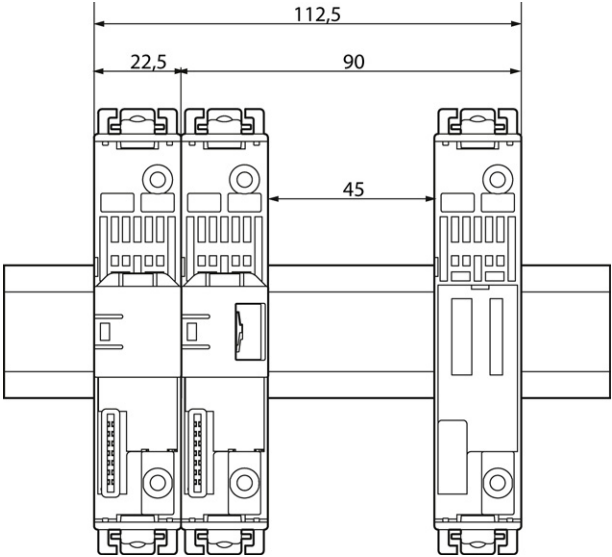Step	Instructions	Figure
6	Note the clearances required for the 90 mm devices.	 <p>The figure is a technical drawing showing three 90 mm wide safety relay modules mounted on a standard DIN rail. The drawing is a top-down view. The total width of the three modules is 112,5 mm. The distance between the centerlines of the first and second modules is 22,5 mm. The distance between the centerlines of the second and third modules is 90 mm. The distance from the centerline of the second module to the centerline of the third module is 45 mm. The drawing shows the front and back views of the modules, including their connectors and internal components.</p>

8.10 Mounting 90 mm devices with device connectors on a standard mounting rail

Step	Instructions	Figure
7	Mount the 3SK1213 output expansion on the device connectors.	
8	Mount all the devices required for the system configuration in accordance with the respective installation guidelines on the device connectors.	

8.11 Removing 90 mm devices with device connectors from a standard mounting rail

 WARNING
--

Hazardous Voltage

Can Cause Death, Serious Injury, or Property Damage.

Before starting work, therefore, disconnect the system and devices from the power supply.



Requirements

- The terminals have been removed or disconnected.

Procedure

Step	Instructions	Figure
1	Unlock the device using a screwdriver.	
2	Pull the lower half of the device away from the device connector.	
3	Unlock the device using a screwdriver.	
4	Pull the device away from the device connector.	

8.11 Removing 90 mm devices with device connectors from a standard mounting rail

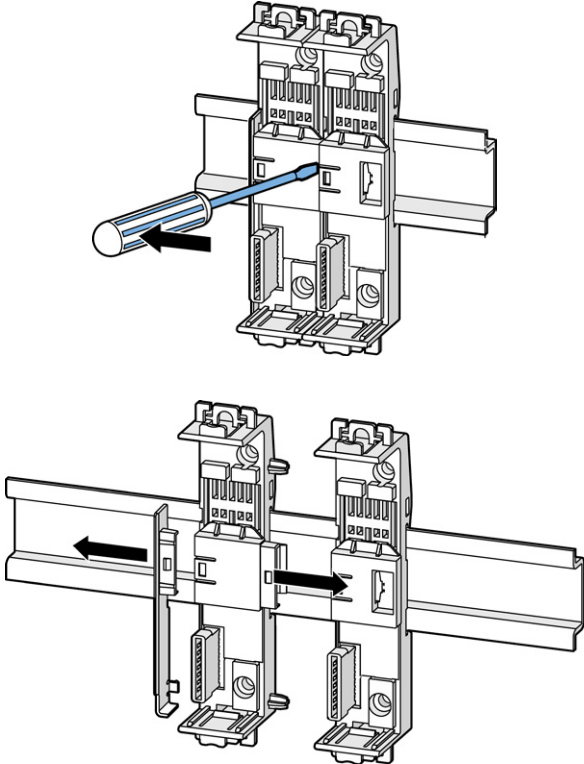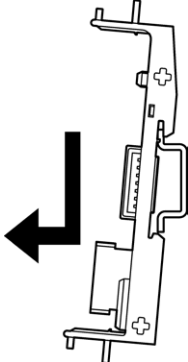Step	Instructions	Figure
5	Separate the device connectors using a screwdriver.	
6	Disassemble the terminating section.	
7	Press the device connector down.	
8	Pull the lower half of the device connector away from the standard mounting rail.	
9	Lift the device connector from the upper edge of the standard mounting rail.	

8.12 Mounting 22.5 mm/17.5 mm devices with device connectors on the wall

Requirements

Please note the following requirements for mounting on a level surface:

- Please observe the information about the mounting position in the chapter "General technical data (Page 209)".
- Two properly executed drill holes (per device connector) with thread or plug on the level surface.



For details of the distances between the drilled holes, please refer to the relevant dimension drawings in the chapter "Dimension drawings 3SK1 device connectors".

- Two screws (per device connector) to fit the holes M4 x12 in accordance with DIN 784.
- Device connector



Refer to the accessories list for the relevant article number in the chapter "Accessories (Page 279)".

Procedure for mounting on a level surface

The figures show 22.5 mm devices. The 17.5 mm devices are mounted correspondingly.

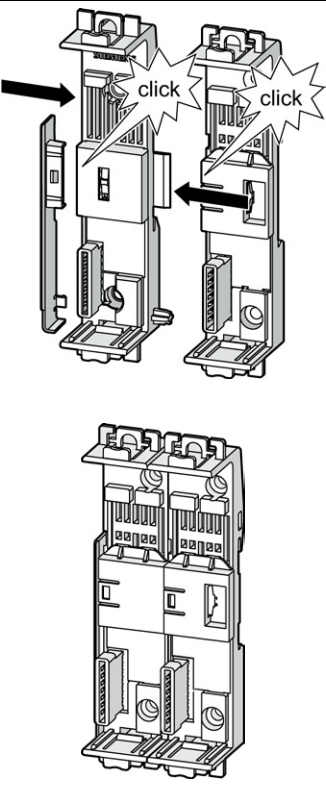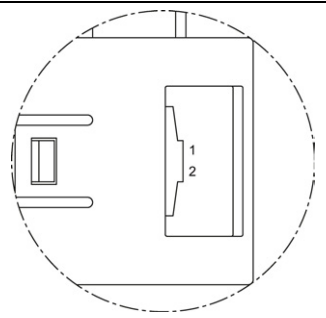Step	Instructions	Figure
1 2	<p>1 Push the device connectors together until they engage.</p> <p>2 Mount the cover on the left of the first device connector. The cover is included in the scope of supply of the device terminator.</p>	
3 (not applicable when mounting 3RM1 Failsafe motor starters)	<p>Set the slide switch in the device termination connector for the 3SK1 safety relays to the following positions:</p> <ul style="list-style-type: none"> • below 3SK1 basic device position 2 (bottom; i.e. open) • below 3SK1211 output expansion position 1 (top; i.e. closed) 	

8.12 Mounting 22.5 mm/17.5 mm devices with device connectors on the wall

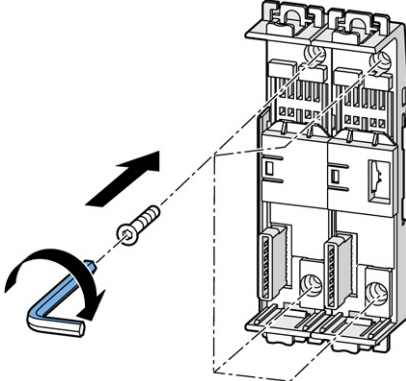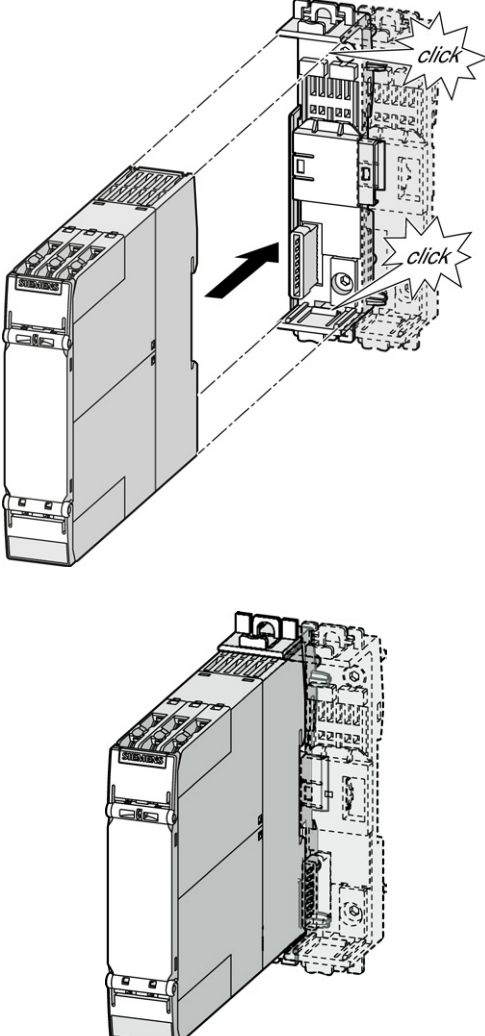Step	Instructions	Figure
4	Hold the device connector against the level surface prepared for screw fastening.	
5	Insert the screws through the holes in the device connectors.	
6	Screw the device connector securely onto the level surface. Tightening torques: <ul style="list-style-type: none"> • Top: < 0.1 Nm • Bottom: 1 Nm 	
7	Mount the device on the device connector.	
8	Mount all the devices required for the system configuration in accordance with the respective installation guidelines on the device connectors.	

8.13 Removing 22.5 mm/17.5 mm devices with device connectors from the wall



 WARNING
Hazardous Voltage Can Cause Death, Serious Injury, or Property Damage.
Before starting work, therefore, disconnect the system and devices from the power supply.

Requirements



- The terminals have been removed or disconnected.

Procedure

The figures show 22.5 mm devices. The 17.5 mm devices are removed correspondingly.

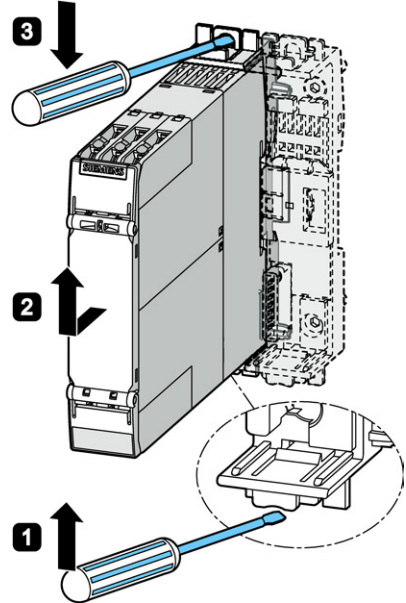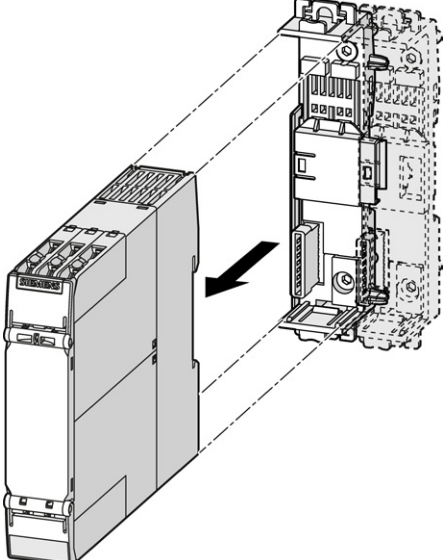Step	Instructions	Figure
1	Unlock the device (below) using a screwdriver.	
2	Pull the lower half of the device away from the device connector.	
3	Unlock the device (above) using a screwdriver.	
4	Pull the device away from the device connector.	

8.13 Removing 22.5 mm/17.5 mm devices with device connectors from the wall

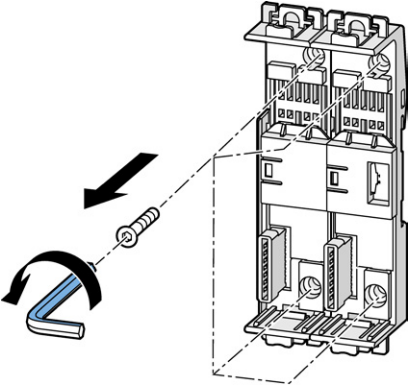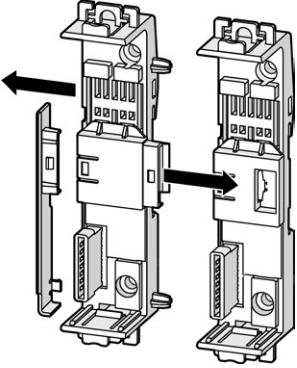Step	Instructions	Figure
5	Release the screws.	
6	Separate the device connectors using a screwdriver.	
7	Remove the cover.	



8.14 Mounting 90 mm devices with device connectors on the wall

Requirements



Please note the following requirements for mounting on a level surface:

- Please observe the information about the mounting position in the chapter "General technical data (Page 209)".
- Two properly executed drill holes with thread or plug on the level surface (per device connector).
- Two M4 x 12 screws in accordance with DIN 784 (per device connector) to fit the holes.
- Use the device termination connector set for 3SK1 safety relays, > 45 mm wide. Refer to the accessories list for the relevant article number in the chapter "Accessories (Page 279)".

Procedure

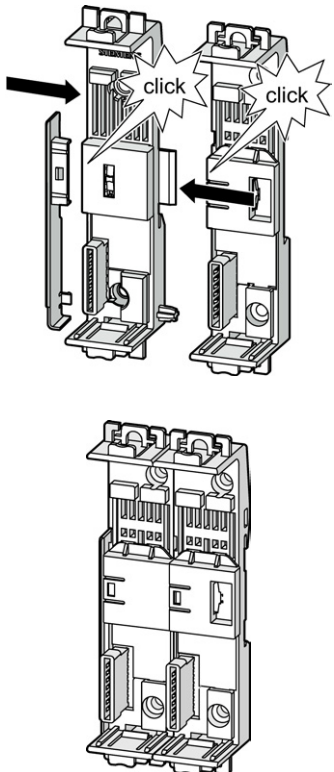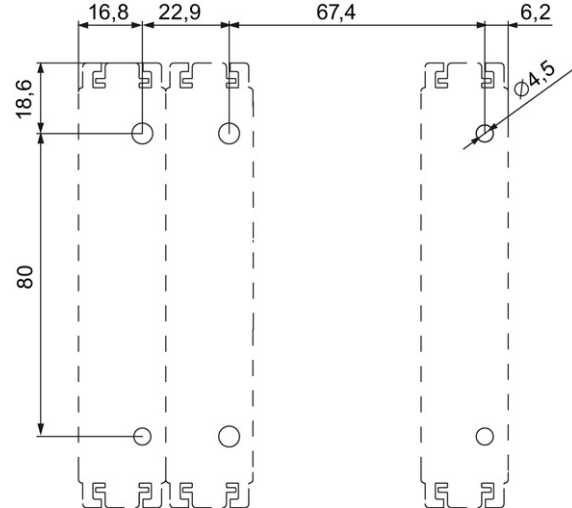Step	Instructions	Figure
<p>1 2</p>	<p>Push the device connectors together until they engage. Mount the cover on the left of the first device connector.</p>	<p>Figure</p> 
<p>3</p>	<p>Note the clearances required for the 90 mm devices. Mount the device connector supplied in the set for enclosures of 45 mm upwards (right-hand side). Tightening torques:</p> <ul style="list-style-type: none"> • Top: < 0.1 Nm • Bottom: 1 Nm 	

8.14 Mounting 90 mm devices with device connectors on the wall

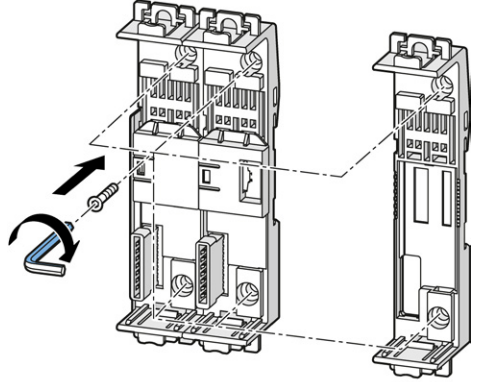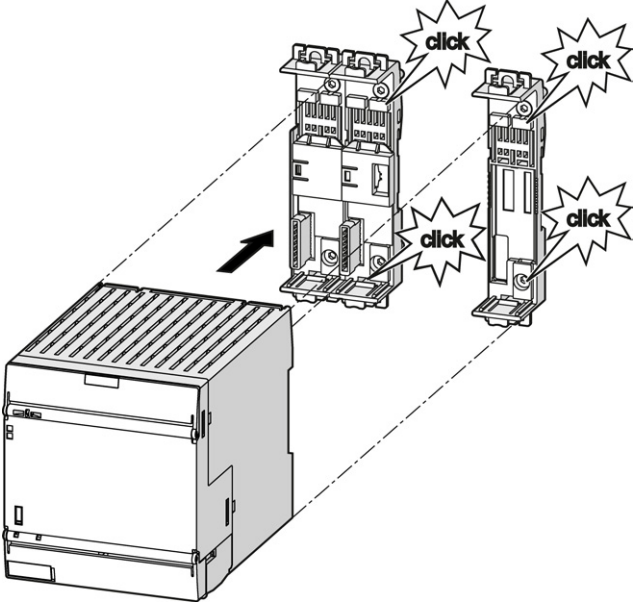Step	Instructions	Figure
4	Hold the device connector against the level surface prepared for screw fastening.	
5	Insert the screws through the holes in the device connectors.	
6	Screw the device connector securely onto the level surface.	
7	Mount the 3SK1213 output expansion on the device connectors	
8	Mount all the devices required for the system configuration in accordance with the respective installation guidelines on the device connectors.	

8.15 Removing 90 mm devices with device connectors from wall

 **WARNING**

Hazardous Voltage

Can Cause Death, Serious Injury, or Property Damage.


Before starting work, therefore, disconnect the system and devices from the power supply.

Requirements

- The terminals have been removed or disconnected.

Procedure

Step	Instructions	Figure
1	Unlock the device (bottom) using a screwdriver.	
2	Pull the lower half of the device away from the device connector.	
3	Unlock the device (top) using a screwdriver.	
4	Pull the device away from the device connector.	
5	Release the screws.	

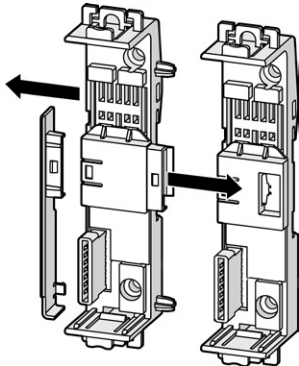
Step	Instructions	Figure
6	Separate the device connectors.	
7	Remove the cover.	

8.16 Mounting the sealable cover

The sealable cover (3ZY1321-1AA00 for 17.5 mm devices, 3ZY1321-2AA00 for 22.5 mm devices) can be used to secure the DIP switches (and, if present, the potentiometers for setting the delay time) of the safety relays against unauthorized or unintended readjustment.

As an alternative, Siemens also offers a sealable membrane (3TK2820-0AA00) for securing the safety relays. The sealable membrane is fixed to the front of the safety relay and secures the DIP switches and the buttons (and potentiometers) against unintentional readjustment.

Mounting the sealable cover

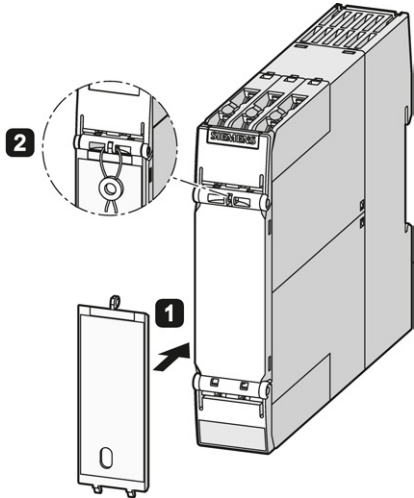Step	Instructions	Figure
1	Attach the hooks on the cover to the openings on the device and fold the cover up.	
2	Seal the cover to secure it against unauthorized removal. Sealing wire diameter, max.: 2 mm	

Connection

9.1 22.5 mm/17.5 mm devices

9.1.1 Terminal assignment

Location of the connections

The inside faces of the terminal covers are labeled with the designations of the relevant terminals. The position of the label corresponds to the position of the respective terminal.

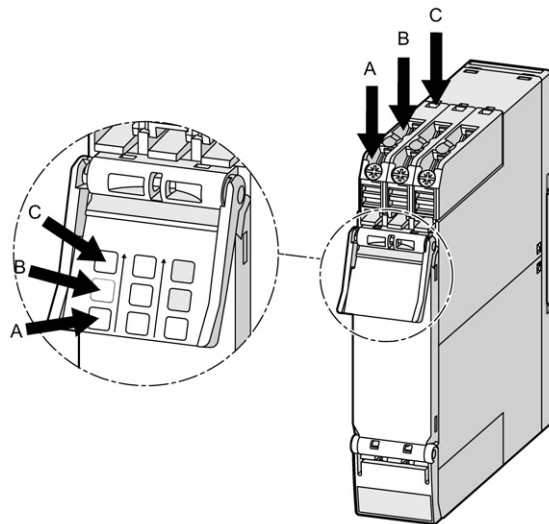


Figure 9-1 Upper terminal cover

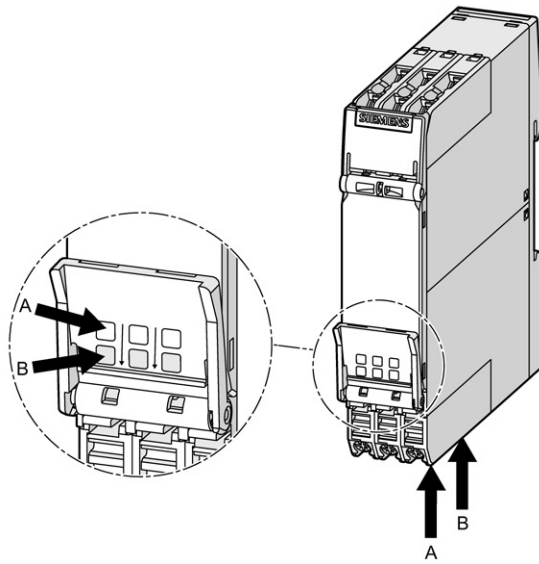







Figure 9-2 Lower terminal cover

9.1.2 Connection data for terminals

		Specification and value in the case of removable terminals with screw-type terminals
<p>Screwdriver</p> 		<p>Cross-tip screwdriver Size: PZ 1x80 (∅ 4.5 mm) Torque: 0.6 to 0.8 Nm</p>
<p>Rigid cable</p> 		<p>A = 10 mm 1 x 0.5 ... 2.5 mm² 2 x 1.0 ... 1.5 mm²</p>
<p>Flexible conductor with end sleeve</p> 		<p>A = 10 mm 1 x 0.5 ... 2.5 mm² 2 x 0.5 ... 1.0 mm²</p>
<p>Flexible cable</p> 		<p>Not permissible</p>
<p>AWG</p>		<p>1 x 20 to 14 2 x 18 to 16</p>


9.1.3 Connecting the screw-type terminals

 WARNING
Hazardous Voltage Can Cause Death, Serious Injury, or Property Damage.
Before starting work, therefore, disconnect the system and devices from the power supply.


Requirements

- Cross-tip screwdriver size PZ 1 x 80.
- For suitable connection cross-sections of the cables, see the chapter "Connection data for terminals (Page 175)".

Procedure

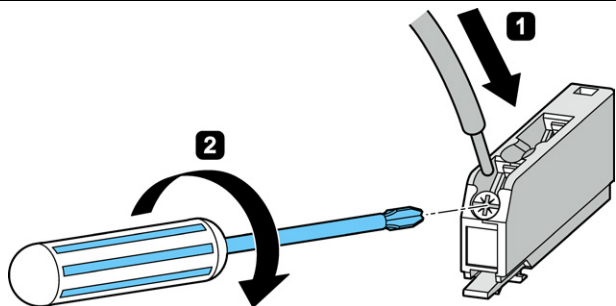Step	Instructions	Figure
1	Insert the relevant cable into square on the screw-type terminal until it engages.	
2	Hold the cable in the screw-type terminal.	
3	Tighten the screw with a torque of 0.6 ... 0.8 Nm.	
4	Pull on the cable to ensure it is screwed tight.	


9.1.4 Disconnecting the screw-type terminals

 WARNING
Hazardous Voltage Can Cause Death, Serious Injury, or Property Damage.
Before starting work, therefore, disconnect the system and devices from the power supply.

Requirements

- Cross-tip screwdriver size PZ 1 x 80

Procedure

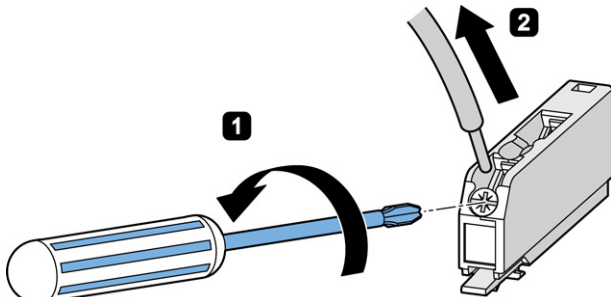Step	Instructions	Figure
1	Unscrew the screw of the screw-type terminal.	
2	Remove the cable from the unscrewed screw-type terminal.	

9.1.5 Wiring rules for spring-loaded terminals (with push-in technology)

Wiring rules for ...		Control current terminals (top of enclosure):	Main current terminals (bottom of enclosure)
Connectable cross-sections for solid cables		2 x 0.5 ... 2 x 1.5 mm ² (AWG ¹⁾ : 20 ... 16)	0.5 ... 4 mm ² AWG ¹⁾ : 20 ... 12
Connectable cross-sections for flexible cables	Without end sleeve	2 x 0.5 ... 2 x 1.5 mm ² (AWG ¹⁾ : 20 ... 16)	0.5 ... 4 mm ² AWG ¹⁾ : 20 ... 12
	With end sleeve (with and without plastic sleeve)	2 x 0.5 ... 2 x 1.0 mm ^{2 2)} (AWG ¹⁾ : 20 ... 18)	0.5 ... 2.5 mm ² (AWG ¹⁾ : 20 ... 14)
	With TWIN end sleeve	---	2 x 0.5 ... 2 x 1.5 mm ² (AWG ¹⁾ : 20 ... 16)
Cable stripping length		10 ... 11 mm	
End sleeves according to DIN 46228-4 with plastic sleeve		10 mm	

- 1) AWG: American Wire Gauge (AWG does not define use of end sleeves)
- 2) When 2 x 1.0 mm² end sleeves with a plastic sleeve are used, space problems may arise with the sleeves; as an alternative, you are advised to use end sleeves without plastic sleeves

Notes on handling spring-loaded terminals with push-in technology


The terminal area of the spring-loaded terminals is rectangular, and the maximum overall dimensions of a conductor to be wired must not exceed 1.5 x 2.4 mm (control current terminals) or 2.4 x 2.8 mm (main current terminals).

Attention must be paid to the orientation of the terminal area, which may call for vertical fitting of rectangularly crimped cables.

To make optimum use of available terminal area, you are advised to choose a form of crimping that creates a corresponding rectangular contour. Trapezoidal crimping is generally very highly suitable in this case.


When use is made of a cable that utilizes the full overall height, the terminal's spring is deflected to the maximum. Therefore, removal of this cable may become a problem because it requires further deflection of the spring.

Control current terminals

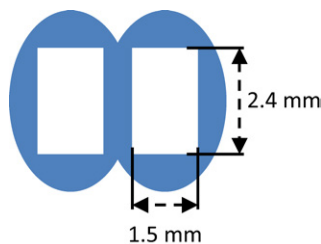

Terminal area of control current terminals

Main current terminals



Terminal area of main current terminals

9.1.6 Connecting the push-in terminals

 WARNING
--

Hazardous Voltage Can Cause Death, Serious Injury, or Property Damage.

Before starting work, therefore, disconnect the system and devices from the power supply.

Push-in connections are a form of spring-loaded terminals allowing wiring without tools for rigid conductors or conductors equipped with end sleeves.

For wiring finely-stranded or stranded conductors without end sleeves on push-in connections, a screwdriver is required.

Requirements

- 0.5 x 3 mm screwdriver DIN 5264 (for finely-stranded conductors only).
- For suitable connection cross-sections of the cables, see the chapter "Connection data for terminals (Page 175)".

Procedure

Table 9- 1 Rigid conductors or conductors equipped with end sleeves

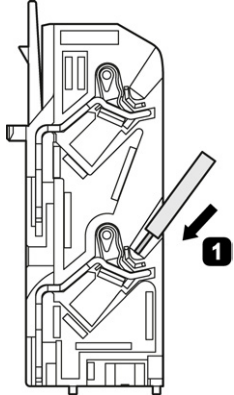
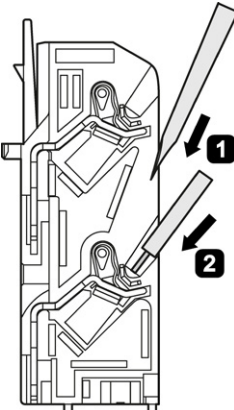

Step	Instructions	Figure
1	Insert the cable into the oval opening as far as it will go.	
2	Pull on the cable to ensure it is tight.	

Table 9- 2 Finely-stranded conductors

Step	Instructions	Figure
1	Insert the screwdriver in the rectangular opening to open the terminal (oval opening).	
2	Insert the cable as far as it will go into the oval opening and remove the screwdriver.	
3	Pull on the cable to ensure it is tight.	


9.1.7 Disconnecting the push-in terminals

 WARNING
Hazardous Voltage Can Cause Death, Serious Injury, or Property Damage. Before starting work, therefore, disconnect the system and devices from the power supply.

Requirements

- Screwdriver DIN 5264 of the size 0.5 x 3 mm

Procedure

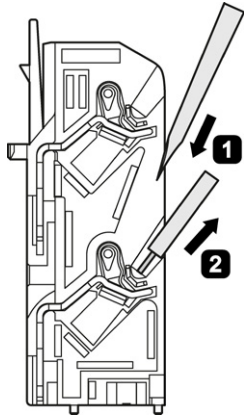Step	Instructions	Figure
1	Insert the screwdriver into the rectangular opening of the spring-loaded terminal until it engages.	
2	Remove the cable from the oval opening.	
3	Remove the screwdriver.	


9.1.8 Attaching the terminals

⚠ WARNING
Hazardous voltage
Can Cause Death, Serious Injury, or Property Damage.
Before starting work, therefore, disconnect the system and devices from the power supply.


Requirements

You must have removed the terminals, for the purpose of replacing a device, for example.


Procedure when plugging in the terminals

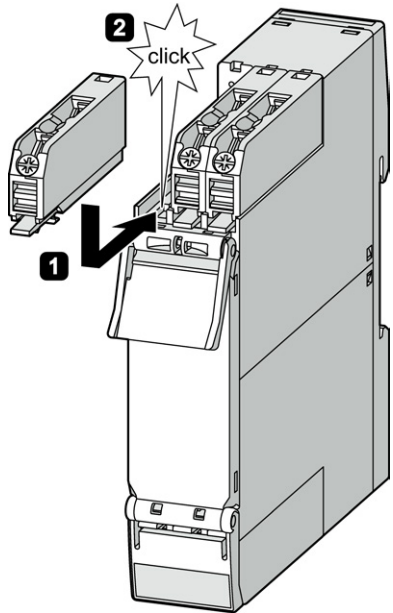Step	Instructions	Figure
1	Insert the detachable terminals into the guide rail of the device.	
2	Slide the detachable terminals back until they audibly engage.	

9.1.9 Disconnecting

 WARNING
Hazardous Voltage Can Cause Death, Serious Injury, or Property Damage. Before starting work, therefore, disconnect the system and devices from the power supply.

Removing terminals from the device

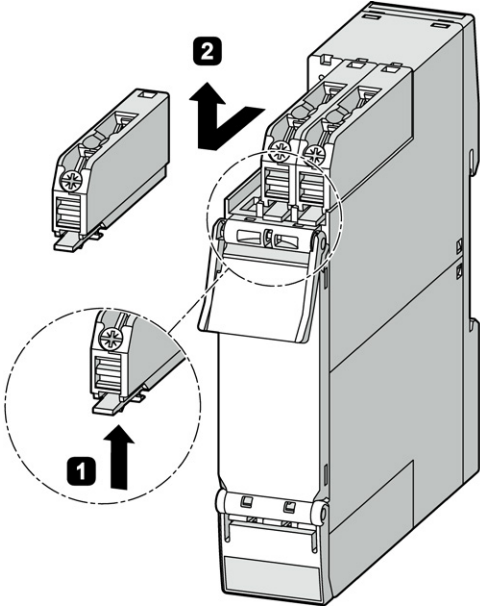Step	Instructions	Figure
1	Press the clip of the terminals upwards.	
2	Pull the terminals out to the front.	
3	Lift the terminals out of the guide rail of the device.	

Screw terminals: Disconnecting the conductor


Step	Instructions	Figure
1	Unscrew the screw of the screw-type terminal.	
2	Remove the cable from the unscrewed screw-type terminal.	

Push-in terminals: Disconnecting the conductor

Step	Instructions	Figure
1	Insert the screwdriver into the rectangular opening of the push-in terminal until it engages. Please observe a 10° horizontal angular deviation of the screwdriver to the oval opening.	
2	Remove the cable from the oval opening.	
3	Remove the screwdriver.	

9.2 Devices 90 mm


9.2.1 Opening the terminal cover

 WARNING
Hazardous Voltage
Can Cause Death, Serious Injury, or Property Damage.
Before starting work, therefore, disconnect the system and devices from the power supply.





Positions of the terminals and opening the terminal cover

The removable terminals are located under the **lower** terminal cover.


To open the terminal cover, press on it in the middle ① and lift it up ②.

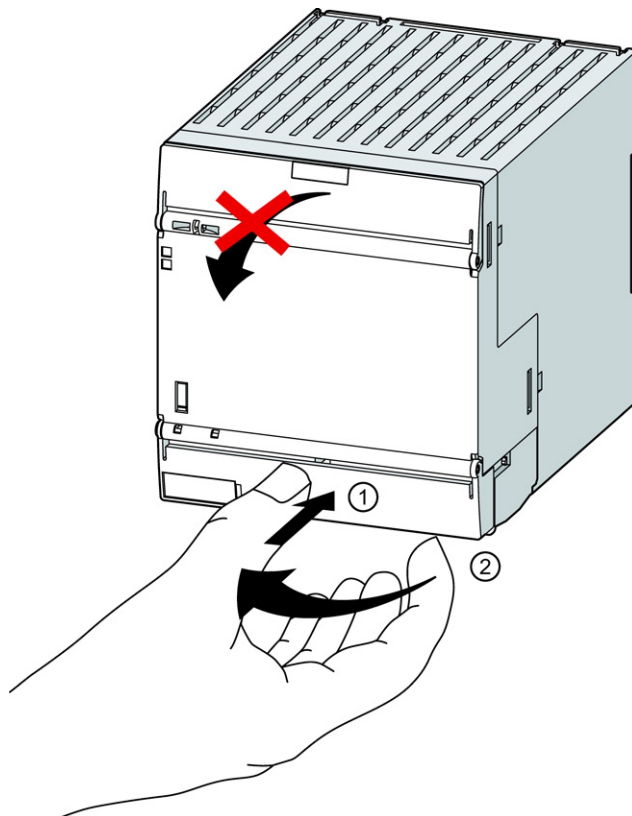

9.2.2 Connection data for terminals

	Screwdriver for removable terminals with screw-type terminals	Screwdriver for removable terminals with spring-loaded terminals
Screwdriver 	Cross-tip screwdriver Size: PZ 1 (∅ 4 mm) Torque: 0.8 to 1.2 Nm	Screwdriver Size: 0 or 1 (width to 3 mm) for raising the terminal springs DIN 5264-A; 0.5 x 3
Rigid cable 	A = 10 mm 1 x 0.5 ... 4.0 mm ² 2 x 0.5 ... 2.5 mm ²	A = 10 mm 1 x 0.5 ... 1.5 mm ² 2 x 0.5 ... 1.5 mm ²
Flexible cable with end sleeve/cable lug 	A = 10 mm 1 x 0.5 ... 2.5 mm ² 2 x 0.5 ... 1.5 mm ²	A = 10 mm 1 x 0.5 ... 1.5 mm ² 2 x 0.5 ... 1.5 mm ²
Flexible cable 	Not permissible	A = 10 mm 1 x 0.5 ... 1.5 mm ² 2 x 0.5 ... 1.5 mm ²
AWG	1 x 20 to 12 2 x 18 to 14	1 x 20 to 16 2 x 20 to 16

9.2.3 Connecting terminals

 WARNING
Hazardous Voltage Can Cause Death, Serious Injury, or Property Damage. Before starting work, therefore, disconnect the system and devices from the power supply.

Procedure for screw-type terminal blocks

Step	Instructions	Figure
1	Insert the relevant cable into square on the screw-type terminal until it engages.	
2	Hold the cable in the screw-type terminal.	
3	Tighten the screw of the terminal in which the cable is inserted.	
4	Pull on the cable to ensure it is screwed tight.	

Procedure for spring-loaded terminals

Step	Instructions	Figure
1	To release the clamping springs, insert the screwdriver as far as it will go into the rectangular opening of the spring-loaded terminal. Please observe a 10° horizontal angular deviation of the screwdriver to the oval opening.	
2	Insert the cable into the oval opening as far as it will go.	
3	Hold the cable in the spring-loaded terminal.	
4	Remove the screwdriver.	
5	Pull on the cable to ensure it is tight.	


9.2.4 Mounting terminals

⚠ WARNING
Hazardous voltage
Can Cause Death, Serious Injury, or Property Damage.
Before starting work, therefore, disconnect the system and devices from the power supply.

Requirements

You must have removed the terminals, for the purpose of replacing a device, for example.

Procedure for mounting terminals

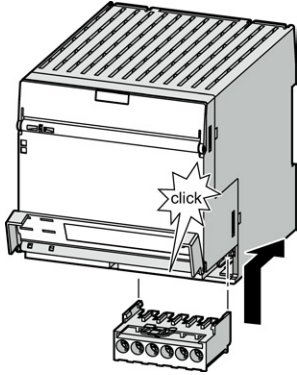Step	Instructions	Figure
1	Insert the detachable terminals into the guide rail of the device.	
2	Slide the detachable terminals back until they audibly engage.	
3	Check that the clip of the removable terminals closes flush with the front panel.	


9.2.5 Disconnecting

⚠ WARNING

**Hazardous Voltage
Can Cause Death, Serious Injury, or Property Damage.**

Before starting work, therefore, disconnect the system and devices from the power supply.

Removing terminals from the device

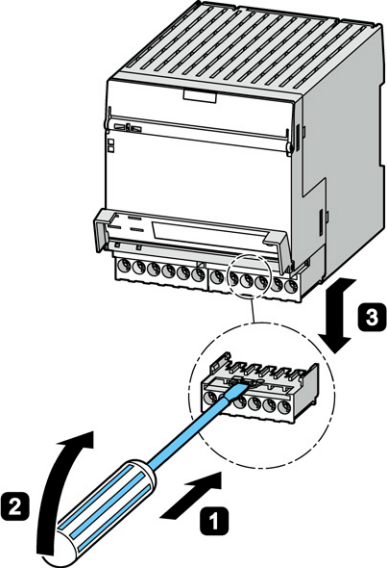Step	Instructions	Figure
1	Insert a flat-head screwdriver between the clip of the terminals and the front panel.	 <p>The diagram illustrates the three-step process of removing terminals from a device. Step 1 shows a flat-head screwdriver being inserted between the terminal clip and the front panel. Step 2 shows the terminal being pulled out towards the front. Step 3 shows the terminal being lifted out of the guide rail.</p>
2	Pull the terminals out to the front.	
3	Lift the terminals out of the guide rail of the device.	

Disconnecting screw-type terminals

Step	Instructions	Figure
1	Insert the screwdriver into the screw-type terminal.	
2	Unscrew the screw of the screw-type terminal.	
3	Remove the cable from the unscrewed screw-type terminal.	

Disconnecting spring-loaded terminals

Step	Instructions	Figure
1	Insert the flat-head screwdriver into the rectangular opening of the spring-loaded terminal until it engages. Please observe a 10° horizontal angular deviation of the screwdriver to the oval opening.	
2	Remove the cable from the oval opening.	
3	Remove the screwdriver.	

9.3 Device replacement

 WARNING

**Hazardous Voltage
Can Cause Death, Serious Injury, or Property Damage.**

Before starting work, therefore, disconnect the system and devices from the power supply.

When replacing a device, you do not need to re-wire it. The terminals can be disconnected from the defective device and then connected to the new device.

You can provide the terminals with coding pins. These are to help you avoid errors when replacing the terminals (see the chapter "Terminal coding (Page 140)" for more details).

Replacing the module



WARNING

**Hazardous Voltage
Can Cause Death, Serious Injury, or Property Damage.
Carry out function test of the plant**

To ensure the safety of the system, a full functional test must be conducted and a successful result obtained after a device has been replaced.

Note

Only replace a defective device with a device of an identical article number.

1. Disconnect the defective device at the terminals.
 - Chapter for 22.5 mm devices Disconnecting (Page 183)
 - Chapter for 90 mm devices Disconnecting (Page 189)
2. Deinstall the defective device.
 - Chapter "Removing devices from a standard mounting rail (Page 147)"
 - Chapter "Removing 22.5 mm/17.5 mm devices with device connectors from a standard mounting rail (Page 151)"
 - Chapter "Removing 90 mm devices with device connectors from a standard mounting rail (Page 158)"
3. Mount the new device
 - Chapter "Mounting the devices on a level surface (Page 141)"
 - Chapter "Mounting 22.5 mm/17.5 mm devices on a standard mounting rail (Page 145)"
 - Chapter "Mounting the 90 mm devices on a standard mounting rail (Page 146)"
 - Chapter "Mounting 22.5 mm/17.5 mm devices with device connectors on the wall (Page 161)"
 - Chapter "Mounting 90 mm devices with device connectors on the wall (Page 167)"
4. Connect the defective device at the terminals
 - Chapter for 22.5 mm devices "Connecting the screw-type terminals (Page 176)", "Connecting the push-in terminals (Page 179)" and "Attaching the terminals (Page 182)"
 - Chapter for 90 mm devices "Connecting terminals (Page 186)" and "Mounting terminals (Page 188)"
5. Set the DIP switches/slide switches and, if applicable, the times according to the defective device.

After applying the supply voltage, the new 3SK1 basic unit checks whether the hardware configuration matches the device configuration.

If there are no deviations, the system re-enters safety mode.

Configuration / operation

10.1 Procedure for configuration

General information:

- It is only possible to change the configuration (DIP switch, NC/NO evaluation, potentiometer, input and output expansion) in configuration mode. Modifications during operation are not accepted.
- A configuration change (DIP switch, NC/NO evaluation, potentiometer) is indicated in safety mode by the "DEVICE" LED flashing green/yellow, but does not change the device function.
- In safety mode, if a change in the system configuration (input and output expansion) is detected, the device switches to error mode ("DEVICE" LED and "SF" LED red). A restart is only possible using Power OFF/ON.

Procedure for configuring a basic unit

1. Set the configuration (DIP, PAR, potentiometer, input expansion, output expansion) in accordance with the desired function.
2. Connect the power supply.
3. If the device detects a modified configuration, it remains in configuration mode (LEDs flash) during power up.
4. Confirm the new configuration by operating the SET/RESET pushbutton for more than 1s.
5. The configuration has been accepted and the device changes to safety mode.

Note

Configuration and setting the delay time

A change to the configuration must only ever be carried out when the system is disconnected from the power.

In safety mode, an adjustment to the potentiometer does not result in a change to the parameterized delay time.

A change to the potentiometer setting made during operation is not accepted and is indicated in safety mode by a yellow/green flashing "DEVICE" LED. The device can be restarted by performing a RESET (pressing the SET/RESET button) or by disconnecting and reconnecting the supply voltage. Following a restart, the device remains in safety configuration mode during power up (all enabling circuits are shut down) until the new delay time is accepted by pressing the SET/RESET button.

10.2 Explanation of the device's functions

Explanation of the device's functions (DIP switches)

DIP switch	Parameter	Function
1	Start type	<ul style="list-style-type: none"> • Autostart: The enabling circuits are switched to the active position as soon as the switch-on condition is satisfied at the sensor inputs IN1, IN2, INF and INK. The START button connection terminal INS is not queried. • Monitored start: The enabling circuits are switched to the active position as soon as the switch-on condition is met at the IN1, IN2, INF und INK sensor inputs and the START button at the INS terminal is actuated (start with the falling edge).
2	Cross-circuit detection	<p>Cross-circuit detection is only possible with floating sensors. The sensors must be connected between T1 - IN1 and T2 – IN2. At the terminals IN1 and PAR (if used), the test signal of terminal T1 is expected; at the terminals IN2 and INF , the test signal of T2 is expected. The device detects a sensor fault if the signal at the terminals IN1, PAR or IN2, INF does not match the test signals T1, T2.</p> <p>Cross-circuit detection must be deactivated if electronic sensors such as light arrays or laser scanners are connected. The 3SK1 now no longer monitors the sensor inputs for cross-circuit detection. Usually, the outputs of safety sensors (OSSD) are already monitored for cross-circuits in the sensor.</p> <p>Devices with PAR terminals expect the test signal T2 at the parameterization input. A 24 V signal at the PAR or INF terminals results in a fault (cross-circuit at the input).</p>
3	Type of connection	<ul style="list-style-type: none"> • 1 sensor with 2 contacts (1 x 2-channel) (NC/NC). It is expected here that both contacts be open simultaneously. With the additional connection of T1 to PAR, this DIP parameterization applies to ONE 2-channel sensor with NC/NO contacts. • 2 sensors with one contact each (2x single-channel) (NC/NC). It is expected that both sensors are ANDed. Simultaneity is not monitored.
4	Startup testing	After a power failure, startup testing requires that the sensors at IN1 and IN2 are actuated once by the system operator.

Function of the cascading input (INK terminal)

1. Safe combination of safety relays

In this application, a higher-level safety relay switches off the 3SK1 safety relay via the cascading input via a safe output.

Example:

an EMERGENCY STOP circuit is to deactivate the entire installation as a higher-level circuit.

Several function groups (e.g., protective doors) that disconnect locally can be operated as subordinate units.

 WARNING
Application / safety relay safety level
The safety level (PL/SIL) of the application corresponds to the lowest safety level of a subsystem of the application when errors are excluded (protected wiring of the control cable).

2. Additional safety sensor circuit

The INK cascading input is ANDed with sensor inputs IN1, IN2 .

PL c in accordance with ISO 13849-1, or SIL1 in accordance with IEC 62061 can be achieved if the cascading input is wired with single-channel (positive opening) safety sensors (supply via A1 / +24 V (identical potential to A1)) and if the connecting cable is laid in a protected fashion. The start function for the cascading input INK corresponds to the start response of sensor inputs IN1 and IN2 (autostart or monitored start).

The cascading input INK can be triggered with floating or solid-state contact blocks (switching to P potential). Floating contact blocks must be connected between A1 / +24 V (identical potential to A1) and the cascading input.

3. Normal switching duty

The INK cascading input can also be used for normal switching duty (not safe).

The INK cascading input can be activated in this case with floating contact blocks or with solid-state contact blocks (switching to P potential).

Floating contact blocks must be connected between A1 / +24 V and INK .

It is important to note that the start function of cascading input INK corresponds to the start function of sensor inputs IN1, IN2.

When using a 3SK1 safety relay with instantaneous and time-delayed contacts, the two following safety notes must always be observed:

NOTICE
In the event of external faults such as: <ul style="list-style-type: none">• Cross-circuit fault• Short circuit to ground• Current-source short circuit and to access the configuration mode for copying a delay time after a reset, the following device behavior must always be taken into account: The outputs of stop category 0 switch instantaneously, while the outputs of stop category 1 have a time delay. The sequence cannot be interrupted. Exception: Switching off the power supply.

NOTICE
If the safe state is restored during the time delay, (e.g. the protective door is closed) and the START button is actuated, the enabling circuits switch to the active position immediately after the delay time has elapsed. The actuation of the START button is saved.

NOTICE
Observe the following in the case of protective doors with tumblers: If the voltage U_s is disconnected on devices with time-delayed outputs between switching the instantaneous outputs and the time-delayed outputs, the delay time expires when the voltage U_s is restored, and the time-delayed contacts change their switch positions.

10.3 Modes

The 3SK1 safety relays have four main operating modes:

- Power-up
- Configuration mode
- Safety mode
- Error mode

Power-up

On powering up (up to 7 seconds), the 3SK1 safety relay runs through a complete function test.

Configuration mode

A saved configuration can only be modified in configuration mode.

The configuration must only ever be modified after disconnecting the power supply.

If the device detects a configuration change during the restart (DIP, PAR, potentiometer, input expansion, output expansion), it does not change automatically to safety mode after power up, but instead remains in configuration mode.

In configuration mode, the LEDs (yellow) whose DIP switch position is ON (right) flash; all other parameter settings are not explicitly indicated.

The configuration is accepted by pressing the SET/RESET button for approximately 1s.

In configuration mode, the device is in the safe state. No monitoring functions are active.

Note

A configuration change made during operation is not accepted, and in safety mode, this is indicated by a yellow/green flashing "DEVICE" LED. The device can be restarted by performing a RESET (pressing the SET/RESET button) or by disconnecting and reconnecting the supply voltage.

Safety mode (DEVICE LED: green)

In safety mode, all monitoring functions are active in accordance with the set configuration.

Note

Parameterized startup testing is indicated by a green flashing "DEVICE" LED. Only when this has been successfully executed does the "DEVICE" LED show a green light.

Error mode

Error mode is indicated by a red "DEVICE" LED or by a red "SF" LED. In error mode, the device **ALWAYS** changes to the safe state.

10.4 Response times

Verification of response times in the case of safety circuits

When safety equipment is commissioned, steps must be taken to verify that a safety-related output will switch off within a maximum permissible response time if the input signal changes at the relevant input.

To provide this verification, you must determine the total response time of the application you have configured.

Note

Note that the calculation of the response time affects the level of safety and governs the overall design of the system.

You can find the response data of the safety relays in the technical specifications of the respective devices in the chapter "Technical data (Page 209)".

You can find the response data of the 3RM1 Failsafe motor starters in the technical specifications in the manual "SIRIUS 3RM1 motor starters (<http://support.automation.siemens.com/WW/view/EN/66295730>)".

Calculation of the response times


To calculate the response times of the overall system configuration, you must add up the individual response times of all input expansions affected by deactivation and also the response time of the basic unit.

If output expansions are used, the response times of the relevant output module are also added to the total time from the sensor to the actuator.

Examples

Example 1

3SK1121-.AB40 + 3SK1211.BB40

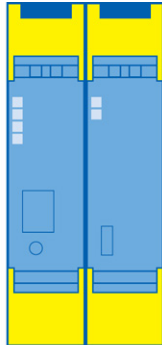


Response time: 40 ms 50 ms

Example 2

3 x 3SK1220 + 3SK1122-.AB40 + 3SK1211-.BB40 + 3RM1 Failsafe motor starter

Sensor: 4 3 2 1

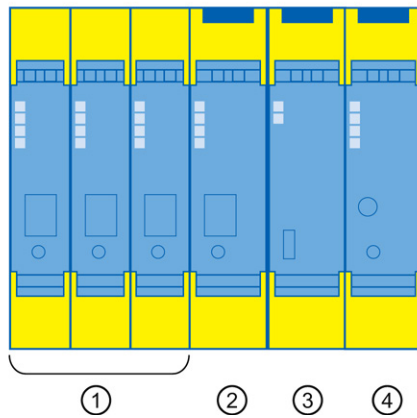

- ① 3SK1220 input expansions
- ② 3SK1122 basic unit
- ③ 3SK1211 output expansion
- ④ 3RM1 Failsafe motor starters

Abbreviations in the following formulas:

GG = basic unit; EE = input expansion; AE = output expansion

In the event of shutdown by sensor 1, the total response time is calculated as follows:

- Basic unit = 40 ms
- 3SK1211 output expansion = $GG + AE = 40 \text{ ms} + 10 \text{ ms} = 50 \text{ ms}$
- 3RM1 Failsafe = $GG + 3RM1 \text{ Failsafe} = 40 \text{ ms} + 3RM1 \text{ Failsafe motor starter response time}$

In the event of shutdown by sensor 3, the total response time is calculated as follows:

- Basic unit = $GG + EE 1 + EE 2 = 3 \times 40 \text{ ms} = 120 \text{ ms}$
- 3SK1211 output expansion = $GG + EE 1 + EE 2 + AE 3SK1211 = 120 \text{ ms} + 10 \text{ ms} = 130 \text{ ms}$
- 3RM1 Failsafe = $120 \text{ ms} + 3RM1 \text{ Failsafe motor starter response time}$

In the event of shutdown by sensor 4, the total response time is calculated as follows:

- Basic unit = $3 \times \text{response time EE} + \text{response time GG} = 160 \text{ ms}$
- 3SK1211 output expansion = $\text{total response time EE with GG} + AE = 170 \text{ ms}$
- 3RM1 Failsafe = $160 \text{ ms} + 3RM1 \text{ Failsafe motor starter response time}$

Note

Since commissioning of the 3SK1 safety relays is an important, safety-related step, it must be carried out by qualified personnel.

 WARNING**Hazardous Voltage**

**Can Cause Death, Serious Injury, or Property Damage.
Carry out function test of the plant.**

To ensure the safety of the system, a full functional test of the system must be conducted after commissioning, and a successful result obtained.

Commissioning 3SK1 safety relays

3SK1 safety relays are commissioned by applying the operating voltage.

After the supply voltage has been applied, all LEDs show a green light for about 1 s (lamp test). The LEDs then go out for approx. 0.5 s. The configuration of the device is then displayed on the configuration LEDs for approx. 3 s.

If no configuration change (DIP, PAR, potentiometer, input expansion, output expansion) has been detected, the device changes automatically to safety mode and is ready for operation. However, if the device detects a deviation of the set parameters from the saved configuration, it remains in safe configuration mode until the new configuration is accepted by pressing the SET/RESET button.

Note

Observe the following during commissioning:

The cascading input must be jumpered (24 V DC) if it is not to be used.

Monitoring of the feedback circuits is not optional.

Display and diagnostics

12.1 LED display

The LED indications of the Advanced safety relays are shown in the tables below. You can find the LED indications of the Standard safety relays in the chapter "Display of the operating state (Page 52)".

LED	Display	Explanation
(1) DEVICE	OFF*	No voltage, group error Configuration mode DIP (1) position: left
	Green	Device is ready for operation Power-up: hardware test
	Green flashing	Missing startup testing Short-circuit on the SET/RESET button
	Yellow	Power-up DIP (1) position: right
	Yellow flashing	Configuration mode DIP (1) position: right
	Green/yellow flashing	Configuration changed
	Red	Device error
(2) OUT	OFF*	Output inactive Configuration mode DIP (2) position: left
	Green	Output active Power-up: hardware test
	Green flashing	Feedback circuit error Short-circuit on the SET/RESET button
	Yellow	Power-up DIP (2) position: right
	Yellow flashing	Configuration mode DIP (2) position: right START button pressed too long
	Green/yellow flashing	Instantaneous outputs inactive, delayed outputs active

12.1 LED display

LED	Display	Explanation
(3) IN	OFF*	Start conditions not fulfilled Configuration mode DIP (3) position: left
	Green	Start conditions fulfilled Power-up: hardware test
	Green flashing	<ul style="list-style-type: none"> For 1x2-channel: Simultaneity of sensors not fulfilled Two-hand operation: time monitoring violated For monitored start: START button not yet pressed Short-circuit on the SET/RESET button
	Yellow	Power-up DIP (3) position: right
	Yellow flashing	Short-circuit of T1/T2 to ground or 24 V With input expansion: missing enabling signal of input expansion Group error: Cross-circuit at input Configuration mode DIP (3) position: right
	Flickering yellow	Configuration mode: Special two-hand operation configuration
	Flickering red	Configuration mode: impermissible configuration
(4) SF	OFF*	No group error Configuration mode DIP (4) position: left
	Green	Power-up: hardware test
	Green flashing	Short-circuit on the SET/RESET button
	Yellow	Power-up DIP (4) position: right
	Yellow flashing	Configuration mode DIP (4) position: right
	Red	Group error (e.g. cross-circuit at input, short-circuit to P, device configuration changed)
	Red flashing	Error message (e.g. short-circuit T1/T2, violation of simultaneity, violation of two-hand operation timeout, feedback circuit error, START-button pressed too long)

* LED flashes briefly in configuration mode due to lamp test

12.2 Power-up

Display mode during power-up / parameterization in configuration mode

LED	Display	Explanation
(1) DEVICE	Yellow or yellow flashing	Monitored start
	Off	Autostart
(2) OUT	Yellow or yellow flashing	Cross-circuit detection ON
	Off	Cross-circuit detection off
(3) IN	Yellow or yellow flashing	1 x two-channel
	Flickering yellow	Configuration mode: Special two-hand operation configuration
	Flickering red	Configuration mode: impermissible configuration
	Off	2 x single-channel
(4) SF	Yellow or yellow flashing	Startup testing off
	Off	Startup testing ON

12.3 Error statuses

LED	Display	Explanation
(1) DEVICE	Red	Device error
(4) SF	Red	Group error
	Red flashing	Fault message

12.4 Diagnostics

Power-up

Explanation	DEVICE	OUT	IN	SF
Hardware test (note: (input expansions remain in this state until acknowledged by the device on the right-hand side)	Green	Green	Green	Green
The SET/RESET button is stuck, or has been pressed too long. The device remains in this state until the button is released again.	Green flashing	Green flashing	Green flashing	Green flashing
Display of DIP switch configuration	If the DIP switch position is at ON (right), the relevant LED shows a yellow light			

Configuration

Explanation	DEVICE	OUT	IN	SF
Indication of a modified configuration	If the DIP switch position is at ON (right), the relevant LED flashes yellow			
Special configuration, two-hand operation (NC/NO, autostart, 2x1-channel)	Off	If the DIP switch position is at ON (right), the relevant LED flashes yellow	Flickering yellow	If the DIP switch position is at ON (right), the relevant LED flashes yellow
Impermissible configuration (NC/NO, monitored start, 2x1-channel)	Yellow flashing	If the DIP switch position is at ON (right), the relevant LED flashes yellow	Flickering red	If the DIP switch position is at ON (right), the relevant LED flashes yellow
All DIP switches are at OFF (left)	All LEDs light up briefly (yellow) at intervals			

Safety mode

Explanation	DEVICE	OUT	IN	SF
No startup testing	Green flashing	Off	Off	Off
Device ready for operation, all outputs OFF	Green	Off	Off	Off
Device ready for operation, all outputs ON	Green	Green	Green	Off
Device ready for operation, instantaneous outputs OFF, time-delayed outputs ON	Green	Green/yellow flashing	Off	Off
For monitored start: START button not yet pressed	Green	Off	Green flashing	Off
With input expansion: missing enabling signal of input expansion	Green	Off	Yellow flashing	Off
Configuration has been changed (PAR, DIP switch, potentiometer)	Green/yellow flashing	— ¹⁾	— ¹⁾	— ¹⁾
For 1x2-channel: Simultaneity violated For two-hand operation: time monitoring violated	Green	Off	Green flashing	Red flashing
Short-circuit test clock output T1 or T2	Green ²⁾	Off	Yellow flashing	Red flashing
For monitored start: START button was pressed too long or has a short-circuit	Green	Yellow flashing	Off	Red flashing
Feedback circuit error	Green	Green flashing	Green	Red flashing

¹⁾ Dependent on device status

²⁾ Green flashing DEVICE LED: No startup testing

Error mode

Explanation	DEVICE	OUT	IN	SF
Device fault (restart possible by pressing the SET/RESET button)	Red	Off ³⁾	Off ³⁾	Off ³⁾
Group error (restart possible by pressing the SET/RESET button)	Off ³⁾	Off ³⁾	Off ³⁾	Red
Group error, cross-circuit at the input (restart possible by pressing the SET/RESET button)	Off ³⁾	Off ³⁾	Flashing yellow ³⁾	Red
System stop (restart possible by disconnecting and re-connecting the operating voltage)	Red	Off ³⁾	Off ³⁾	Red

³⁾ On time-delayed devices, the LED flashes green/yellow provided the time-delayed outputs are still switched on

Technical data

13.1 General technical data

Technical data valid for all 3SK1 products in this manual.

Product brand name		SIRIUS
Product designation		Safety relay
Version of the product		for EMERGENCY STOP and protective doors
IP degree of protection of the enclosure		IP20
Touch protection against electric shock		Safe from finger-touch
Ambient temperature • during storage • during operation	°C	-40 ... +80 -25 ... +60
Air pressure Comply with the instructions given for the respective device • according to SN 31205	hPa	900 ... 1060
Relative air humidity • During operation without condensation	%	10 ... 95
Maximum operating altitude above MSL	m	2000
Vibration resistance according to IEC 60068-2-6		5 ... 500 Hz: 0.75 mm
Degree of pollution		3
Overvoltage category		III
Distance to be maintained at the side with side-by-side mounting	mm	0
Distance to be maintained at the side from grounded parts	mm	5
DC_{avg} average diagnostics coverage level		> 99 %
MTTF_d Mean Time To dangerous Failure		> 30 years
Item designation In accordance with DIN 40719, expanded in accordance with IEC 204-2 and IEC 750		-
Item designation in accordance with DIN EN 61346-2		F
Hardware failure tolerance in accordance with IEC 61508		1

13.1 General technical data

Mounting position		Any (except 3SK1213) 3SK1213: +/- 22.5° lateral inclination	
Type of fixing		Snap-on mounting Comply with the instructions given for the respective device	
Type of electrical connection		3SK....-1.... screw-type	3SK....-2.... push-in connection
Maintenance		The 3SK1 safety relays are maintenance-free	
Certificate of suitability		Yes (except 3SK1230)	
<ul style="list-style-type: none"> • TÜV approval • UL certification • CSA approval 		Yes	
		Yes	

Electrical service life of 3SK1 safety relays

Note

When using the devices to equip furnaces to DIN EN 50156-1, the load (utilization category) listed below must not be exceeded.

Electrical service life \geq 250000 operating cycles at:

Utilization category	3SK111; 3SK1121; 3SK1211	3SK1213
AC-1, 240 V	1.5 A	10.0 A
AC-15, 240 V	0.2 A	10.0 A
DC-13, 24 V	2.0 A	3.0 A

B10_d values for 3SK1 safety relays

Device versions:

- 3SK1121-.AB40
- 3SK1111-.AB30
- 3SK1111-.AW20
- 3SK1211-.BB40
- 3SK1211-.BB00
- 3SK1211-.BW20

Utilization category	U _e (V)	I _e (A)	B10 _d value (operating cycles)
AC-1	240	5	500000
		4	860000
		2	1300000
AC-15	240	4	300000
		3	850000
		1	1100000
DC-13	24	5	300000
		2	2000000
		1	7000000

Device version:

3SK1121-.CB4.

Utilization category	U _e (V)	I _e (A)	B10 _d value (operating cycles)
AC-1	240	5	500000
		4	600000
		2	1000000
AC-15	240	3	400000
		0,1	10000000
DC-13	24	3	450000
		1	2000000

13.1 General technical data

Device versions:
 3SK1213-.AB40
 3SK1213-.AJ20
 3SK1213-.AL20

Utilization category	Ue (V)	Ie (A)	B10 _d value (operating cycles)
AC-1	240	10	1370000
AC-15	240	10	1370000
DC-13	24	6	1370000

PFH and PFDavg values of 3SK1 safety relays

The table below shows the values of the:

- Average frequency of a hazardous failure of the safety function per hour (**PFH**) at a high demand rate in accordance with IEC 61508.
- Average probability of failure of the safety function upon demand (**PFDavg**) at a low demand rate in accordance with IEC 61508.

Safety relay	PFH [1/h] less than	PFDavg less than
3SK1111-.AB30	1.7 E ⁻⁰⁹	1.0 E ⁻⁰⁶
3SK1111-.AW20	1.5 E ⁻⁰⁹	1.0 E ⁻⁰⁶
3SK1112-.BB40	1.0 E ⁻⁰⁹	7.0 E ⁻⁰⁶
3SK1121-.AB40	2.5 E ⁻⁰⁹	7.0 E ⁻⁰⁶
3SK1121-.CB41	3.7 E ⁻⁰⁹	7.0 E ⁻⁰⁶
3SK1121-.CB42	3.7 E ⁻⁰⁹	7.0 E ⁻⁰⁶
3SK1121-.CB44	3.7 E ⁻⁰⁹	7.0 E ⁻⁰⁶
3SK1122-.AB40	1.3 E ⁻⁰⁹	7.0 E ⁻⁰⁶
3SK1122-.CB41	1.5 E ⁻⁰⁹	7.0 E ⁻⁰⁶
3SK1122-.CB42	1.5 E ⁻⁰⁹	7.0 E ⁻⁰⁶
3SK1122-.CB44	1.5 E ⁻⁰⁹	7.0 E ⁻⁰⁶
3SK1120-.AB40	1.3 E ⁻⁰⁹	7.0 E ⁻⁰⁶
3SK1211-.BB40	1.7 E ⁻⁰⁹	1.0 E ⁻⁰⁶
3SK1211-.BB00	1.7 E ⁻⁰⁹	1.0 E ⁻⁰⁶
3SK1211-.BW20	1.7 E ⁻⁰⁹	1.0 E ⁻⁰⁶
3SK1213-.AB40	1.0 E ⁻⁰⁹	1.0 E ⁻⁰⁶
3SK1213-.AJ20	1.0 E ⁻⁰⁹	1.0 E ⁻⁰⁶
3SK1213-.AL20	1.0 E ⁻⁰⁹	1.0 E ⁻⁰⁶
3SK1220-.AB40	1.0 E ⁻⁰⁹	7.0 E ⁻⁰⁶

You will find further technical data in the "Technical Data" chapters of each product and in the "Dimension Drawings" chapter.

13.2 Basic units

13.2.1 Standard

13.2.1.1 Technical data for 3SK1111 Standard relay basic unit

		3SK1111-.AB..	3SK1111-.AW..
Insulation voltage rated value	V	300	
Resistance against shock		10g / 11 ms	
Number of sensor inputs 1-channel or 2-channel		1	
Design of the cascading		none	
Type of the safety-related wiring of the inputs		single-channel and two-channel	
Product feature transverse contact-secure		Yes	
Safety Integrity Level (SIL)		SIL3	
<ul style="list-style-type: none"> • according to IEC 61508 • for delayed release circuit according to IEC 61508 		—	
Performance Level (PL)		e	
<ul style="list-style-type: none"> • according to ISO 13849-1 • for delayed release circuit according to ISO 13849-1 		—	
Category according to ISO 13849-1		4	
Safe failure fraction (SFF)	%	99	
T1 value for proof test interval or service life according to IEC 61508	a	20	
Hardware fault tolerance according to IEC 61508		1	
Safety device type according to IEC 61508-2		Type A	

		3SK1111-AB..	3SK1111-AW..
Number of outputs			
<ul style="list-style-type: none"> • as contact-affected switching element <ul style="list-style-type: none"> – as NC contact for reporting function instantaneous switching – as NO contact for reporting function instantaneous switching – as NC contact for reporting function delayed switching – as NO contact for reporting function delayed switching – as NC contact safety-related instantaneous switching – as NO contact safety-related instantaneous switching – as NC contact safety-related delayed switching – as NO contact safety-related delayed switching • as contact-less semiconductor switching element <ul style="list-style-type: none"> – safety-related – delayed switching – non-delayed – for reporting function – delayed switching – non-delayed 		<p>1</p> <p>0</p> <p>0</p> <p>0</p> <p>0</p> <p>3</p> <p>0</p> <p>—</p>	
Stop category according to DIN EN 60204-1			0
Design of the input			
<ul style="list-style-type: none"> • cascading-input/functional switching • feedback input • start input 		No	Yes
Design of the electrical connection jumper socket			No
Operating cycles maximum	1/h		360
Switching capacity current of the semiconductor outputs at DC-13 at 24 V	A		—

		3SK1111-.AB..	3SK1111-.AW..
Switching capacity current of the NO contacts of the relay outputs			
• at DC-13			
– at 24 V	A		5
– at 115 V	A		0.2
– at 230 V	A		0.1
• at AC-15			
– at 115 V	A		5
– at 230 V	A		5
Switching capacity current of the NC contacts of the relay outputs			
• at DC-13			
– at 24 V	A		1
– at 115 V	A		0.2
– at 230 V	A		0.1
• at AC-15			
– at 115 V	A		1.5
– at 230 V	A		1.5
Thermal current of the contact-affected switching element maximum	A		5
Total current maximum	A		12
Mechanical operating cycles as operating time typical			10 000 000
Max. permissible voltage for safe isolation between electronic evaluation device and enabling circuit according to EN 60947-1	V		—
Design of the fuse link for short-circuit protection of the NO contacts of the relay outputs required		gL/gG: 6A or circuit breaker type A: 3A or circuit breaker type B: 2A or circuit breaker type C: 1A	

		3SK1111-AB..	3SK1111-AW..
Make time			
• with automatic start			
– typical	s	0.2	0.11
– for DC maximum	s	0.32	0.13
– for AC maximum	s	0.32	0.13
– after mains power cut			
– typical	s	0.2	0.11
– maximum	s	0.32	0.13
• with monitored start			
– typical	s	0.015	
– maximum	s	0.02	0.015
Backslide delay time			
• after opening of the safety circuits typical	s		0.01
• at mains power cut			
– typical	s	0.065	0.2
– maximum	s	0.075	0.3
Adjustable backslide delay time			
• after opening of the safety circuits	s		—
Recovery time			
• after opening of the safety circuits typical	s		0.01
• after mains power cut typical	s	0.09	0.32
Pulse duration			
• of the sensor input minimum	s		0.15
• of the ON pushbutton input minimum	s		0.015
• of the cascading-entrance minimum	s		—
Type of voltage of the controlled supply voltage		AC/DC	
Control supply voltage frequency			
• 1 rated value	Hz		50
• 2 rated value	Hz		60

		3SK1111-.AB..	3SK1111-.AW..
Control supply voltage			
• for DC rated value	V	24	—
– minimum	V	—	110
– maximum	V	—	240
• at 50 Hz at AC rated value	V	24	—
– minimum	V	—	110
– maximum	V	—	240
• at 60 Hz at AC rated value	V	24	—
– minimum	V	—	110
– maximum	V	—	240
Operating range factor control supply voltage rated value of the magnet coil			
• at 50 Hz for AC			0.85 1.1
• at 60 Hz for AC			0.85 1.1
• for DC			0.85
		1.2	1.1
Active power loss typical	W	2	2.5
Contact reliability of the auxiliary contacts			—
Product function parameterizable		Sensor floating / sensor non-floating, monitored start / autostart	Sensor floating / monitored start / autostart
Suitability for use device connector 3ZY12			No
Suitability for interaction pressing control			No
Suitability for use			
• safety cut-out switch			Yes
• monitoring of floating sensors			Yes
• monitoring of non-floating sensors		Yes	No
• magnetically operated switches monitoring		Yes	No
• safety-related circuits			Yes

13.2.1.2 Technical data for 3SK1112 Standard solid-state basic unit

		3SK1112-BB..
Insulation voltage rated value	V	50
Resistance against shock		10g / 11 ms
Number of sensor inputs 1-channel or 2-channel		1
Design of the cascading		yes
Type of the safety-related wiring of the inputs		single-channel and two-channel
Product feature transverse contact-secure		Yes
Safety Integrity Level (SIL)		
• according to IEC 61508		SIL3
• for delayed release circuit according to IEC 61508		—
Performance Level (PL)		
• according to ISO 13849-1		e
• for delayed release circuit according to ISO 13849-1		—
Category according to ISO 13849-1		4
Safe failure fraction (SFF)	%	99
T1 value for proof test interval or service life according to IEC 61508	a	20
Hardware fault tolerance according to IEC 61508		1
Safety device type according to IEC 61508-2		Type B
Number of outputs		
• as contact-affected switching element		
– as NC contact for reporting function instantaneous switching		0
– as NO contact for reporting function instantaneous switching		0
– as NC contact for reporting function delayed switching		0
– as NO contact for reporting function delayed switching		0
– as NC contact safety-related instantaneous switching		0
– as NO contact safety-related instantaneous switching		—
– as NC contact safety-related delayed switching		0
– as NO contact safety-related delayed switching		—
• as contact-less semiconductor switching element		
– safety-related		
– delayed switching		0
– non-delayed		2
– for reporting function		
– delayed switching		—
– non-delayed		1

		3SK1112-.BB..
Stop category according to DIN EN 60204-1		0
Design of the input		
• cascading-input/functional switching		Yes
• feedback input		Yes
• start input		Yes
Design of the electrical connection jumper socket		No
Operating cycles maximum	1/h	2 000
Switching capacity current of the semiconductor outputs at DC-13 at 24 V	A	2
Switching capacity current of the NO contacts of the relay outputs		
• at DC-13		
– at 24 V	A	—
– at 115 V	A	—
– at 230 V	A	—
• at AC-15		
– at 115 V	A	—
– at 230 V	A	—
Switching capacity current of the NC contacts of the relay outputs		
• at DC-13		
– at 24 V	A	—
– at 115 V	A	—
– at 230 V	A	—
• at AC-15		
– at 115 V	A	—
– at 230 V	A	—
Thermal current of the contact-affected switching element maximum	A	—
Total current maximum	A	—
Mechanical operating cycles as operating time typical		—
Max. permissible voltage for safe isolation between electronic evaluation device and enabling circuit according to EN 60947-1	V	—
Design of the fuse link for short-circuit protection of the NO contacts of the relay outputs required		not required

		3SK1112-BB..
Make time		
• with automatic start		
– typical	s	—
– for DC maximum	s	0.085
– for AC maximum	s	—
– after mains power cut		
– typical	s	6.5
– maximum	s	6.5
• with monitored start		
– typical	s	—
– maximum	s	0.085
Backslide delay time		
• after opening of the safety circuits typical	s	0.04
• at mains power cut		
– typical	s	0
– maximum	s	0
Adjustable backslide delay time		
• after opening of the safety circuits	s	—
Recovery time		
• after opening of the safety circuits typical	s	0.03
• after mains power cut typical	s	6.5
Pulse duration		
• of the sensor input minimum	s	0.06
• of the ON pushbutton input minimum	s	0.15
• of the cascading-entrance minimum	s	—
Type of voltage of the controlled supply voltage		DC
Control supply voltage frequency		
• 1 rated value	Hz	—
• 2 rated value	Hz	—

		3SK1112-.BB..
Control supply voltage		
• for DC rated value	V	24
– minimum	V	—
– maximum	V	—
• at 50 Hz at AC rated value	V	—
– minimum	V	—
– maximum	V	—
• at 60 Hz at AC rated value	V	—
– minimum	V	—
– maximum	V	—
Operating range factor control supply voltage rated value of the magnet coil		
• at 50 Hz for AC		—
• at 60 Hz for AC		—
• for DC		0.8
		1.2
Active power loss typical	W	2
Contact reliability of the auxiliary contacts		—
Product function parameterizable		Sensor floating / sensor non-floating, monitored start / autostart, 1-channel / 2-channel sensor connection, cross-circuit detection, startup testing
Suitability for use device connector 3ZY12		No
Suitability for interaction pressing control		No
Suitability for use		
• safety cut-out switch		Yes
• monitoring of floating sensors		Yes
• monitoring of non-floating sensors		Yes
• magnetically operated switches monitoring		Yes
• safety-related circuits		Yes

13.2.2 Advanced

13.2.2.1 Technical data for 3SK1120 Advanced solid-state basic unit

		3SK1120-AB..
Insulation voltage rated value	V	50
Resistance against shock		10g / 11 ms
Number of sensor inputs 1-channel or 2-channel		1
Design of the cascading		yes
Type of the safety-related wiring of the inputs		single-channel and two-channel
Product feature transverse contact-secure		Yes
Safety Integrity Level (SIL)		SIL3
<ul style="list-style-type: none"> • according to IEC 61508 • for delayed release circuit according to IEC 61508 		—
Performance Level (PL)		e
<ul style="list-style-type: none"> • according to ISO 13849-1 • for delayed release circuit according to ISO 13849-1 		—
Category according to ISO 13849-1		4
Safe failure fraction (SFF)	%	99
T1 value for proof test interval or service life according to IEC 61508	a	20
Hardware fault tolerance according to IEC 61508		1
Safety device type according to IEC 61508-2		Type B

		3SK1120-AB..
Number of outputs		
• as contact-affected switching element		
– as NC contact for reporting function instantaneous switching		0
– as NO contact for reporting function instantaneous switching		0
– as NC contact for reporting function delayed switching		0
– as NO contact for reporting function delayed switching		0
– as NC contact safety-related instantaneous switching		0
– as NO contact safety-related instantaneous switching		—
– as NC contact safety-related delayed switching		0
– as NO contact safety-related delayed switching		—
• as contact-less semiconductor switching element		
– safety-related		
– delayed switching		0
– non-delayed		1
– for reporting function		
– delayed switching		—
– non-delayed		0
Stop category according to DIN EN 60204-1		0
Design of the input		
• cascading-input/functional switching		Yes
• feedback input		Yes
• start input		Yes
Design of the electrical connection jumper socket		No
Operating cycles maximum	1/h	2 000
Switching capacity current of the semiconductor outputs at DC-13 at 24 V	A	0.5
Switching capacity current of the NO contacts of the relay outputs		
• at DC-13		
– at 24 V	A	—
– at 115 V	A	—
– at 230 V	A	—
• at AC-15		
– at 115 V	A	—
– at 230 V	A	—

		3SK1120-.AB..
Switching capacity current of the NC contacts of the relay outputs		
• at DC-13		
– at 24 V	A	—
– at 115 V	A	—
– at 230 V	A	—
• at AC-15		
– at 115 V	A	—
– at 230 V	A	—
Thermal current of the contact-affected switching element maximum	A	—
Total current maximum	A	—
Mechanical operating cycles as operating time typical		—
Max. permissible voltage for safe isolation between electronic evaluation device and enabling circuit according to EN 60947-1	V	—
Design of the fuse link for short-circuit protection of the NO contacts of the relay outputs required		not required
Make time		
• with automatic start		
– typical	s	—
– for DC maximum	s	0.085
– for AC maximum	s	—
– after mains power cut		
– typical	s	6.5
– maximum	s	6.5
• with monitored start		
– typical	s	—
– maximum	s	0.085
Backslide delay time		
• after opening of the safety circuits typical	s	0.04
• at mains power cut		
– typical	s	0
– maximum	s	0
Adjustable backslide delay time		
• after opening of the safety circuits	s	—
		—
Recovery time		
• after opening of the safety circuits typical	s	0.03
• after mains power cut typical	s	6.5

		3SK1120-AB..
Pulse duration		
• of the sensor input minimum	s	0.06
• of the ON pushbutton input minimum	s	0.15
• of the cascading-entrance minimum	s	—
Type of voltage of the controlled supply voltage		DC
Control supply voltage frequency		
• 1 rated value	Hz	—
• 2 rated value	Hz	—
Control supply voltage		
• for DC rated value	V	24
– minimum	V	—
– maximum	V	—
• at 50 Hz at AC rated value	V	—
– minimum	V	—
– maximum	V	—
• at 60 Hz at AC rated value	V	—
– minimum	V	—
– maximum	V	—
Operating range factor control supply voltage rated value of the magnet coil		
• at 50 Hz for AC		—
		—
• at 60 Hz for AC		—
		—
• for DC		0.8
		1.2
Active power loss typical	W	2
Contact reliability of the auxiliary contacts		—
Product function parameterizable		Sensor floating / sensor non-floating, monitored start / autostart, 1-channel / 2-channel sensor connection, cross-circuit detection, startup testing, antivalent sensors, 2-hand switches

	3SK1120-.AB..
Suitability for use device connector 3ZY12	Yes
Suitability for interaction pressing control	No
Suitability for use	
• safety cut-out switch	Yes
• monitoring of floating sensors	Yes
• monitoring of non-floating sensors	Yes
• magnetically operated switches monitoring	Yes
• safety-related circuits	Yes

13.2.2.2 Technical data for 3SK1121 Advanced relay instantaneous basic unit

		3SK1121-.AB..
Insulation voltage rated value	V	300
Resistance against shock		10g / 11 ms
Number of sensor inputs 1-channel or 2-channel		1
Design of the cascading		yes
Type of the safety-related wiring of the inputs		single-channel and two-channel
Product feature transverse contact-secure		Yes
Safety Integrity Level (SIL)		
• according to IEC 61508		SIL3
• for delayed release circuit according to IEC 61508		—
Performance Level (PL)		
• according to ISO 13849-1		e
• for delayed release circuit according to ISO 13849-1		—
Category according to ISO 13849-1		4
Safe failure fraction (SFF)	%	99
T1 value for proof test interval or service life according to IEC 61508	a	20
Hardware fault tolerance according to IEC 61508		1
Safety device type according to IEC 61508-2		Type B
Number of outputs		
• as contact-affected switching element		
– as NC contact for reporting function instantaneous switching		1
– as NO contact for reporting function instantaneous switching		0
– as NC contact for reporting function delayed switching		0
– as NO contact for reporting function delayed switching		0
– as NC contact safety-related instantaneous switching		0
– as NO contact safety-related instantaneous switching		3
– as NC contact safety-related delayed switching		0
– as NO contact safety-related delayed switching		—
• as contact-less semiconductor switching element		
– safety-related		
– delayed switching		0
– non-delayed		0
– for reporting function		
– delayed switching		—
– non-delayed		0

		3SK1121-AB..
Stop category according to DIN EN 60204-1		0
Design of the input		
• cascading-input/functional switching		Yes
• feedback input		Yes
• start input		Yes
Design of the electrical connection jumper socket		No
Operating cycles maximum	1/h	360
Switching capacity current of the semiconductor outputs at DC-13 at 24 V	A	—
Switching capacity current of the NO contacts of the relay outputs		
• at DC-13		
– at 24 V	A	5
– at 115 V	A	0.2
– at 230 V	A	0.1
• at AC-15		
– at 115 V	A	5
– at 230 V	A	5
Switching capacity current of the NC contacts of the relay outputs		
• at DC-13		
– at 24 V	A	1
– at 115 V	A	0.2
– at 230 V	A	0.1
• at AC-15		
– at 115 V	A	1.5
– at 230 V	A	1.5
Thermal current of the contact-affected switching element maximum	A	5
Total current maximum	A	12
Mechanical operating cycles as operating time typical		10 000 000
Max. permissible voltage for safe isolation between electronic evaluation device and enabling circuit according to EN 60947-1	V	—
Design of the fuse link for short-circuit protection of the NO contacts of the relay outputs required		gL/gG: 6A or circuit breaker type A: 3A or circuit breaker type B: 2A or circuit breaker type C: 1A

		3SK1121-AB..
Make time		
• with automatic start		
– typical	s	—
– for DC maximum	s	0.11
– for AC maximum	s	—
– after mains power cut		
– typical	s	6.5
– maximum	s	6.5
• with monitored start		
– typical	s	—
– maximum	s	0.11
Backslide delay time		
• after opening of the safety circuits typical	s	0.04
• at mains power cut		
– typical	s	0.03
– maximum	s	0.05
Adjustable backslide delay time		
• after opening of the safety circuits	s	—
		—
Recovery time		
• after opening of the safety circuits typical	s	0.03
• after mains power cut typical	s	6.5
Pulse duration		
• of the sensor input minimum	s	0.075
• of the ON pushbutton input minimum	s	0.15
• of the cascading-entrance minimum	s	—

		3SK1121-AB..
Type of voltage of the controlled supply voltage		DC
Control supply voltage frequency		
• 1 rated value	Hz	—
• 2 rated value	Hz	—
Control supply voltage		
• for DC rated value	V	24
– minimum	V	—
– maximum	V	—
• at 50 Hz at AC rated value	V	—
– minimum	V	—
– maximum	V	—
• at 60 Hz at AC rated value	V	—
– minimum	V	—
– maximum	V	—
Operating range factor control supply voltage rated value of the magnet coil		
• at 50 Hz for AC		—
		—
• at 60 Hz for AC		—
		—
• for DC		0.8
		1.2
Active power loss typical	W	2
Contact reliability of the auxiliary contacts		
—		
Product function parameterizable		
Sensor floating / sensor non-floating, monitored start / autostart, 1-channel / 2-channel sensor connection, cross-circuit detection, startup testing, antivalent sensors, 2-hand switches		
Suitability for use device connector 3ZY12		
Yes		
Suitability for interaction pressing control		
No		
Suitability for use		
• safety cut-out switch		Yes
• monitoring of floating sensors		Yes
• monitoring of non-floating sensors		Yes
• magnetically operated switches monitoring		Yes
• safety-related circuits		Yes

13.2.2.3 Technical data for 3SK1121 Advanced relay time-delayed basic unit

		3SK1121-.CB.1	3SK1121-.CB.2	3SK1121-.CB.4
Insulation voltage rated value	V		300	
Resistance against shock			10g / 11 ms	
Number of sensor inputs 1-channel or 2-channel			1	
Design of the cascading			yes	
Type of the safety-related wiring of the inputs			single-channel and two-channel	
Product feature transverse contact-secure			Yes	
Safety Integrity Level (SIL)				
• according to IEC 61508			SIL3	
• for delayed release circuit according to IEC 61508			SIL3	
Performance Level (PL)				
• according to ISO 13849-1			e	
• for delayed release circuit according to ISO 13849-1			e	
Category according to ISO 13849-1			4	
Safe failure fraction (SFF)	%		99	
T1 value for proof test interval or service life according to IEC 61508	a		20	
Hardware fault tolerance according to IEC 61508			1	
Safety device type according to IEC 61508-2			Type B	

	3SK1121-.CB.1	3SK1121-.CB.2	3SK1121-.CB.4
Number of outputs			
• as contact-affected switching element			
– as NC contact for reporting function instantaneous switching		0	
– as NO contact for reporting function instantaneous switching		0	
– as NC contact for reporting function delayed switching		0	
– as NO contact for reporting function delayed switching		0	
– as NC contact safety-related instantaneous switching		0	
– as NO contact safety-related instantaneous switching		2	
– as NC contact safety-related delayed switching		0	
– as NO contact safety-related delayed switching		2	
• as contact-less semiconductor switching element			
– safety-related			
– delayed switching		0	
– non-delayed		0	
– for reporting function			
– delayed switching		—	
– non-delayed		0	
Stop category according to DIN EN 60204-1		0 / 1	

		3SK1121-.CB.1	3SK1121-.CB.2	3SK1121-.CB.4
Design of the input				
• cascading-input/functional switching			Yes	
• feedback input			Yes	
• start input			Yes	
Design of the electrical connection jumper socket			No	
Operating cycles maximum	1/h		360	
Switching capacity current of the semiconductor outputs at DC-13 at 24 V	A		—	
Switching capacity current of the NO contacts of the relay outputs				
• at DC-13				
– at 24 V	A		3	
– at 115 V	A		0.2	
– at 230 V	A		0.1	
• at AC-15				
– at 115 V	A		3	
– at 230 V	A		3	
Switching capacity current of the NC contacts of the relay outputs				
• at DC-13				
– at 24 V	A		—	
– at 115 V	A		—	
– at 230 V	A		—	
• at AC-15				
– at 115 V	A		—	
– at 230 V	A		—	
Thermal current of the contact-affected switching element maximum	A		5	
Total current maximum	A		12	
Mechanical operating cycles as operating time typical			10 000 000	

		3SK1121-.CB.1	3SK1121-.CB.2	3SK1121-.CB.4
Max. permissible voltage for safe isolation between electronic evaluation device and enabling circuit according to EN 60947-1	V	—		
Design of the fuse link for short-circuit protection of the NO contacts of the relay outputs required		gL/gG: 6A or circuit breaker type A: 3A or circuit breaker type B: 2A or circuit breaker type C: 1A		
Make time				
• with automatic start				
– typical	s	—		
– for DC maximum	s	0.11		
– for AC maximum	s	—		
– after mains power cut				
– typical	s	6.5		
– maximum	s	6.5		
• with monitored start				
– typical	s	—		
– maximum	s	0.11		
Backslide delay time				
• after opening of the safety circuits typical	s	0.04		
• at mains power cut				
– typical	s	0.03		
– maximum	s	0.04		
Adjustable backslide delay time				
• after opening of the safety circuits	s	0.05 3	0.5 30	5 300
Recovery time				
• after opening of the safety circuits typical	s	0.03		
• after mains power cut typical	s	6.5		

		3SK1121-.CB.1	3SK1121-.CB.2	3SK1121-.CB.4
Pulse duration				
• of the sensor input minimum	s		0.075	
• of the ON pushbutton input minimum	s		0.15	
• of the cascading-entrance minimum	s		—	
Type of voltage of the controlled supply voltage			DC	
Control supply voltage frequency				
• 1 rated value	Hz		—	
• 2 rated value	Hz		—	
Control supply voltage				
• for DC rated value	V		24	
– minimum	V		—	
– maximum	V		—	
• at 50 Hz at AC rated value	V		—	
– minimum	V		—	
– maximum	V		—	
• at 60 Hz at AC rated value	V		—	
– minimum	V		—	
– maximum	V		—	
Operating range factor control supply voltage rated value of the magnet coil				
• at 50 Hz for AC			—	
			—	
• at 60 Hz for AC			—	
			—	
• for DC			0.8	
			1.2	
Active power loss typical	W		2.5	
Contact reliability of the auxiliary contacts			—	

	3SK1121-CB.1	3SK1121-CB.2	3SK1121-CB.4
Product function parameterizable	Sensor floating / sensor non-floating, monitored start / autostart, 1-channel / 2-channel sensor connection, cross-circuit detection, startup testing, antivalent sensors, 2-hand switches, time delay		
Suitability for use device connector 3ZY12	Yes		
Suitability for interaction pressing control	No		
Suitability for use			
• safety cut-out switch	Yes		
• monitoring of floating sensors	Yes		
• monitoring of non-floating sensors	Yes		
• magnetically operated switches monitoring	Yes		
• safety-related circuits	Yes		

13.2.2.4 Technical data for 3SK1122 Advanced solid-state instantaneous basic unit

		3SK1122-.AB..
Insulation voltage rated value	V	50
Resistance against shock		10g / 11 ms
Number of sensor inputs 1-channel or 2-channel		1
Design of the cascading		yes
Type of the safety-related wiring of the inputs		single-channel and two-channel
Product feature transverse contact-secure		Yes
Safety Integrity Level (SIL)		
• according to IEC 61508		SIL3
• for delayed release circuit according to IEC 61508		—
Performance Level (PL)		
• according to ISO 13849-1		e
• for delayed release circuit according to ISO 13849-1		—
Category according to ISO 13849-1		4
Safe failure fraction (SFF)	%	99
T1 value for proof test interval or service life according to IEC 61508	a	20
Hardware fault tolerance according to IEC 61508		1
Safety device type according to IEC 61508-2		Type B
Number of outputs		
• as contact-affected switching element		
– as NC contact for reporting function instantaneous switching		0
– as NO contact for reporting function instantaneous switching		0
– as NC contact for reporting function delayed switching		0
– as NO contact for reporting function delayed switching		0
– as NC contact safety-related instantaneous switching		0
– as NO contact safety-related instantaneous switching		—
– as NC contact safety-related delayed switching		0
– as NO contact safety-related delayed switching		—
• as contact-less semiconductor switching element		
– safety-related		
– delayed switching		0
– non-delayed		3
– for reporting function		
– delayed switching		—
– non-delayed		1

		3SK1122-AB..
Stop category according to DIN EN 60204-1		0
Design of the input		
• cascading-input/functional switching		Yes
• feedback input		Yes
• start input		Yes
Design of the electrical connection jumper socket		No
Operating cycles maximum	1/h	2 000
Switching capacity current of the semiconductor outputs at DC-13 at 24 V	A	2
Switching capacity current of the NO contacts of the relay outputs		
• at DC-13		
– at 24 V	A	—
– at 115 V	A	—
– at 230 V	A	—
• at AC-15		
– at 115 V	A	—
– at 230 V	A	—
Switching capacity current of the NC contacts of the relay outputs		
• at DC-13		
– at 24 V	A	—
– at 115 V	A	—
– at 230 V	A	—
• at AC-15		
– at 115 V	A	—
– at 230 V	A	—
Thermal current of the contact-affected switching element maximum	A	—
Total current maximum	A	—
Mechanical operating cycles as operating time typical		—
Max. permissible voltage for safe isolation between electronic evaluation device and enabling circuit according to EN 60947-1	V	—
Design of the fuse link for short-circuit protection of the NO contacts of the relay outputs required		not required

		3SK1122-AB..
Make time		
• with automatic start		
– typical	s	—
– for DC maximum	s	0.085
– for AC maximum	s	—
– after mains power cut		
– typical	s	6.5
– maximum	s	6.5
• with monitored start		
– typical	s	—
– maximum	s	0.085
Backslide delay time		
• after opening of the safety circuits typical	s	0.04
• at mains power cut		
– typical	s	0
– maximum	s	0
Adjustable backslide delay time		
• after opening of the safety circuits	s	—
		—
Recovery time		
• after opening of the safety circuits typical	s	0.03
• after mains power cut typical	s	6.5
Pulse duration		
• of the sensor input minimum	s	0.06
• of the ON pushbutton input minimum	s	0.15
• of the cascading-entrance minimum	s	—
Type of voltage of the controlled supply voltage		DC
Control supply voltage frequency		
• 1 rated value	Hz	—
• 2 rated value	Hz	—

		3SK1122-AB..
Control supply voltage		
• for DC rated value	V	24
– minimum	V	—
– maximum	V	—
• at 50 Hz at AC rated value	V	—
– minimum	V	—
– maximum	V	—
• at 60 Hz at AC rated value	V	—
– minimum	V	—
– maximum	V	—
operating range factor control supply voltage rated value of the magnet coil		
• at 50 Hz for AC		—
		—
• at 60 Hz for AC		—
		—
• for DC		0.8
		1.2
Active power loss typical	W	2
Contact reliability of the auxiliary contacts		—
Product function parameterizable		Sensor floating / sensor non-floating, monitored start / autostart, 1-channel / 2-channel sensor connection, cross-circuit detection, startup testing, antivalent sensors, 2-hand switches
Suitability for use device connector 3ZY12		Yes
Suitability for interaction pressing control		No
Suitability for use		
• safety cut-out switch		Yes
• monitoring of floating sensors		Yes
• monitoring of non-floating sensors		Yes
• magnetically operated switches monitoring		Yes
• safety-related circuits		Yes

13.2.2.5 Technical data for 3SK1122 Advanced solid-state time-delayed basic unit

		3SK1122-.CB.1	3SK1122-.CB.2	3SK1122-.CB.4
Insulation voltage rated value	V		50	
Resistance against shock			10g / 11 ms	
Number of sensor inputs 1-channel or 2-channel			1	
Design of the cascading			yes	
Type of the safety-related wiring of the inputs			single-channel and two-channel	
Product feature transverse contact-secure			Yes	
Safety Integrity Level (SIL)				
• according to IEC 61508			SIL3	
• for delayed release circuit according to IEC 61508			SIL3	
Performance Level (PL)				
• according to ISO 13849-1			e	
• for delayed release circuit according to ISO 13849-1			e	
Category according to ISO 13849-1			4	
Safe failure fraction (SFF)	%		99	
T1 value for proof test interval or service life according to IEC 61508	a		20	
Hardware fault tolerance according to IEC 61508			1	
Safety device type according to IEC 61508-2			Type B	

	3SK1122-.CB.1	3SK1122-.CB.2	3SK1122-.CB.4
Number of outputs			
• as contact-affected switching element			
– as NC contact for reporting function instantaneous switching		0	
– as NO contact for reporting function instantaneous switching		0	
– as NC contact for reporting function delayed switching		0	
– as NO contact for reporting function delayed switching		0	
– as NC contact safety-related instantaneous switching		0	
– as NO contact safety-related instantaneous switching		—	
– as NC contact safety-related delayed switching		0	
– as NO contact safety-related delayed switching		—	
• as contact-less semiconductor switching element			
– safety-related			
– delayed switching		2	
– non-delayed		2	
– for reporting function			
– delayed switching		—	
– non-delayed		0	
Stop category according to DIN EN 60204-1		0 / 1	

		3SK1122-.CB.1	3SK1122-.CB.2	3SK1122-.CB.4
Design of the input				
• cascading-input/functional switching			Yes	
• feedback input			Yes	
• start input			Yes	
Design of the electrical connection jumper socket				
			No	
Operating cycles maximum	1/h		2 000	
Switching capacity current of the semiconductor outputs at DC-13 at 24 V	A		2	
Switching capacity current of the NO contacts of the relay outputs				
• at DC-13				
– at 24 V	A		—	
– at 115 V	A		—	
– at 230 V	A		—	
• at AC-15				
– at 115 V	A		—	
– at 230 V	A		—	
Switching capacity current of the NC contacts of the relay outputs				
• at DC-13				
– at 24 V	A		—	
– at 115 V	A		—	
– at 230 V	A		—	
• at AC-15				
– at 115 V	A		—	
– at 230 V	A		—	
Thermal current of the contact-affected switching element maximum	A		—	
Total current maximum	A		—	
Mechanical operating cycles as operating time typical			—	

		3SK1122-.CB.1	3SK1122-.CB.2	3SK1122-.CB.4
Max. permissible voltage for safe isolation between electronic evaluation device and enabling circuit according to EN 60947-1	V		—	
Design of the fuse link for short-circuit protection of the NO contacts of the relay outputs required			not required	
Make time				
• with automatic start				
– typical	s		—	
– for DC maximum	s		0.085	
– for AC maximum	s		—	
– after mains power cut				
– typical	s		6.5	
– maximum	s		6.5	
• with monitored start				
– typical	s		—	
– maximum	s		0.085	
Backslide delay time				
• after opening of the safety circuits typical	s		0.04	
• at mains power cut				
– typical	s		0	
– maximum	s		0	
Adjustable backslide delay time				
• after opening of the safety circuits	s	0.05 3	0.5 30	5 300
Recovery time				
• after opening of the safety circuits typical	s		0.03	
• after mains power cut typical	s		6.5	

		3SK1122-.CB.1	3SK1122-.CB.2	3SK1122-.CB.4
Pulse duration				
• of the sensor input minimum	s		0.06	
• of the ON pushbutton input minimum	s		0.15	
• of the cascading-entrance minimum	s		—	
Type of voltage of the controlled supply voltage			DC	
Control supply voltage frequency				
• 1 rated value	Hz		—	
• 2 rated value	Hz		—	
Control supply voltage				
• for DC rated value	V		24	
– minimum	V		—	
– maximum	V		—	
• at 50 Hz at AC rated value	V		—	
– minimum	V		—	
– maximum	V		—	
• at 60 Hz at AC rated value	V		—	
– minimum	V		—	
– maximum	V		—	
Operating range factor control supply voltage rated value of the magnet coil				
• at 50 Hz for AC			—	
			—	
• at 60 Hz for AC			—	
			—	
• for DC			0.8	
			1.2	
Active power loss typical	W		2	
Contact reliability of the auxiliary contacts				
—				
Product function parameterizable				
Sensor floating / sensor non-floating, monitored start / autostart, 1-channel / 2-channel sensor connection, cross-circuit detection, startup testing, antivalent sensors, 2-hand switches, time delay				

	3SK1122-.CB.1	3SK1122-.CB.2	3SK1122-.CB.4
Suitability for use device connector 3ZY12		Yes	
Suitability for interaction pressing control		No	
Suitability for use			
• safety cut-out switch		Yes	
• monitoring of floating sensors		Yes	
• monitoring of non-floating sensors		Yes	
• magnetically operated switches monitoring		Yes	
• safety-related circuits		Yes	

13.3 Expansion modules

13.3.1 Output expansions

13.3.1.1 Technical data for output expansion 3SK1211

		3SK1211-.BB0.	3SK1211-.BB4.	3SK1211-.BW2.
Insulation voltage rated value	V	300		
Resistance against shock		10g / 11 ms		
Number of sensor inputs 1-channel or 2-channel		—		
Type of the safety-related wiring of the inputs		—		
Product feature transverse contact-secure		—		
Safety Integrity Level (SIL) according to IEC 61508		SIL3		
SIL claim limit (for a subsystem) according to EN 62061		3		
Performance level (PL) according to ISO 13849-1		e		
Category according to ISO 13849-1		4		
T1 value for proof test interval or service life according to IEC 61508	a	20		
Safety device type according to IEC 61508-2		Type A		

13.3 Expansion modules

		3SK1211-BB0.	3SK1211-BB4.	3SK1211-BW2.
Number of outputs as contact-affected switching element				
• as NC contact for reporting function instantaneous switching			0	
• as NO contact for reporting function instantaneous switching			0	
• as NC contact for reporting function delayed switching			0	
• as NO contact for reporting function delayed switching			0	
• as NC contact safety-related instantaneous switching			0	
• as NO contact safety-related instantaneous switching			4	
• as NC contact safety-related delayed switching			0	
• as NO contact safety-related delayed switching			0	
Stop category according to DIN EN 60204-1			0	
Design of the input start input			—	
Design of the electrical connection jumper socket			No	
Operating cycles maximum	1/h		360	

		3SK1211-BB0.	3SK1211-BB4.	3SK1211-BW2.
Switching capacity current				
• of the NO contacts of the relay outputs				
– at DC-13				
– at 24 V	A		5	
– at 115 V	A		0.2	
– at 230 V	A		0.1	
– at AC-15				
– at 115 V	A		5	
– at 230 V	A		5	
• of the NC contacts of the relay outputs				
– at DC-13				
– at 24 V	A		—	
– at 115 V	A		—	
– at 230 V	A		—	
– at AC-15				
– at 115 V	A		—	
– at 230 V	A		—	
Thermal current of the contact-affected switching element maximum	A		5	
Total current maximum	A		12	
Mechanical operating cycles as operating time typical			10 000 000	
Max. permissible voltage for safe isolation between electronic evaluation device and enabling circuit according to EN 60947-1	V		—	
Design of the fuse link for short-circuit protection of the NO contacts of the relay outputs required		gL/gG: 6A or circuit breaker type A: 3A or circuit breaker type B: 2A or circuit breaker type C: 1A		
Cable length between sensor and electronic evaluation device with Cu 1.5 mm² and 150 nF/km maximum	m		—	

13.3 Expansion modules

		3SK1211-BB0.	3SK1211-BB4.	3SK1211-BW2.
Make time				
• with automatic start				
– typical	s	0.025	0.015	0.035
– for DC maximum	s	—	0.03	—
– for AC maximum	s	0.04	—	0.035
– after mains power cut				
– typical	s	0.025	0.015	0.035
– maximum	s	0.04	0.03	0.035
• with monitored start				
– maximum	s		—	
– typical	s		—	
Backside delay time				
• after opening of the safety circuits typical				
	s		—	
• at mains power cut				
– typical	s	0.045	0.01	0.2
– maximum	s	0.05	0.015	0.3
Adjustable backside delay time after opening of the safety circuits				
• initial value	s		—	
• final value	s		—	
Recovery time				
• after opening of the safety circuits typical				
	s		—	
• after mains power cut typical	s	0.06	0.015	0.32
Pulse duration				
• of the sensor input minimum				
	s		—	
• of the ON pushbutton input minimum				
	s		—	
• of the cascading-entrance minimum				
	s		—	
Type of voltage of the controlled supply voltage		AC	DC	AC/DC
Control supply voltage frequency				
• 1 rated value	Hz	50	—	50
• 2 rated value	Hz	60	—	60

		3SK1211-BB0.	3SK1211-BB4.	3SK1211-BW2.
Control supply voltage				
• for DC rated value	V	—	24	—
– minimum	V	—		110
– maximum	V	—		240
• at 50 Hz at AC rated value	V	24	—	
– minimum	V	—		110
– maximum	V	—		240
• at 60 Hz at AC rated value	V	24	—	
– minimum	V	—		110
– maximum	V	—		240
Operating range factor control supply voltage rated value of the magnet coil				
• at 50 Hz for AC		0.85	—	0.85
		1.1	—	1.1
• at 60 Hz for AC		0.85	—	0.85
		1.1	—	1.1
• for DC		—	0.8	0.85
		—	1.2	1.1
Active power loss typical	W		2.5	2
Contact reliability of the auxiliary contacts			—	
Product function parameterizable		—	undelayed/delayed (only with system connector)	—
Suitability for interaction pressing control			—	
Suitability for use device connector 3ZY12		No	Yes	No
Suitability for use				
• monitoring of floating sensors			—	
• monitoring of non-floating sensors			—	
• safety cut-out switch			—	
• magnetically operated switches monitoring			—	
• safety-related circuits			Yes	

13.3.1.2 Technical data for output expansion 3SK1213

		3SK1213-.AB..	3SK1213-.AJ..	3SK1213-.AL..
Insulation voltage rated value	V		300	
Resistance against shock			5 g / 10 ms	
Number of sensor inputs 1-channel or 2-channel			—	
Type of the safety-related wiring of the inputs			—	
Product feature transverse contact-secure			—	
Safety Integrity Level (SIL) according to IEC 61508			SIL3	
SIL claim limit (for a subsystem) according to EN 62061			3	
Performance level (PL) according to ISO 13849-1			e	
Category according to ISO 13849-1			4	
T1 value for proof test interval or service life according to IEC 61508	a		20	
Safety device type according to IEC 61508-2			Type A	

		3SK1213-.AB..	3SK1213-.AJ..	3SK1213-.AL..
Number of outputs as contact-affected switching element				
	• as NC contact for reporting function instantaneous switching		0	
	• as NO contact for reporting function instantaneous switching		0	
	• as NC contact for reporting function delayed switching		0	
	• as NO contact for reporting function delayed switching		0	
	• as NC contact safety-related instantaneous switching		0	
	• as NO contact safety-related instantaneous switching		3	
	• as NC contact safety-related delayed switching		0	
	• as NO contact safety-related delayed switching		0	
Stop category according to DIN EN 60204-1			0	
Design of the input start input			—	
Design of the electrical connection jumper socket			No	
Operating cycles maximum	1/h		360	

		3SK1213-AB..	3SK1213-AJ..	3SK1213-AL..
Switching capacity current				
• of the NO contacts of the relay outputs				
– at DC-13				
– at 24 V	A		6	
– at 115 V	A		1.1	
– at 230 V	A		0.55	
– at AC-15				
– at 115 V	A		10	
– at 230 V	A		10	
• of the NC contacts of the relay outputs				
– at DC-13				
– at 24 V	A		—	
– at 115 V	A		—	
– at 230 V	A		—	
– at AC-15				
– at 115 V	A		—	
– at 230 V	A		—	
Thermal current of the contact-affected switching element maximum	A		10	
Total current maximum	A		—	
Mechanical operating cycles as operating time typical			10 000 000	
Max. permissible voltage for safe isolation between electronic evaluation device and enabling circuit according to EN 60947-1	V		300	
Design of the fuse link for short-circuit protection of the NO contacts of the relay outputs required		gL/gG: 16 A or MCB type A: 6 A or MCB type B: 4 A or MCB type C: 4 A		
Cable length between sensor and electronic evaluation device with Cu 1.5 mm² and 150 nF/km maximum	m		—	

		3SK1213-.AB..	3SK1213-.AJ..	3SK1213-.AL..
Make time				
• with automatic start				
– typical	s	0.05	0.01	
– for DC maximum	s	0.07	—	
– for AC maximum	s	—	0.015	
– after mains power cut				
– typical	s	0.05	0.01	
– maximum	s	0.07	0.015	
• with monitored start				
– maximum	s		—	
– typical	s		—	
Backslide delay time				
• after opening of the safety circuits typical	s			—
• at mains power cut				
– typical	ms	20	15	
– maximum	ms	20	15	
Adjustable backslide delay time after opening of the safety circuits				
• initial value	s			—
• final value	s			—
Recovery time				
• after opening of the safety circuits typical	s			—
• after mains power cut typical	s			0
Pulse duration				
• of the sensor input minimum	s			—
• of the ON pushbutton input minimum	s			—
• of the cascading-entrance minimum	s			—
Type of voltage of the controlled supply voltage		DC	AC	
Control supply voltage frequency				
• 1 rated value	Hz	—	50	
• 2 rated value	Hz	—	60	

13.3 Expansion modules

		3SK1213-AB..	3SK1213-AJ..	3SK1213-AL..
Control supply voltage				
• for DC rated value	V	24	—	
– minimum	V	—		
– maximum	V	—		
• at 50 Hz at AC rated value	V	—	115	230
– minimum	V	—		
– maximum	V	—		
• at 60 Hz at AC rated value	V	—	115	230
– minimum	V	—		
– maximum	V	—		
Operating range factor control supply voltage rated value of the magnet coil				
• at 50 Hz for AC		—	0.85	
		—	1.1	
• at 60 Hz for AC		—	0.85	
		—	1.1	
• for DC		0.8	—	
		1.2	—	
Active power loss typical	W	5.5	4	3.5
Contact reliability of the auxiliary contacts			—	
Product function parameterizable		undelayed/delayed (only with system connector)	—	
Suitability for interaction pressing control			—	
Suitability for use device connector 3ZY12		Yes	No	
Suitability for use				
• monitoring of floating sensors			—	
• monitoring of non-floating sensors			—	
• safety cut-out switch			—	
• magnetically operated switches monitoring			—	
• safety-related circuits			Yes	

13.3.2 Input expansions

13.3.2.1 Technical data for input expansion 3SK1220

		3SK1220-.....
Insulation voltage rated value	V	50
Resistance against shock		10g / 11 ms
Number of sensor inputs 1-channel or 2-channel		1
Type of the safety-related wiring of the inputs		single-channel and two-channel
Product feature transverse contact-secure		Yes
Safety Integrity Level (SIL) according to IEC 61508		SIL3
SIL claim limit (for a subsystem) according to EN 62061		3
Performance level (PL) according to ISO 13849-1		e
Category according to ISO 13849-1		4
T1 value for proof test interval or service life according to IEC 61508	a	20
Safety device type according to IEC 61508-2		Type B
Number of outputs as contact-affected switching element		
• as NC contact for reporting function instantaneous switching		0
• as NO contact for reporting function instantaneous switching		0
• as NC contact for reporting function delayed switching		0
• as NO contact for reporting function delayed switching		0
• as NC contact safety-related instantaneous switching		0
• as NO contact safety-related instantaneous switching		0
• as NC contact safety-related delayed switching		0
• as NO contact safety-related delayed switching		0
Stop category according to DIN EN 60204-1		0
Design of the input start input		Yes
Design of the electrical connection jumper socket		No
Operating cycles maximum	1/h	—

		3SK1220-.....
Switching capacity current		
• of the NO contacts of the relay outputs		
– at DC-13		
– at 24 V	A	—
– at 115 V	A	—
– at 230 V	A	—
– at AC-15		
– at 115 V	A	—
– at 230 V	A	—
• of the NC contacts of the relay outputs		
– at DC-13		
– at 24 V	A	—
– at 115 V	A	—
– at 230 V	A	—
– at AC-15		
– at 115 V	A	—
– at 230 V	A	—
Thermal current of the contact-affected switching element maximum	A	—
Total current maximum	A	—
Mechanical operating cycles as operating time typical		—
Max. permissible voltage for safe isolation between electronic evaluation device and enabling circuit according to EN 60947-1	V	—
Design of the fuse link for short-circuit protection of the NO contacts of the relay outputs required		—
Cable length between sensor and electronic evaluation device with Cu 1.5 mm² and 150 nF/km maximum	m	4 000
Make time		
• with automatic start		
– typical	s	0.06
– for DC maximum	s	0.06
– for AC maximum	s	—
– after mains power cut		
– typical	s	6.5
– maximum	s	6.5
• with monitored start		
– maximum	s	0.06
– typical	s	0.06

		3SK1220-.....
Backslide delay time		
• after opening of the safety circuits typical	s	0.04
• at mains power cut		
– typical	s	—
– maximum	s	—
Adjustable backslide delay time after opening of the safety circuits		
• initial value	s	—
• final value	s	—
Recovery time		
• after opening of the safety circuits typical	s	0.03
• after mains power cut typical	s	—
Pulse duration		
• of the sensor input minimum	s	0.06
• of the ON pushbutton input minimum	s	0.15
• of the cascading-entrance minimum	s	—
Type of voltage of the controlled supply voltage		DC
Control supply voltage frequency		
• 1 rated value	Hz	—
• 2 rated value	Hz	—
Control supply voltage		
• for DC rated value	V	24
– minimum	V	—
– maximum	V	—
• at 50 Hz at AC rated value	V	—
– minimum	V	—
– maximum	V	—
• at 60 Hz at AC rated value	V	—
– minimum	V	—
– maximum	V	—
Operating range factor control supply voltage rated value of the magnet coil		
• at 50 Hz for AC		—
		—
• at 60 Hz for AC		—
		—
• for DC		0.8
		1.2

		3SK1220-.....
Active power loss typical	W	1.2
Contact reliability of the auxiliary contacts		—
Product function parameterizable		Sensor floating / sensor non-floating, monitored start / autostart, 1-channel / 2-channel sensor connection, cross-circuit detection, startup testing, antivalent sensors, 2-hand switches
Suitability for interaction pressing control		No
Suitability for use device connector 3ZY12		Yes
Suitability for use		
• monitoring of floating sensors		Yes
• monitoring of non-floating sensors		Yes
• safety cut-out switch		Yes
• magnetically operated switches monitoring		Yes
• safety-related circuits		Yes

13.3.2.2 Technical data for power supply unit 3SK1230

		3SK1230-1AW20	3SK1230-2AW20
Type of current supply		24 V / 0,6 A	
Type of display for normal operation		Green LED for 24 V OK	
Overvoltage class		Installation category III	
Characteristic feature of the output short-circuit protected		Yes	
Product feature Bridging of channels		No	
Output voltage for DC nominal value	V	24	
Output current nominal range ultimate value	A	0.6	
Resistive loss	W	17	
Design of the short-circuit protection		automatically start-up	
Operating range factor control supply voltage rated value			
• at 50 Hz for AC			
– initial value		0.85	
– final value		1.1	
• at 60 Hz for AC			
– initial value		0.85	
– final value		1.1	
• for DC			
– initial value		0.85	
– final value		1.1	
Control supply voltage			
• at 50 Hz at AC rated value			
– maximum	V	240	
– minimum	V	110	
• at 60 Hz at AC rated value			
– maximum	V	240	
– minimum	V	110	
• for DC rated value			
– maximum	V	240	
– minimum	V	110	
Resistance against shock		10g / 11 ms	
Verification of suitability			
• TÜV (German technical inspectorate) certificate		No	
• UL-registration		Yes	

Dimension drawings

14.1 Dimension drawings for 3SK1 devices

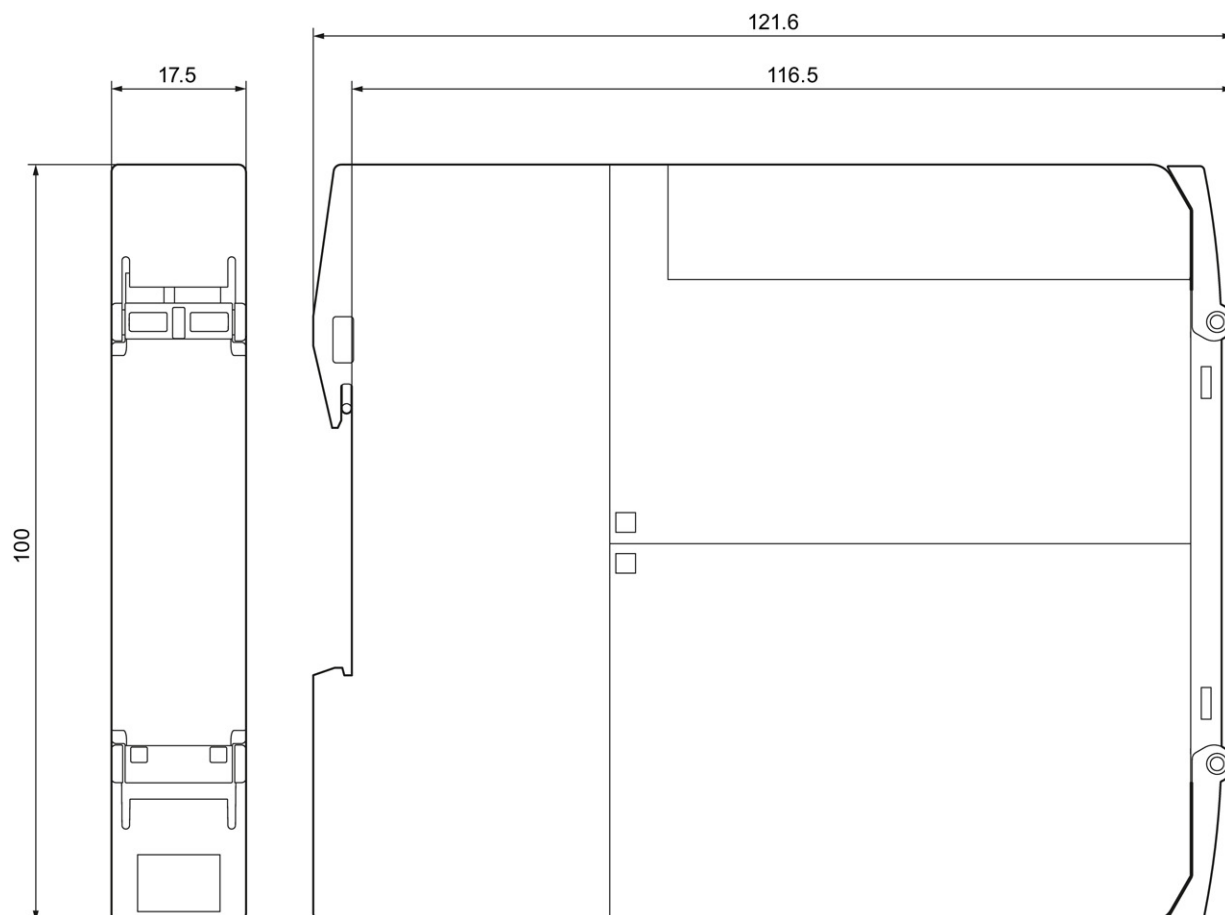


Figure 14-1 Enclosure 17.5 mm for safety relays:
3SK1120-..... ; 3SK1220-.....

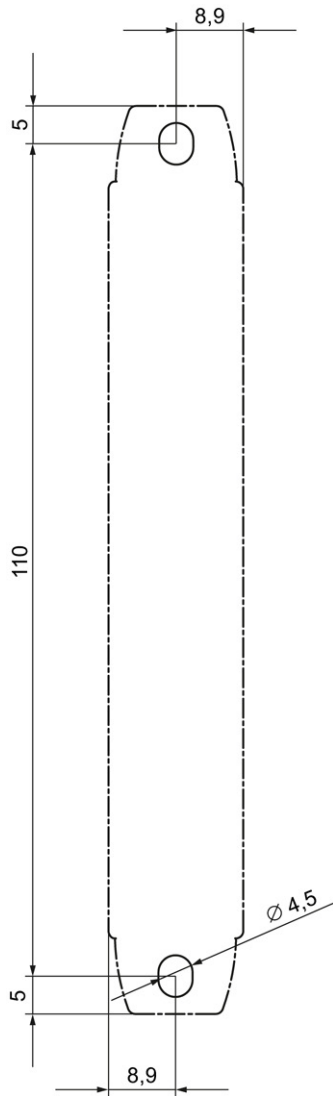


Figure 14-2 Drilling diagram, enclosure 17.5 mm

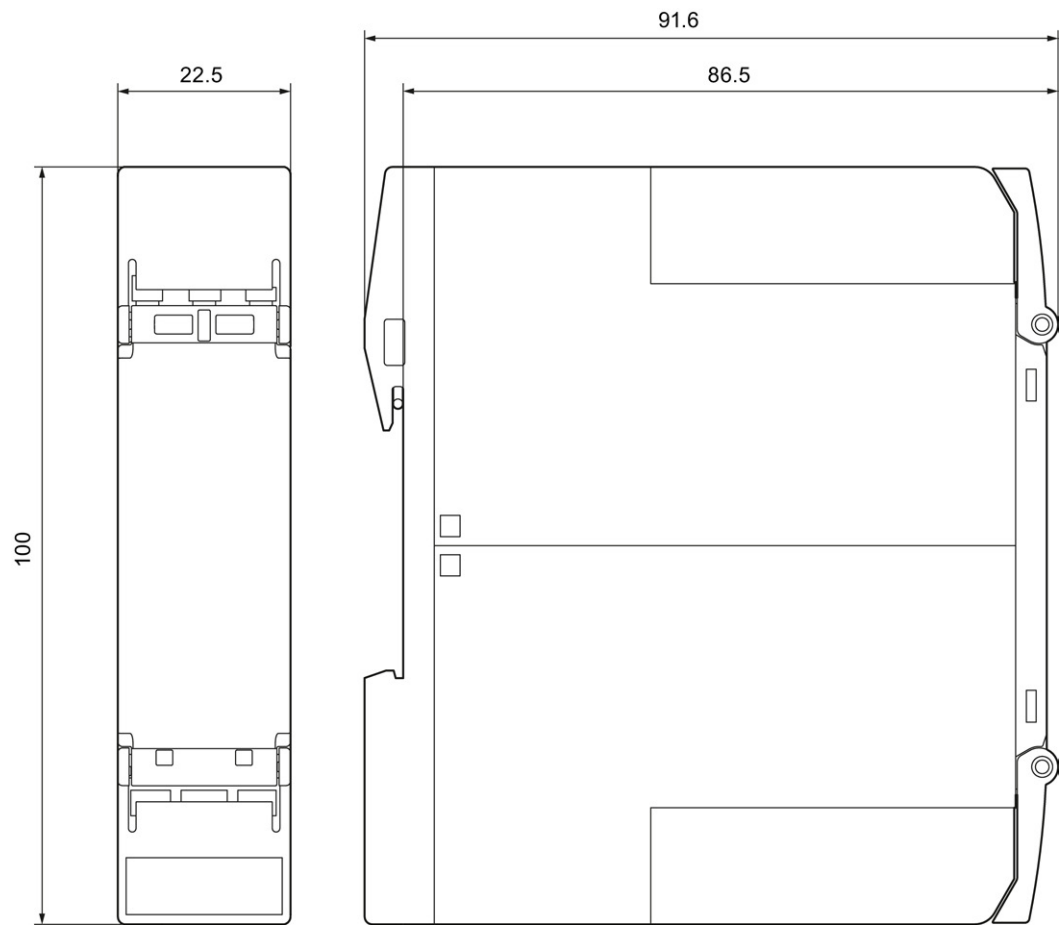


Figure 14-3 Enclosure 22.5 mm (short) for safety relays:
3SK1112-.....

14.1 Dimension drawings for 3SK1 devices

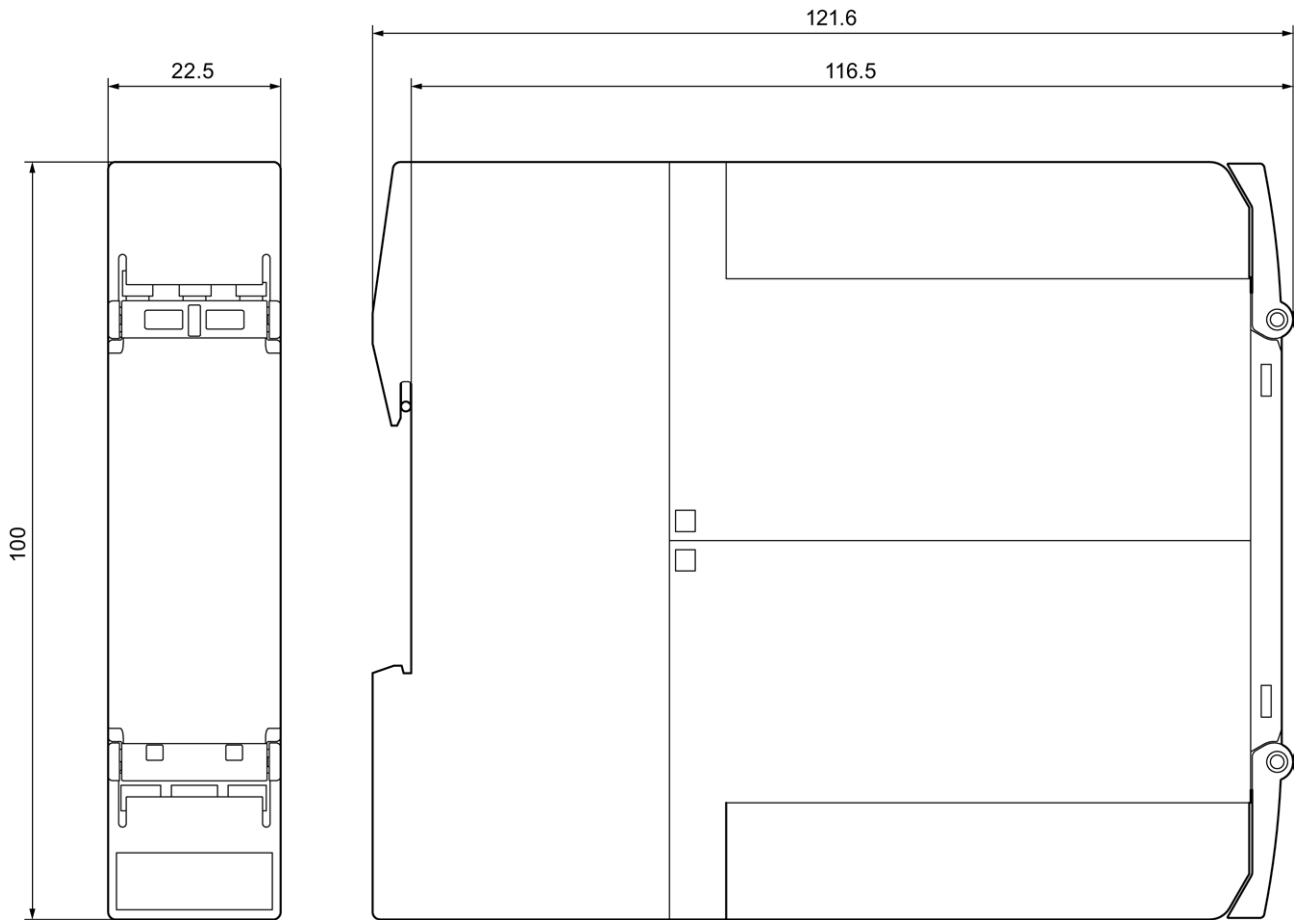


Figure 14-4 Enclosure 22.5 mm (long) for safety relays:
3SK1111-..... ; 3SK1121-..... ; 3SK1122-..... ; 3SK1211-..... ; 3SK1230-.....

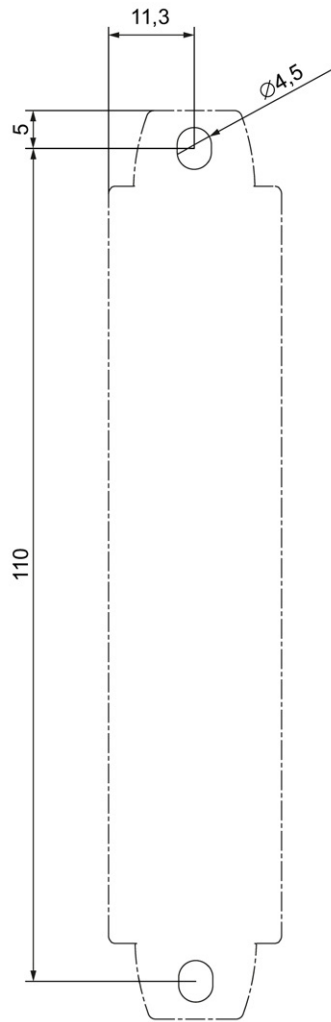


Figure 14-5 Drilling diagram, enclosure 22.5 mm

14.1 Dimension drawings for 3SK1 devices

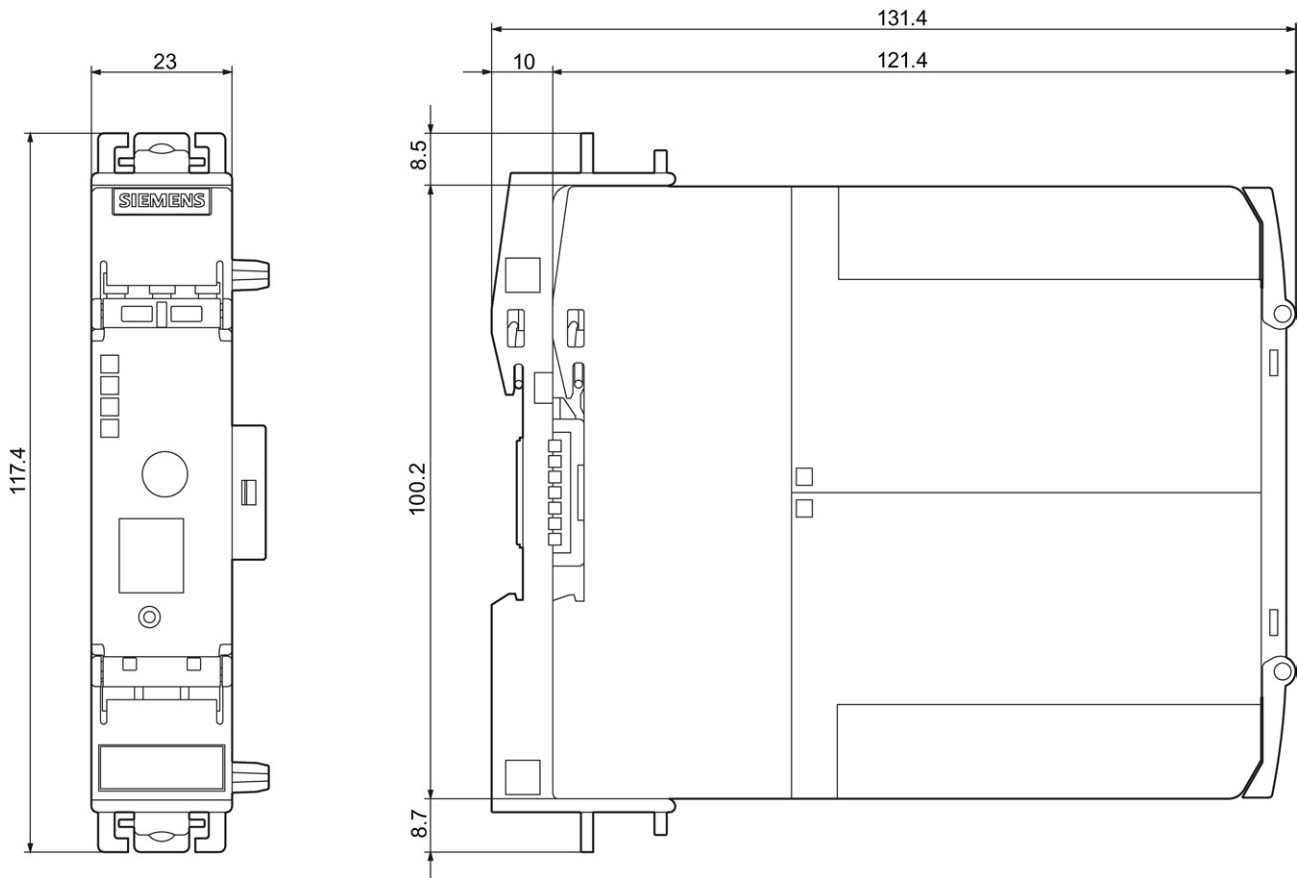


Figure 14-6 3SK1 device on device connector

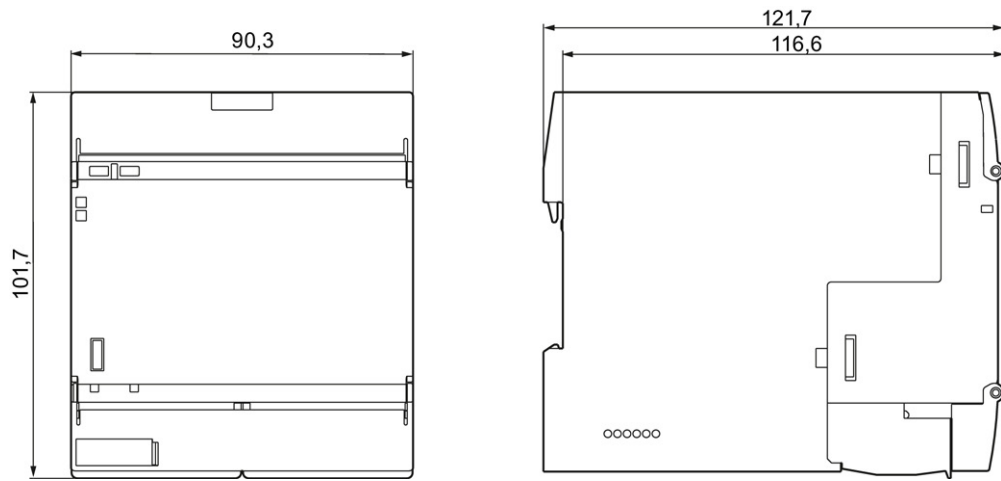


Figure 14-7 Enclosure 90 mm for safety relays:
3SK1213-.....

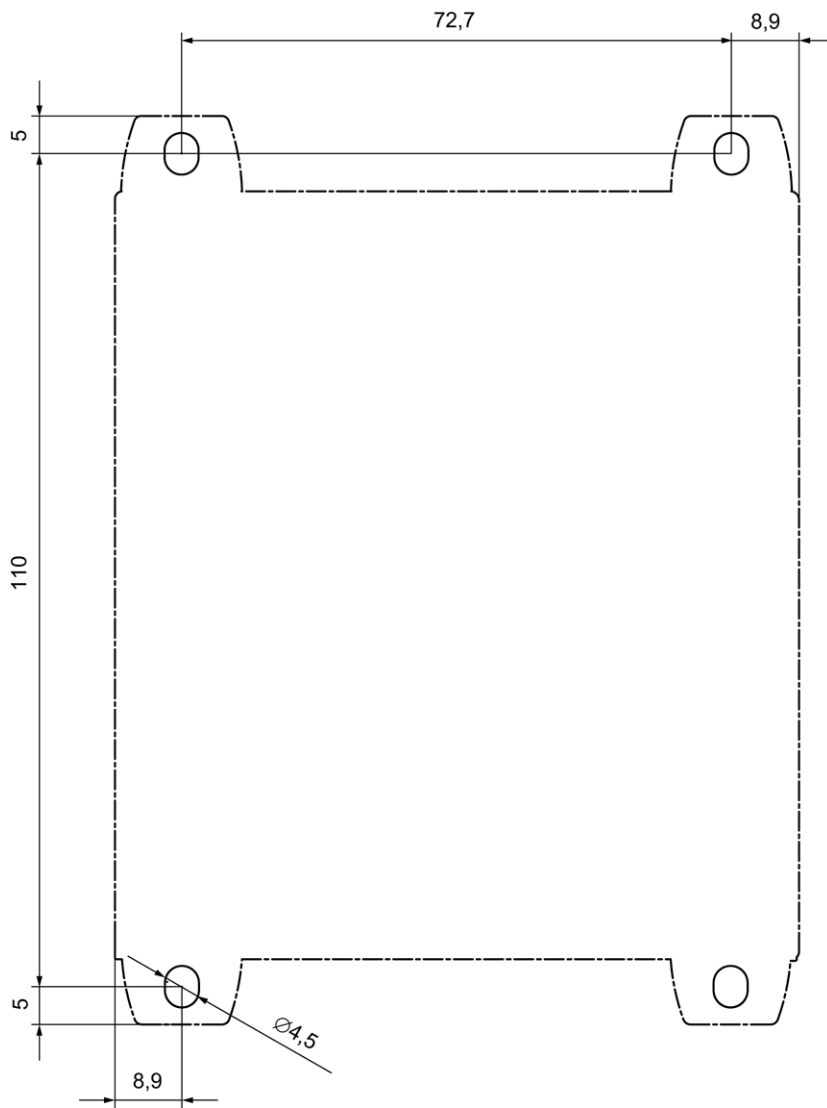


Figure 14-8 Drilling diagram, enclosure 90 mm

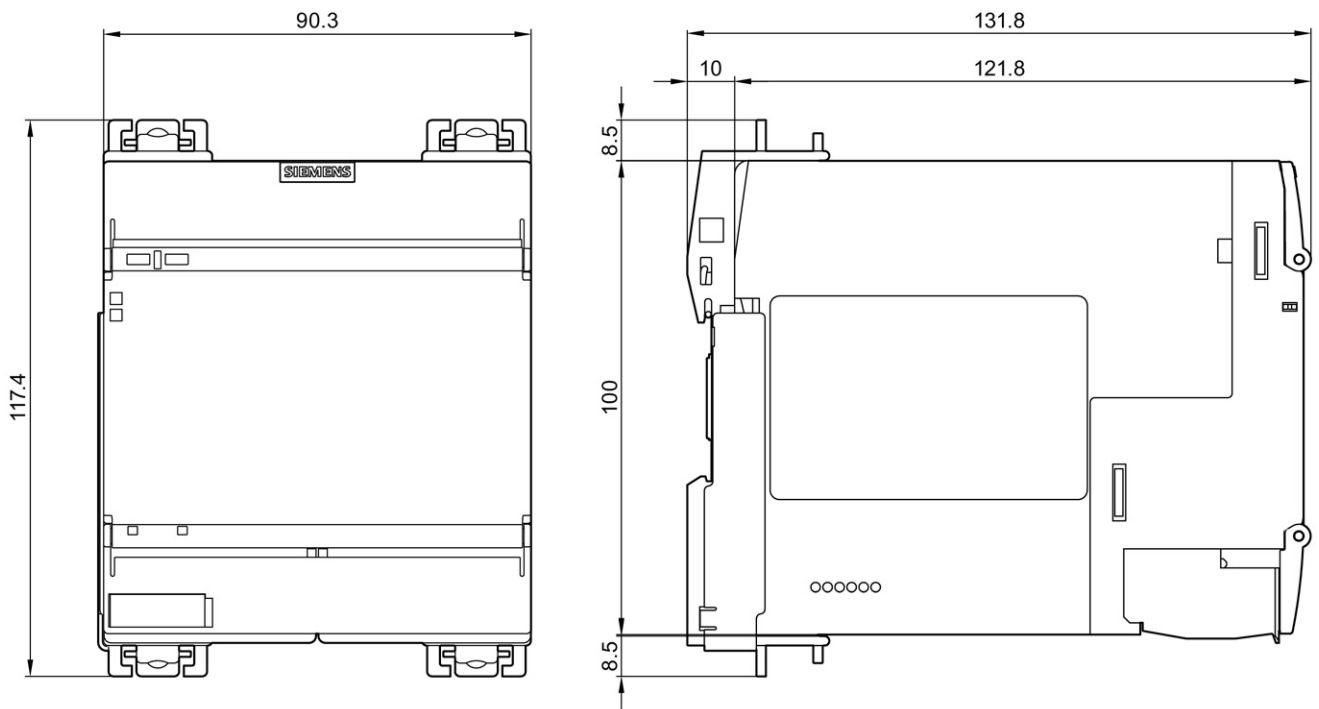


Figure 14-9 3SK1213 device on device connector

14.2 Dimension drawings for 3SK1 device connector

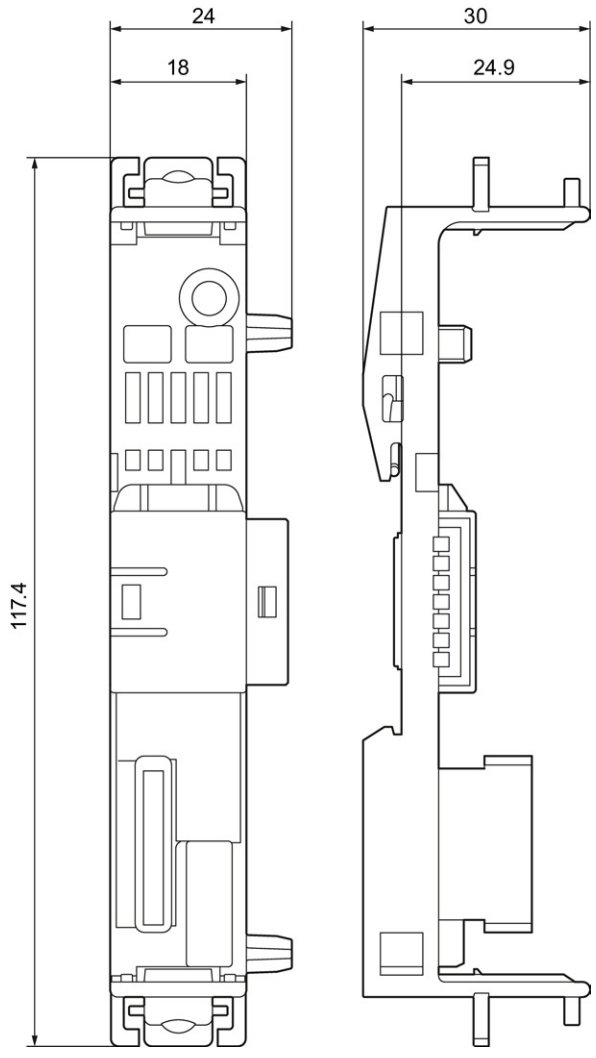


Figure 14-10 Device connector for 3SK1 safety relays, width: 17.5 mm

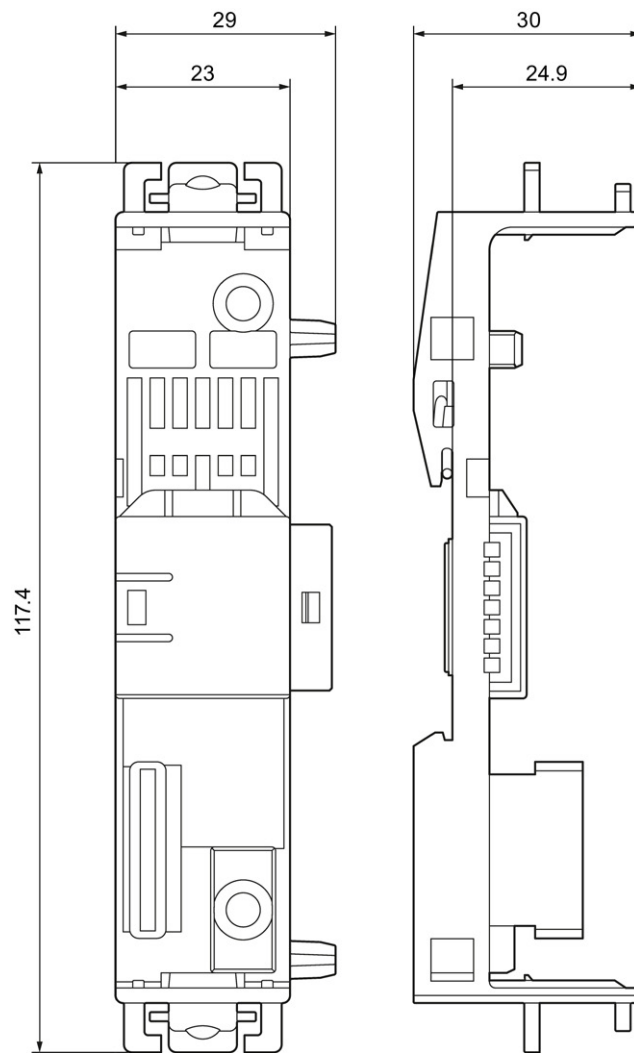


Figure 14-11 Device connector for 3SK1 safety relays, width: 22.5 mm

14.2 Dimension drawings for 3SK1 device connector

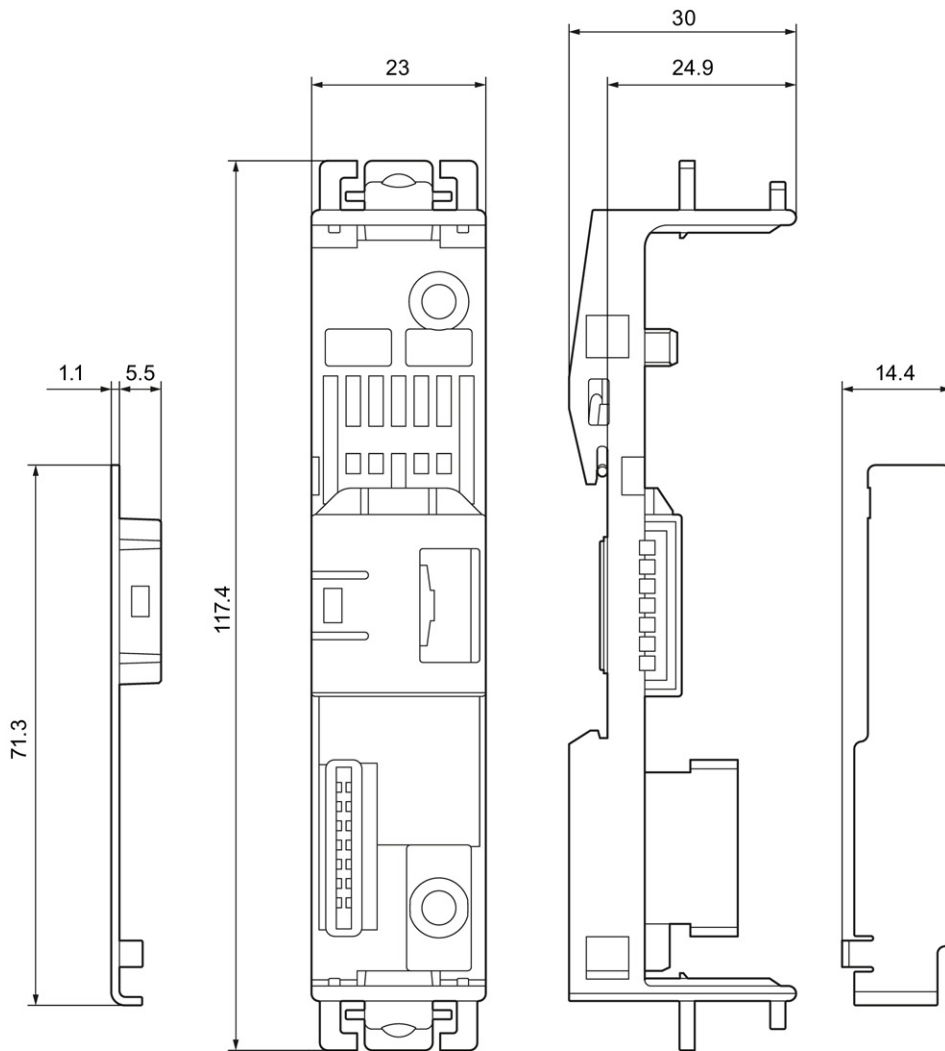


Figure 14-12 Device termination connector for 3SK1 safety relays, width: 22.5 mm

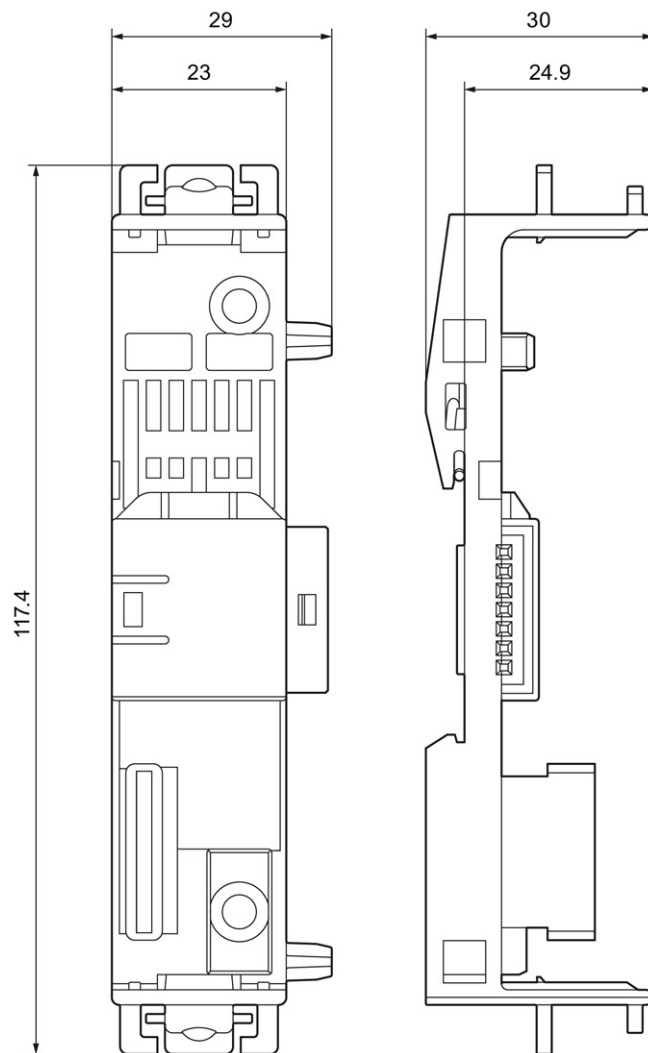


Figure 14-13 Device connector for 3RM1 motor starters, width: 22.5 mm

14.2 Dimension drawings for 3SK1 device connector

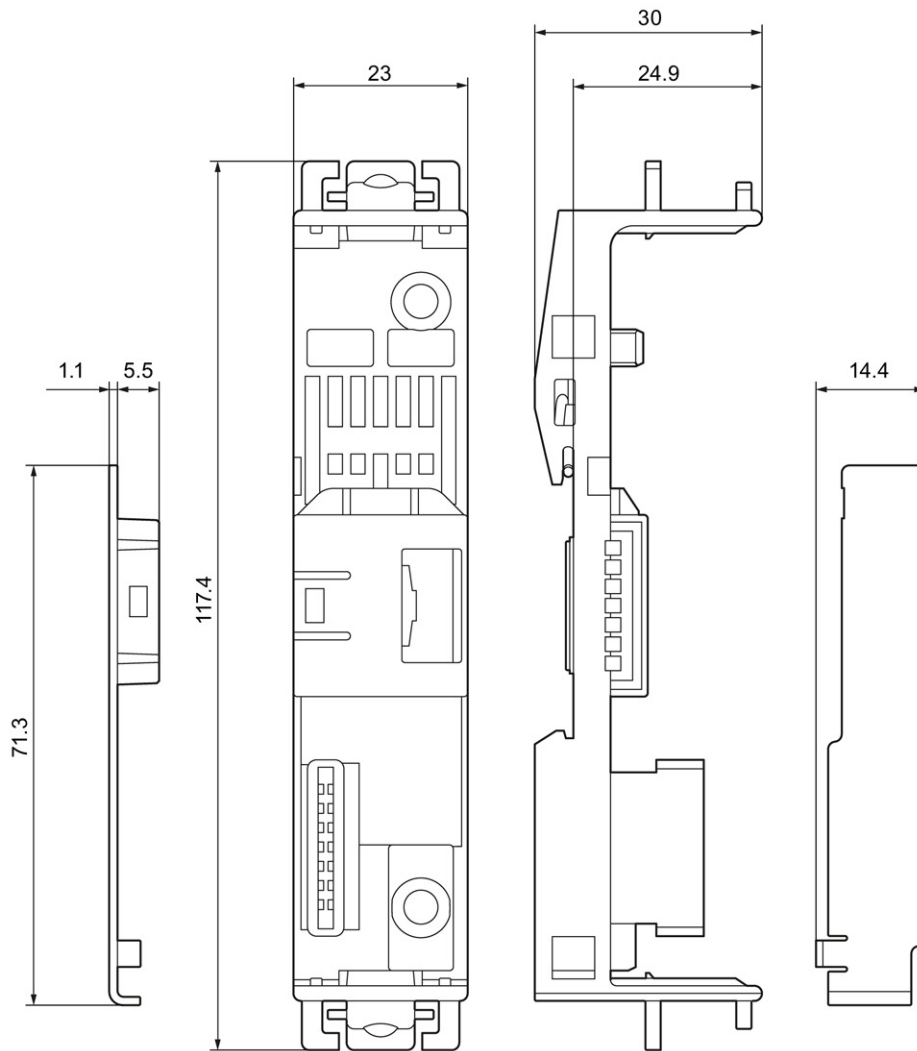


Figure 14-14 Device termination connector for 3RM1 motor starters, width: 22.5 mm

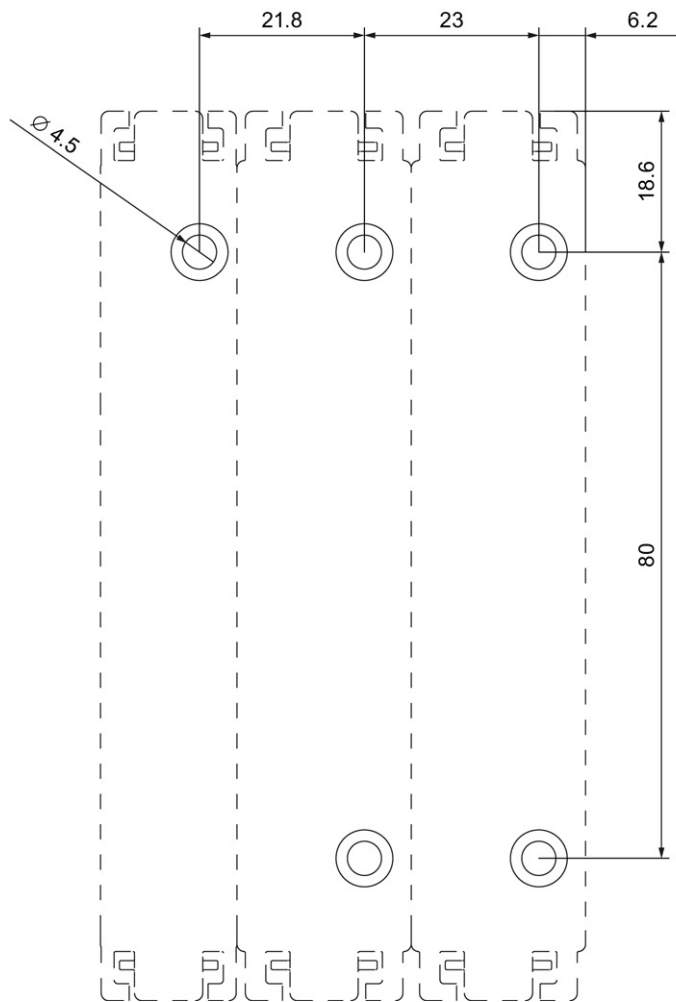


Figure 14-15 Drilling plan for 17.5 mm and 22.5 mm device connectors

Accessories

The following accessories are available for the 3SK1 safety relay system.

Designation	Article number (MLFB)
SIRIUS terminal, 2-pole, screw-type, 1 x 2.5 mm ²	3ZY1121-1BA00
SIRIUS terminal, 3-pole, screw-type, 1 x 2.5 mm ²	3ZY1131-1BA00
SIRIUS terminal, 2-pole, push-in, 1 x 2.5 mm ²	3ZY1121-2BA00
SIRIUS terminal, 3-pole, push-in, 1 x 2.5 mm ²	3ZY1131-2BA00
SIRIUS device connector for 3SK1 safety relay, 17.5 mm wide	3ZY1212-1BA00
SIRIUS device connector for 3SK1 safety relay, 22.5 mm wide	3ZY1212-2BA00
SIRIUS device termination connector for 3SK1 safety relay, 22.5 mm wide	3ZY1212-2DA00
SIRIUS device connector for 3RM1 motor starters, 22.5 mm wide	3ZY1212-2EA00
SIRIUS device termination connector for 3RM1 motor starters, 22.5 mm wide	3ZY1212-2FA00
SIRIUS device termination connector set for 3SK1 safety relay, ≥ 45 mm wide	3ZY1212-0FA01
SIRIUS device connector for looping through signals, 22.5 mm wide (for 3RM1 motor starters)	3ZY1212-2AB00
SIRIUS device connector without a function, 22.5 mm wide	3ZY1210-2AA00
SIRIUS push-in lugs for wall mounting (Contents: 12 units)	3ZY1311-0AA00
SIRIUS sealable cover, 17.5 mm	3ZY1321-1AA00
SIRIUS sealable cover, 22.5 mm	3ZY1321-2AA00
Coding pins for SIRIUS terminals	3ZY1440-1AA00
Sealable membrane 22.5 mm 1 pack = 12 membranes	3TK2820-0AA00
SIRIUS device identification label 17 sheets of 48 labels; size 10 x 7 mm	3RT2900-1SB10
SIRIUS device identification label 17 sheets of 20 labels; size 20 x 7 mm	3RT2900-1SB20
SIRIUS device identification label 10 sheets of 306 adhesive labels; size 19 x 6 mm	3RT2900-1SB60

Appendix

A.1 Correction sheet

Have you noticed any errors while reading this manual? If so, please use this form to tell us about them. We welcome comments and suggestions for improvement.

Fax response

To	From (please complete):
SIEMENS AG	Name
I IA CE MK&ST 3	Company/Department
92220 Amberg / Germany	Address

Fax: +49 (0)9621-80-3337

Manual title:

Table A- 1 Errors, comments, and suggestions for improvements

Service & Support

Download catalogs and information material:
www.siemens.com/sirius/infomaterial

Newsletter - always up to date:
www.siemens.com/sirius/newsletter

E-Business in the Industry Mall:
www.siemens.com/sirius/mall

Online-Support:
www.siemens.com/sirius/support

Contact for all technical information:
Technical Assistance
Tel.: +49 (911) 895-5900
e-mail: technical-assistance@siemens.com
www.siemens.com/sirius/technical-assistance

Siemens AG
Industry Sector
Postfach 23 55
90713 FUERTH
GERMANY

Subject to change without prior notice
3ZX1012-0SK11-0ACO

© Siemens AG 2013

