Energy Management Energy Analyzer Type EM24 DIN





- . Application adaptable display and programming procedure (Easyprog function)
- Easy connections management
- Certified according to MID Directive (option PF): see "how to order" below
- Other versions available (not certified, option X): see "how to order" on the next page

- Class 1 (kWh) according to EN62053-21
- Class B (kWh) according to EN50470-3
- Class 2 (kvarh) according to EN62053-23
- Accuracy ±0.5 RDG (current/voltage)
- Energy analyzer
- Instantaneous variables readout: 4 DGT
- Energies/gas/water readout: 8 DGT
- System variables: VLL, VLN, Admd max, VA, VAdmd, VAdmd max, W, Wdmd, Wdmd max, var, PF, Hz, Phase-sequence.
- Single phase variables: VLL, VLN, A, VA, W, var, PF
- Energy measurements: total and partial kWh and kvarh or based on 4 different tariffs; single phase measurements
- Gas, cold water, hot water, kWh remote heating measurements
- Hour counter (6+2 DGT)
- TRMS measurements of distorted sine waves (voltages/currents)
- Self power supply (AV2-AV9 inputs)
- Auxiliary power supply (AV5-AV6 inputs)
 3 digital inputs for tariff selection, DMD synch or gas/ water (hot-cold) and remote heating metering (on request)
- 2 digital outputs for pulses or for alarms or as a mix of them
- Dimensions: 4-DIN modules
- Protection degree (front): IP50
- RS485 serial output (MODBUS-RTU), iFIX SCADA compatibility
- Dupline communication capability (DP option)

Product Description

Three-phase energy analyzer with built-in configuration joystick and LCD data displaying; particularly indicated for active and reactive energy metering and for cost allocation. Housing

for DIN-rail mounting with IP50 (front) protection degree. Direct connection up to 65A and by means of external current and potential transformers.

Moreover the meter

provided with digital outputs that can be either for pulse proportional to the active (imported exported) and reactive energy being measured or for alarm outputs. In alternative the

RS485 communication port and 3 digital inputs or Dupline port and 3 digital inputs are available as an option.



Certified according to MID Directive, Annex "B" + Annex "D" for legal metrology relevant to active electrical energy meters (see Annex MI-003 of MID). Can be used for fiscal (legal)

metrology. Only the total positive energy meter is certified according to MID.

How to order EM24 DIN AV5 3 D O2 PF A

Model ————————————————————————————————————	
Power supply ——— Inputs/Outputs ——	
Option —	
Measurement	

Type Selection for MID version

Range codes

AV5: 400V_{LL} AC - 5(10)A (CT connection) AV2:

400V_{LL}AC 10(65)A (direct connection) V_{LN}: 113V to 265V_{LN} V_{LL}: 196V to 460V_{LL} 400V_{LL} AC - 10(65)A

(direct connection) V_{LN}: 113V to 265V_{LN} V_{LL} : 196V to 460 V_{LL}

System

3-phase, 4-wire 3:

NOTE: please check the availability of the needed code on the verification path diagram below before order.

Inputs/Outputs

02: dual open collector

type (dual pulse or one pulse + one alarm or dual alarm)

IS: 3 digital inputs for tariff selection or Gas/Water/ remote heating metering plus RS485 port

DP: Dupline port plus 3 digital inputs for Gas/ water/ remote heating metering


Measurement

- A: The power is always integrated (both in case of positive -imported and negative -exportedpower) and the total energy meter is certified according to MID. B:
- Only the total positive imported- energy meter is certified according to MID. The negative exported-energy meter is not certified according to MID.

Options

AV9:

PF: Certified according to MID Directive, Annex "B" + Annex "D" for legal metrology relevant to active electrical energy meters (see Annex MI-003 of MID). Can be used for fiscal (legal) metrology.

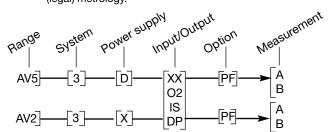

Power supply

X: Self power supply (See "Power supply specifications")

Measurement 115/230VAC (50Hz) Inbrit Ontbrit D: bower anbby Option X



STANDARD

Not certified according to MID directive. Cannot be used for fiscal (legal) metrology.

How to order EM24 DIN AV5 3 D O2 X

Model —	 	\Box	누 누	' -	
Range code ———					
System ———			」 │		
Power supply ——					
Inputs/Outputs —					
Option					

Type Selection for standard version

Range codes

AV2:

Connections)
V_{LN}: 40V to 144V_{LN}
V_{LL}: 70V to 250V_{LL}
400V_{LL}AC 10(65)A
(direct connection)
V_{LN}: 113V to 265V_{LN}

AV9: V_{LL}: 196V to 460V_{LL} 400V_{LL} AC - 10(65)A (direct connection) V_{LN}: 184V to 276V_{LN} V_{LL}: 318V to 480V_{LL}

System

3: balanced and unbalanced load: 3-phase, 4-wire; 3-phase, 3-wire; 2-phase, 3-wire; 1-phase, 2-wire

NOTE: please check the availability of the needed code on the verification path tables below before order.

Power supply

X: Self power supply (See "Power supply specifications")
L: 18 to 60VAC/DC (48 to 62Hz)
D: 115/230 VAC (48 to

62Hz)

Options

X: none

Inputs/Outputs

XX: none

DP:

O2: dual open collector type (dual pulse or one pulse + one alarm or dual alarm)

R2: dual relay type (functions as per "O2")


IS: 3 digital inputs for tariff selection or Gas/ water/ remote heating

water/ remote heating metering plus RS485 port

Dupline port plus 3 digital inputs for Gas / water / remote heating

metering

$$AV6] - \begin{bmatrix} 3 \end{bmatrix} - \begin{bmatrix} D \\ L \end{bmatrix} = \begin{bmatrix} O2 \\ IS \\ DP \end{bmatrix}$$





Input specifications

Rated inputs	System type: 3-phase		Exported Total/Partial/
Current type	Galvanic insulation by means		Tariff: 6+1or 7DGT (with "-"
, ,	of built-in CT's (AV5 and AV6		sign)
	models). By direct connec-	Overload status	EEEE indication when the
	tion (AV2 and AV9)		value being measured is
Current range (by CT)	AV5 and AV6: 1/5(10)A		exceeding the "Continuous
Current range (direct)	AV2: 10(65)A; AV9: 10(65)A		inputs overload" (maximum
Voltage	AV5: 400 VLL		measurement capacity)
	AV2: 230/400 VLL	Max. and Min. indication	Max. instantaneous vari-
Valtaga by VT/DT	AV9: 400 VLL		ables: 9999; energies:
Voltage by VT/PT	AV6: 120VLN/208 VLL		99 999 999. Min. instanta-
Accuracy (Display + RS485)	Ib: see below, Un: see below		neous variables: 0.000;
(@25°C ±5°C, R.H. ≤60%,			energies 0.00.
50±5Hz/60±5Hz)	1 54 1 404 11 400	LEDs	Red LED (Energy con-
AV5 model	In: 5A, Imax: 10A; Un: 160		sumption), according to EN50470-3, EN62052-11
AV6 model	to 480VLN (277 to 830VLL) In: 5A, Imax: 10A; Un: 40 to	AV5, AV6 models	0.001 kWh/kvarh by pulse if
Avoillodel	144VLN (70 to 250VLL)	7 (V 3, 7 (V 6 III) GUCIS	CT ratio by VT ratio is ≤7;
AV2 model	Ib: 10A, Imax: 65A, Un: 113		0.01 kWh/kvarh by pulse if CT
7.11.2000.	to 265VLN (196 to 460VLL)		ratio by VT ratio is $> 7.1 \le 70.0$;
AV9 model	lb: 10A, Imax: 65A; Un: 184		0.1 kWh/kvarh pulse if CT ratio
	to 276VLN (318 to 480VLL)		by VT ratio is $> 70.1 \le 700.0$;
Current	, , , , , , , , , , , , , , , , , , ,		1 kWh/kvarh by pulse if CT
AV5, AV6 models	From 0.002In to 0.2In:		ratio x VT ratio is > 700.1;
	±(0.5% RDG +3DGT)	AV2, AV9 models	0.001kWh/kvarh by pulse
	From 0.2In to Imax:	Max frequency	16Hz
AV/2 AV/0 modele	±(0.5% RDG +1DGT). From 0.004lb to 0.2lb:	Measurements	See "List of the variables
AV2, AV9 models	±(0.5% RDG +3DGT)	NA - tii	that can be connected to:"
	From 0.2lb to Imax:	Method	TRMS measurements of distorted wave forms.
	±(0.5% RDG +1DGT).	Coupling type	Direct for AV2 and AV9
Phase-neutral voltage	In the range Un: ±(0,5%	Couping type	models. By means of exter-
	RDG +1DGT)		nal CT's for AV5 and AV6
Phase-phase voltage	In the range Un: ±(1% RDG	Crest factor	Ib 10A ≤4 (91A max. peak)
_	+1DGT)	0.000.14000	In 5A ≤3 (15A max. peak)
Frequency	±0.1Hz (50±5Hz/60±5Hz)	Current Overloads	, ,
Active and Apparent power Power Factor	±(1%RDG +2DGT)	Continuous	1/5(10) A: 10A, @ 50Hz
Power Factor	±[0.001+1%(1.000 - "PF RDG")]		10(65) A: 65A, @ 50Hz
Reactive power	±(2%RDG +2DGT)	For 500ms	1/5(10) A: 200A, @ 50Hz
Active energy	Class 1 according to	For 10ms	10(65) A: 1920A max, @ 50Hz
	EN62053-21 and MID	Voltage Overloads	
	Annex MI-003 Class B	Continuous	1.2 Un
	according to EN50470-3	For 500ms	2 Un
Reactive energy	Class 2 according to	Input impedance	
A) /5 A) /0 I I	EN62053-23	208VL-L (AV6)	>1600KΩ
AV5, AV6 models	In: 5A, Imax: 10A; 0.1 In: 0.5A,	230/400VL-L (AV2)	Refer to "Power
	Start up current: 10mA	400\/L L (A\/E\	Consumption" >1600ΚΩ
AV2, AV9 models	Ib: 10A, Imax: 65A;	400VL-L (AV5) 400VL-L (AV9)	Refer to "Power
7112,7110 11100010	0.1 lb: 1.0A	400 VL-L (AV3)	Consumption"
	Start up current: 40mA	1/5(10)A (AV5-AV6)	< 0.3VA
Energy additional errors		10(65)A (AV2-AV9)	< 4VA
Influence quantities	According to EN62053-21,	Frequency	50±5Hz/60±5Hz
·	EN50470-3, EN62053-23	Joystick	For variable selection and
Temperature drift	≤200ppm/°C		programming of the
Sampling rate	1600 samples/s @ 50Hz		instrument working
. 0	1900 samples/s @ 60Hz		parameters
Display refresh time	750 ms		
Display	3 lines (1 x 8 DGT; 2 x 4 DGT)		
Type	LCD, h 7mm		
Instantaneous variables read-out	4 DGT		
Energies	Imported Total 6+2, 7+1 or		
	8DGT		



Output specifications

Digital outputs

Pulse type Number of outputs

Type

Pulse duration

Alarm type Number of outputs Alarm modes

Set-point adjustment

Hysteresis On-time delay Output status

Min. response time

Note

Static output

Purpose

Signal

Insulation

Relay output

Purpose

Type

Up to 2, independent. Programmable from 0.001 to 10.00kWh/kvarh by

pulse.

Outputs connectable to the energy meters (kWh/kvarh) T_{OFF} ≥120ms, according to EN62053-31

T_{ON} selectable (30 ms or 100 ms), according to EN62053-31

Up to 2, independent Up alarm, down alarm (see the table "List of the variables that can be

connected to") From 0 to 100% of the display scale

From 0 to full scale 0 to 255s Selectable; normally

de-energized or normally eneraized

≤ 700ms, filter excluded, set-point on-time delay: "0 s" The 2 digital outputs can also work as a dual pulse output, dual alarm output, one pulse output and one

alarm output.

For pulse output or alarm output Von 1.2 VDC/ max. 100 mA

V_{OFF} 30 VDC max. By means of optocuplers, 4000 VRMS output to measuring inputs, 4000 VRMS output to power supply input.

For alarm output or pulse output

Relay, SPST type AC 1-5A @ 250VAC DC 12-5A @ 24VDC AC 15-1.5A @ 250VAC DC 13-1.5A @ 24VDC

Insulation

Note

4000 VRMS output to measuring input

4000 VRMS output to power supply input. The meters equipped with the relay outputs ("AV9"

models with "R2" option) work even if VL3 is missing (VL1, VL2 and neutral have to be available)(see table

"working mode notes")

RS485 Type

Connections

Addresses

Protocol

Data (bidirectional) Dynamic (reading only)

Static (reading and writing)

Data format

Baud-rate

Driver input impedance

Insulation

Note:

Multidrop, bidirectional (static and dynamic

variables) 2-wire

Max. distance 1000m 247, selectable by means of

the front joystick MODBUŚ/JBUS (RTU)

System and phase

variables: see table "List of

variables...

All the configuration param-

eters. 1 start bit, 8 data bit, no

parity,1 stop bit 4800, 9600 bit/s 1/5 unit load

Maximum 160 transceivers

on the same bus. By means of optocouplers,

4000 VRMS output to measuring input, 4000 VRMS output to

power supply input. The meters equipped with the communication port ("AV9" models with "XS" and "IS" options) work even if VL3 is missing (VL1, VL2 and neutral have to be

available)(see table "working mode notes")

Dupline specifications

Counters

Used Dupline function

Number of counters

Counter range Used channels Multiplexer Reset Value Counter reset

Multiplexer for counter val-

6 per instrument, 128 per network 0... 99 999 999 B to F B2 to B8 B1

C1 to F8 Enable/disable function for all the counters

Available counters

kWh tot, -kWh tot, kwarh tot, -kwarh tot, kwh t1, kwh t2, kwh L1, kwh L2, kwh L3, counter dig. in. 1, counter dig. in. 2, counter dig. in. 3, hour counter.

Analogue variables Used Dupline function

Multiplexer for analogue values



Dupline specifications

Number of variables	8 per instrument 80 per network		• total and partial energy meter (kWh, kvarh) man-
Dupline data format	3 1/2 DGT BCD		aged by time periods (t1-t2).
Full scale value	Selectable from 1.999 to	Alarms	
	1999M	Used Dupline function	Monostable (push-button)
Used channels	depending on the number	Used channells	Selectable (A1 to P8). No
	of variables		control that the selected
Multiplexer	A1 to A4		channels are not used for
Value	G1 to H8 (1st group of 16		counters or analog vari-
	variables)		ables.
	I1 to J8 (2 nd group of 16	Number of alarms	2 per instrument
	variables)	Alarm modes	Up alarm, down alarm (see
	K1 to L8 (3 th group of 16 variables)		the table "List of the
	M1 to N8 (4 th group of 16		variables that can be
	variables)	Set-point adjustment	connected to") From 0 to 100% of the dis-
	O1 to P8 (5 th group of 16	Get-point adjustment	play scale
	variables)	Hysteresis	From 0 to full scale
Available variables	All, except for the "max"	On-time delay	0 to 255s
	variables	Output status	Normally energised
Synchro/Tariff input		Available variables	All, except for the "max"
Used Dupline functions	Monostable (push-button)		variables
	Realtime		
Used channels	A5		
Working mode	Selectable:		
	• none		
	 Wdmd synchronization 		

Digital input specifications

Number of inputs	3
Input frequency	20Hz max, duty cycle 50%
Prescaler adjustment	From 0.001 to 999.9 m ³ or
•	kWh per pulse
Contact measuring voltage	5VDC +/- 5%
Contact measuring current	10mA max
Input impedance	680Ω
Contact resistance	≤100Ω, closed contact
	≥500kΩ, open contact
Working modes	, ' '
(DP version excluded)	Selectable:
,	 total and partial energy meters (kWh and kvarh)
	meters (kvvii and kvam)

10mA max 680Ω ≤100Ω, closed contact ≥500kΩ, open contact ≥500kΩ, open contact ≤500kΩ, open contact selectable:
• total and partial energy meters (kWh and kvarh) without digital inputs;
• total and partial energy meters (kWh and kvarh) managed by time periods (t1-t2-t3-t4), W dmd synchronisation (the synchronisation is made every time the tariff changes) and GAS (m³) or WATER (hotcold m³) or remote heating (kWh) meters or external kWh meter;
• total and partial energy meters (kWh and kvarh) managed by time periods (t1-t2), W dmd synchronisation (the synchronisation

from the tariff selection) and GAS (m³) or WATER (hot-cold m³) or remote heating (kWh) meters or external kWh meter; • total energy (kWh, kvarh) and GAS, WATER (hot-cold m³), remote heating, external kWh meters (3 choices only). Working modes (DP version only) Selectable: • GAS (m3) or WATER (hotcold m³) or remote heating (kWh) meters Note The energy metering is only made by means of the analogue inputs. Insulation By means of optocouplers, 4000 VRMS digital inputs to measuring inputs, 4000 VRMS digital inputs to power supply input.

is made independently



Software functions

Password 1st level 2nd level	Numeric code of max. 4 digits; 2 protection levels of the programming data: Password "0", no protection Password from 1 to 9999, all data are protected	Filter Operating range Filtering coefficient Filter action	0 to 100% of the input display scale 1 to 32 Measurements, serial output (fundamental variables: V, A, W and their derived ones).
System selection System 3-Pn unbalanced load System 3-P unbalanced load System 3-P1 (only AV5 and AV6) balanced load	3-phase (4-wire) 3-phase (3-wire) 3-phase (3-wire) one current and 3-phase to phase	Displaying	Up to 3 variables per page (see « Display pages ») 8 different set of variables available (see « Display pages ») according to the application being selected
System 2-P System 1-P Transformer ratio	voltage measurements 3-phase (4-wire) one current and 1-phase (L1) to neutral voltage measurement 2-phase (3-wire) 1-phase (2-wire)	Reset	By means of the front joystick: - dmd and dmd max; - total energies (kWh and kvarh) and gas/water; - partial energies and tariffs: kWh, kvarh
VT (PT)	1.0 to 999.9 / 1000 to 6000 (only AV5 and AV6) 1.0 to 999.9 / 1000 to 9999 / 10.00k to 60.00k (only AV5 and AV6). The maximum power being measured cannot exceed 210 MW (calculated as maximum input voltage and current, see the "Accuracy" paragraph before). The maximum VT by CT ratio is 48600. For MID complaint applications the maximum power being measured is 25MW.	Easy connection function AV2 and AV9 models AV5-AV6-AV2-AV9 models	Automatic phase sequence detection with current and voltage synchronisation. For all the display selections, both energy and power measurements are independent from the current direction. The displayed energy is always "imported" with the only exception of "F" and "H" types (see "display pages" table). For those latter selections the energies can be either "imported" or "exported" depending on the current direction.

General specifications

Operating temperature	-25°C to +55°C (-13°F to	Dielectric strength	4000 VRMS for 1 minute
Operating temperature	131°F) (R.H. from 0 to 90%		1000 111110 101 111110
	non-condensing @ 40°C)	Noise rejection CMRR	100 dB, 48 to 62 Hz
	according to EN62053-21,	EMC	According to EN62052-11
	,	Electrostatic discharges	15kV air discharge
	EN50470-1 and EN62053- 23	Immunity to irradiated	Test with current: 10V/m
			from 80 to 2000MHz
Storage temperature	-30°C to +70°C (-22°F to 158°F) (R.H. < 90% non-	Electromagnetic fields	Test without any current: 30V/m from 80 to 2000MHz
	condensing @ 40°C) according to EN62053-21, EN50470-1 and EN62053-	Burst	On current and voltage measuring inputs circuit: 4kV
	23	Immunity to conducted	
Installation category	Cat. III (IEC60664, EN60664)	disturbances	10V/m from 150KHz to 80MHz
Insulation (for 1 minute)	4000 VRMS between measuring inputs and power supply 4000 VRMS between power	Surge	On current and voltage measuring inputs circuit: 4kV; on "L" auxiliary power supply input: 1kV
	supply and RS485/digital output	Radio frequency suppression	According to CISPR 22



General specifications (cont.)

Standard compliance Safety	Safety IEC60664, IEC61010-1 EN60664, EN61010-1 EN62052-11. Metrology EN62053-23, EN50470-3. MID "annex MI-003" Pulse output DIN43864, IEC62053-31	Cable cross-section area AV5-AV6 models	Max. 1.5 mm ² Screws tightening torque: 0.5 Nm
Metrology Pulse output Approvals		Housing DIN Dimensions (WxHxD) Material Mounting Protection degree	71 x 90 x 64.5 mm Nylon PA66, self-extinguishing: UL 94 V-0 DIN-rail
Connections Cable cross-section area AV2-AV9 models	Screw-type measuring inputs max. 16 mm²; min. 2.5 mm² (by cable lug). Min./Max. screws tightening torque: 1.7 Nm / 3 Nm Other inputs: 1.5 mm² Screws tightening torque: 0.5 Nm	Front Screw terminals Weight	IP50 IP20 Approx. 400 g (packing included)

Power supply specifications

Self supplied version	AV9 models "XX" and "O2" options only: -20% +15%, 48-62Hz. "R2", "XS" and "IS" options only: -15% +10%, 48-62Hz. AV2 model: "XX", "O2", "IS" and "DP" options: -15% +15%, 48-62Hz. In case of 3-phase system, 4-wire connection: 113 to 265V. In case of 3-phase system, 3-wire connection: 196 to 460V.	Auxiliary power supply	phase connection has to be performed the L1 and L2 voltage inputs have to be short circuited. The instrument provided with "O2" option, working in a 3-phase system with neutral may work also if one or two phases are missing. AV5-AV6 modules: L: 18 to 60VAC/DC; D: 115VAC/230VAC (48 to 62Hz)
Note	The instruments provided with "IS" and "R2" options work only if all the voltage inputs are connected (3-phase and neutral) if a 1-	Power consumption AV9-AV2 models AV9-AV2 models (IS and DP option only) AV5-AV6 models	≤ 20VA/1W ≤ 12VA/2W ≤ 2VA/2W


Working mode notes (only "Self power supply" version)

Output	Model	Note
Open collector output	"AV9" models with "O2" option	The meter works even if up to two voltages "phase to neutral" are missing or if one voltage "phase to phase" is missing.
Relay output	"AV9" models with "R2" option	The neutral wire has always to be available. The meter works even if "Phase 3" is missing but,
RS485 port	"AV9" models with "IS" option	mandatorily, both "phase 1" and "Phase 2" have to be available.
Dupline port	"AV2" model with "DP" option	The meter works even if up to two voltages "phase
Relay output	"AV2" model with "R2" option	to neutral" are missing or if one voltage "phase to
RS485 port	"AV2" model with "IS" option	phase" is missing.




Accuracy (According to EN50470-3 and EN62053-23)

kWh, accuracy (RDG) depending on the current

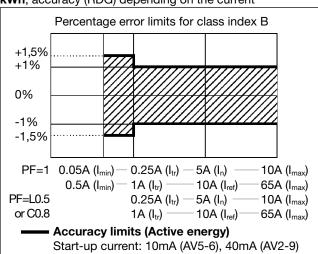

kvarh, accuracy (RDG) depending on the current

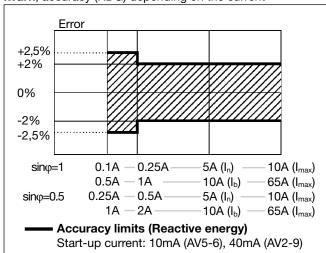

MID "Annex MI-003" compliance (PF option only)

Accuracy	0.9 Un \leq U \leq 1.1 Un; 0.98 fn \leq f \leq 1.02 fn; fn: 50Hz; cosp: 0.5 inductive to 0.8
AV2-AV9 models	capacitive. Class B. I st: 0.04A; I min: 0.5A; I tr: 1A; I ref: 10A;
AV5 models	I max: 65A. Class B. I st: 0.01A; I min: 0.05A; I tr: 0.25A; I ref: 5A; I max: 10A.
Operating temperature	-25°C to +55°C (-13°F to 131°F) (R.H. from 0 to 90% non-condensing @ 40°C)

E2
M2
in order to achieve the protection against dust and water required by the norms harmonized to MID, the meter must be used only installed in IP51 (or better) cabinets.

Used calculation formulas

Phase variables

Instantaneous effective voltage

$$V_{1N} = \sqrt{\frac{1}{n}} \cdot \sum_{1}^{n} (V_{1N})_{i}^{2}$$

Instantaneous active power

$$W_1 = \frac{1}{n} \cdot \sum_{1}^{n} \left(V_{1N} \right)_i \cdot \left(A_1 \right)_i$$

Instantaneous power factor

$$\cos \varphi_1 = \frac{W_1}{VA_1}$$

Instantaneous effective current

$$A_1 = \sqrt{\frac{1}{n} \cdot \sum_{i=1}^{n} (A_1)_i^2}$$

Instantaneous apparent power

$$VA_1 = V_{1N} \cdot A_1$$

Instantaneous reactive power

$$var_1 = \sqrt{(VA_1)^2 - (W_1)^2}$$

System variables

Equivalent three-phase voltage

$$V_{\Sigma} = \frac{V_1 + V_2 + V_3}{3} \cdot \sqrt{3}$$

Voltage asymmetry
$$ASY_{LL} = \frac{(V_{LL \text{ max}} - V_{LL \text{ min}})}{V_{LL} \sum}$$

$$ASY_{LN} = \frac{(V_{LN \text{ max}} - V_{LN \text{ min}})}{V_{LN} \sum}$$

$$ASY_{LN} = \frac{(V_{LN\,\text{max}} - V_{LN\,\text{min}})}{V_{LN}\,\Sigma}$$

Three-phase reactive power

$$var_y = (var_1 + var_2 + var_3)$$

Three-phase active power

$$W_{\Sigma} = W_1 + W_2 + W_3$$

Three-phase apparent power

$$VA_{\Sigma} = \sqrt{W_{\Sigma}^2 + \text{var}_{\Sigma}^2}$$

Three-phase power factor

(TPF)

$$\cos \varphi_{\Sigma} = \frac{W_{\Sigma}}{VA_{\Sigma}}$$

Energy metering

$$k \operatorname{var} hi = \int_{t_1}^{t_2} Qi(t) dt \cong \Delta t \sum_{t_1}^{n_2} Qnj$$

$$kWhi = \int_{t_1}^{t_2} Pi(t)dt \cong \Delta t \sum_{i=1}^{n_2} Pnj$$

Where:

i= considered phase (L1, L2 or L3) P= active power; Q= reactive power; t₁, t₂ =starting and ending time points of consumption recording; n= time unit; Δt = time interval between two successive power consumptions; $\mathbf{n_1}$, $\mathbf{n_2}$ = starting and ending discrete time points of consumption recording



List of the variables that can be connected to:

- RS485 communication port
- Alarm outputs ("max" variable", "energies" and "hour counter" excluded)
- Pulse outputs (imported and exported kWh, imported kvarh)
- Dupline bus

No	Variable	1-phase system	2-phase system	3-ph. 4-wire balanced sys.	3-ph. 4-wire unbal. sys.	3 ph. 3-wire bal. sys.	3 ph. 3-wire unbal. sys.	Notes
1	V L-N sys	0	X	Х	х	Х	#	sys=system
2	V L1	Х	Х	Х	х	Х	#	
3	V L2	0	Х	Х	х	Х	#	
_4	V L3	0	0	Х	х	Х	#	
5	V L-L sys	0	X	X	Х	X	Х	sys=system
6	V L1-2	#	X	X	Х	X	X	
7	V L2-3	#	0	X	Х	Х	Х	
8	V L3-1	#	0	Х	Х	Х	Х	
9	A dmd max	0	X	Х	х	Х	X	Highest "dmd" current among the phases (1)(2)
10	A L1	Х	X	Х	Х	Х	Х	
11	A L2	0	X	Х	Х	Х	Х	
12	A L3	0	0	Х	Х	X	Х	
13	VA sys	Х	X	Х	Х	X	Х	sys=system
14	VA sys dmd	Х	X	X	Х	X	Х	sys=system (1)
15	VA L1	Х	X	Х	Х	Х	#	
16	VA L2	0	X	Х	Х	X	#	
<u>17</u>	VA L3	0	0	Х	х	Х	#	
18	var sys	Х	X	Х	Х	Х	#	sys=system
19	var L1	Х	X	Х	х	Х	#	
20	var L2	0	Х	Х	х	Х	#	
21	var L3	0	0	X	х	Х	#	
22	W sys	х	X	Х	Х	Х	Х	sys=system
23	W sys dmd	х	X	X	Х	Х	Х	sys=system (1)
24	W L1	х	X	Х	Х	Х	#	
25	W L2	0	Х	Х	х	Х	#	
26	W L3	0	0	Х	Х	Х	#	
27	PF sys	Х	X	Х	х	Х	Х	
28	PF L1	Х	Х	Х	х	Х	#	
29	PF L2	0	Х	X	х	Х	#	
30	PF L3	0	0	Х	Х	X	#	
31	Hz	х	X	Х	Х	Х	Х	
32	Phase seq.	0	Х	Х	х	Х	Х	
33	Hours	Х	X	Х	х	Х	Х	
34	kWh (+)	X	X	X	х	Х	Х	Total or by user
35	kvarh (+)	Х	Х	Х	х	Х	#	Total or by user
36	kWh (+)	Х	X	Х	Х	X	Х	Partial or by tariff
37	kvarh (+)	х	X	Х	Х	Х	#	Partial or by tariff
38	kWh (-)	Х	Х	Х	Х	Х	Х	Total
39	kvarh (-)	х	Х	Х	Х	Х	#	Total
40	m³ Gas	Х	Х	х	х	Х	х	Total
41	m³ Cold H₂O	Х	Х	х	х	Х	х	Total
42	m³ Hot H₂O	Х	Х	х	х	Х	х	Total
43	kWh H₂O	Х	Х	х	х	Х	х	Total
44	kWh out	Х	Х	Х	х	Х	Х	Total

- (x) = available
- (o) = not available (zero indication on the display)
- (#) = not available (the relevant page is not displayed)
- (1) = max. value with data storage
- (2) = not available with the "DP" option



Display pages

Sel.	NI-	1st variable	2nd variable	3rd variable (3rd line)	N-4-	Applications							
pos.	No	(1st line)	(2nd line)		Note		В	С	D	Ε	F	G	Н
	1 Phase seq.		VLN sys	Hz		7	7	7		7	7	7	7
	2 Phase seq.		VLL sys	Hz							Х	Х	х
	3 Total kWh (+)		W sys dmd	W sys dmd max		Х	Х	Х		Х	Х	Х	х
	4	kWh (+)	A dmd max	(text) "PArt"	"PArt" = Partial kWh (+)						Х	Х	х
	5	5 Total kvarh (+) VA sys		VA sys dmd max			7				7	7	7
	6			(text) "PArt"	"PArt" = Partial kvarh (+)						7	7	7
	7			Х			Х	Х	х				
	8	Totalizer 2 (2)	W sys (8)	(text) (3)	(1)			Х			Х	Х	х
	ത	Totalizer 3 (2)	W sys (8)	(text) (3)	(1)			Х			Х	Х	х
	10	kWh (+)	t1 tariff (4)	W sys dmd	(1) digital input enabled			Х			Х	Х	х
	11	kWh (+)	t2 tariff (4)	W sys dmd	(1) digital input enabled			Х			Х	Х	х
	12	kWh (+)	t3 tariff (4)	W sys dmd	(1) digital input enabled			5			5	5	5
	13	kWh (+)	t4 tariff (4)	W sys dmd	(1) digital input enebled	5 5		5	5	5			
	14	kvarh (+)	t1 tariff (4)	W sys dmd	(1) digital input enabled			7			7	7	7
	15	kvarh (+)	t2 tariff (4)	W sys dmd	(1) digital input enabled			7			7	7	7
	16	kvarh (+)	t3 tariff (4)	W sys dmd	(1) digital input enabled			5,7			5,7	5,7	5,7
	17	kvarh (+)	t4 tariff (4)	W sys dmd	(1) digital input enabled			5,7			5,7	5,7	5,7
	18	kWh (+) X	WX	User X	(1) specific function enabled				Х				
	19	kWh (+) Y	WY	User Y	(1) specific function enabled				Х				
	20 kWh (+) Z		WZ	User Z	(1) specific function enabled				Х				
	21	Total kvarh (-)	VA sys dmd	VA sys dmd max					7				
	22	Total kWh (-)	W sys dmd	W sys dmd max					х				
	23	Hours	W sys	PF sys				Х	х				
	24	Hours	var sys	PF sys				7	7				
	25 var L1 var L2 var L3 26 VA L1 VA L2 VA L3				7	7							
						7	7						
	27	27 PF L1 PF L2		PF L3								7	7
	28	W L1	W L2	W L3						7		7	7
	29	A L1	A L2	A L3				Х		Х		Х	х
	30	V L1-2	V L2-3	V L3-1				6				6	6
	31	V L1	V L2	V L3			7		7	7		7	7
0	Sel	Selector position which can be linked to any of the variable combinations listed above (No. from 1 to 31)											
1	Sel	selector position which can be linked to any of the variable combinations listed above (No. from 1 to 31)											
2	Sel	ector position wh	ich can be linked	to any of the va	riable combinations listed abov	e (N	o. fr	om 1	l to	31)			
3	Sel	Selector position which can be linked to any of the variable combinations listed above (No. from 1 to 31)											
	In t	In this position the front LED blinks proportionally to the reactive energy (kvarh) being measured											

- (1) The page is available according to the enabled measurement.
- (2) m³ Gas, m³ Water, kWh remote heating, external kWh meter.
- (3) Hot and Cold (water), GAS. ENE (external energy meter).
- (4) The active tariff is displayed with an "A" before the "t1-t2-t3-t4" symbols.
- (5) These pages are not available in case of Dupline system.
- (6) Pages not available in case of 1-phase system (1P selection).
- (7) Pages not available in case of 3-phase unbalanced system (3P selection).
- (8) In case of external kWh meter the text "W sys" is replaced by "out".

Note: in case of alarm the whole display blinks. The blinking stops when either the selector or the joystick are used. The display starts to blink again after 60 seconds of the last command being used. There is a time-out of 60s that brings the scrolled page to the default one (selectable according to the table given above).



Additional available information on the display

Туре	1st line	2nd line	3rd line		
Meter information	Firmware revision	YEAr (text)	Year of production		
Meter information	PuLSE (text)	PuLSE (text) LEd (text)			
Meter information	System (1-2-3-phase)	Connection (2-3-4-wire)	dmd (time)		
Meter information (AV5-6)	Ct rAtio (text)	1.0 60.0k			
Meter information (AV5-6)	UT rAtio (text)	1.06.0k			
In case of alarm output	Alarm output 1 or 2 status	Set-point value	Alarm type		
In case of pulse output	Pulse output 1 or 2 variable link (kWh/kvarh)	Output pulse weight (kWh-kvarh / pulse)	Empty (positive energy pulse) nEG (negative energy pulse)		
In case of communication port	SEriAL (text)	Address number	RS485 status (RX-TX)		
In case of communication port	Secondary address (for M-bus protocol)		Sn		
In case of Dupline port	Dupline (text) or EM24 (text)	OK err			

List of selectable applications

	Description	Notes
Α	Basic domestic **	Mainly energy metering
В	Shopping centres **	Mainly energy metering
С	Advanced domestic **	Mainly energy metering (total and based on tariff), gas and water metering
D	Multi domestic (also camping and marinas) * /**	Mainly energy metering (3 by single phase)
Е	Solar *	Energy meter with some basic power analyzer functions
F	Industrial *	Mainly energy metering
G	Advanced industrial **	Energy metering and power analysis
Н	Advanced industrial for power generation *	Complete energy metering and power analysis

Notes: * Not available with option PF A. ** Not available with option PF B

Insulation between inputs and outputs

	Measuring Inputs	Relay outputs	Open collector outputs	Comm. port and digital inputs	Dupline	Self power supply	Auxiliary power supply
Measuring Inputs	-	4kV	4kV	4kV	4kV	0kV	4kV
Relay outputs	4kV	-	-	-	-	4kV	4kV
Open collector outputs	4kV	-	-	-	-	4kV	4kV
Comm. port and digital inputs	4kV	-	-	-	-	4kV	4kV
Dupline	4kV	-	-	-	-	4kV	4kV
Self power supply	0kV	4kV	4kV	4kV	4kV	-	-
Aux. power supply	4kV	4kV	4kV	4kV	4kV	-	-

NOTE: all the models with auxiliary power supply have, mandatorily, to be connected to external current transformers because the isolation among the current inputs is just functional (100VAC).

Tamper proof accessory kit



The "tamper proof" kit (two screw protection covers) is available with the "PF" option.

The instrument (PF option) is sealed in

- Front selector (to lock the instrument programming).


After installation it must be sealed in other two points:

- Upper cover;
- Lower cover.







Wiring diagrams




(65A) System type selection: 3P.n




(65A) System type selection: 3P




(65A) System type selection: 2P





(65A) System type selection: 1P






(10A) System type selection: 3P.n












Wiring diagrams


(10A) System type selection: 3P.n










(10A) System type selection: 3P.1









(10A) System type selection: 2P






(10A) System type selection: 1P







Wiring diagrams


(10A) System type selection: 1P










Power supply wiring diagrams (auxiliary power supply)









Open collector and relay outputs wiring diagrams










The load resistances (RC) must be designed so that the close contact current is lower than 100mA; the VDC voltage must be lower than or equal to 30VDC.




Digital inputs, RS485 and Dupline ports wiring diagrams




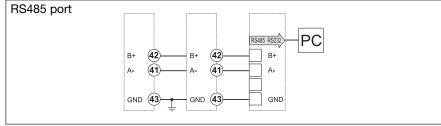



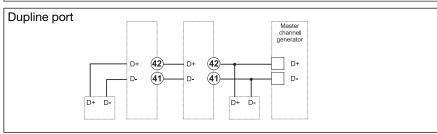

Front panel description

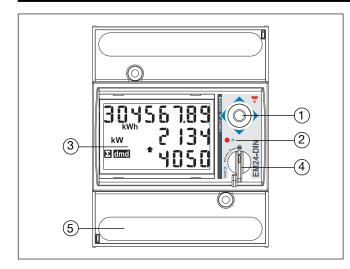

1. Joystick

To program the configuration parameters and scroll the variables on the display.

2. LED

Red LED blinking proportional to the energy being measured.

3. Display

LCD-type with alphanumeric indications to:

- display configuration parameters;
- display all the measured variables.

4. Selector

To select the desired display pages and to lock the programming.

5. Connections

Screw terminal blocks for instrument wiring.

Dimensions

